


## SEDM

### Multi compartment smoke control damper

Technical Documentation

Installation, Commissioning, Operation, Maintenance and Service Manual

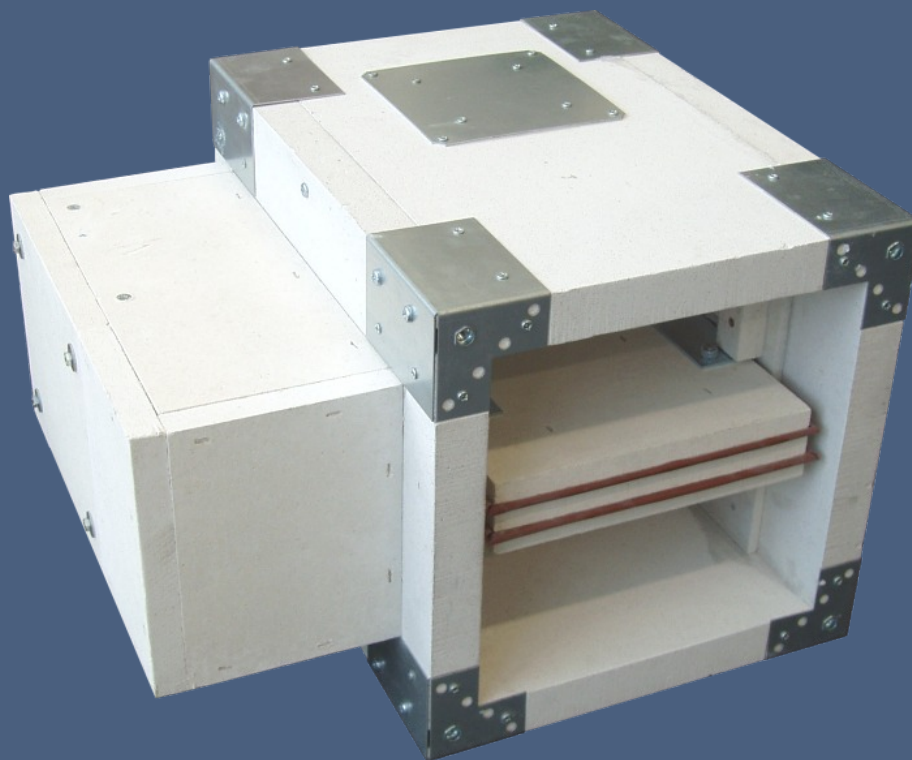

These technical specifications state a row of manufactured sizes, main dimensions, design and range of use of multi compartment smoke control dampers SEDM.

It is valid for production, design, ordering, delivery, storage, assembly, operation, maintenance and serviceability checks.

# CONTENT

I. GENERAL.....	3
Description.....	3
II. DESIGN.....	4
Design with actuating mechanism.....	4
III. DIMENSIONS.....	9
Technical parameters.....	11
IV. INSTALLATION.....	23
Placement and installation.....	23
Statement of installations.....	25
Installation in solid wall construction.....	26
Installation in gypsum wall construction.....	29
Installation in solid ceiling construction.....	32
Installation in battery.....	35
Installation into/onto vertical or horizontal smoke extraction duct.....	47
V. SUSPENSION SYSTEMS.....	51
Example of duct connection.....	57
VI. ACCESSORIES.....	62
VII. TECHNICAL DATA.....	63
Pressure loss.....	63
Noise data - level of acoustic output corrected with filter A.....	65
VIII. MATERIAL, FINISHING.....	71
IX. TRANSPORTATION, STORAGE AND WARRANTY.....	72
Logistic terms.....	72
Warranty.....	72
X. ASSEMBLY, ATTENDANCE AND MAINTENANCE.....	72
Electrical connection of the actuator in protection box.....	73
Entry into service and revisions.....	74
XI. ORDERING INFORMATION.....	75
Ordering key.....	75
Data label.....	75

# I. GENERAL

## Description


Smoke control damper are designed into an inlet or extract smoke ventilation system. The dampers are designed either to close to provide compartmentalization or to open (for fresh air inlet) or to allow removal of the heat and combustible products from a fire in the affected fire zone/compartment.

The damper blade is controlled by electrical actuating mechanism.

Dampers are fire resistant and are intended for systems with manual or automatic activation.

Dampers are designed for using in fire compartments that can be connected to the smoke exhaust ducts (tested according to EN 1366-8) or they can be installed in or on the construction of the fire compartment.

Dampers can be delivered with or without flange(s), with cover grille(s).

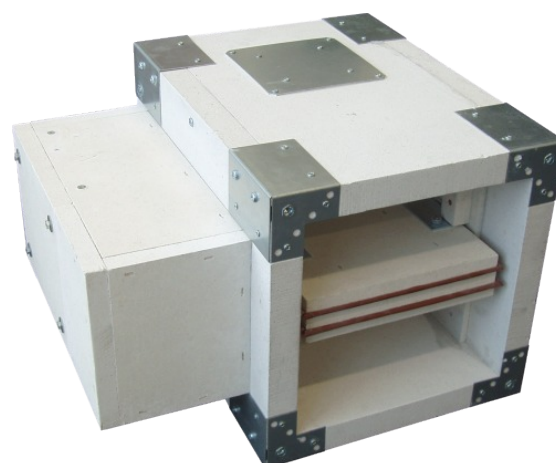

*Damper SEDM*

### Damper characteristics

- CE certified acc. to EN 12101-8
- Tested in accordance with EN 1366-10
- Classified acc. to EN 13501-4
- External Casing leakage class ATC 3 (old marking "C"), Internal leakage min. class 2 acc. to EN 1751
- Cycling test in class  $C_{mod}$  acc. to EN 12101-8
- Certificate of constancy of performance No. 1391-CPR-XXXX/XXXX
- Declaration of Performance No. PM/SEDM/01/XX/X
- Hygienic assessment - Report No. 1.6/pos/19/19c

### Classification of Dampers

Supporting construction	Installation type	Classification
Horizontal or vertical smoke extraction ducts	Connection to single or multi compartment smoke extraction ducts tested according to EN 1366-8 or 9	EI 120 ( $h_{od}-v_{ed} i \leftrightarrow o$ ) S1000 $C_{mod}$ HOT 400/30MAmulti
In solid/ gypsum plasterboard wall construction, min. thickness 100 mm	Mortar or gypsum	EI 120 ( $v_{ew} i \leftrightarrow o$ ) S1500 $C_{mod}$ HOT 400/30MAmulti
	Ablative Coated Batt	
	Mineral wool and boards	EI 120 ( $v_{ew} i \leftrightarrow o$ ) S1000 $C_{mod}$ HOT 400/30MAmulti
In solid ceiling construction, min. thickness 150 mm	Mortar or gypsum	
	Ablative Coated Batt	EI 120 ( $h_{ow} i \leftrightarrow o$ ) S1500 $C_{mod}$ HOT 400/30MAmulti
	Mineral wool and boards	

### Working conditions

- Exact damper function is provided under the following conditions
  - maximum air velocity 15 m/s
  - underpressure max. -1500 Pa or overpressure max. 500 Pa
- Dampers are designed for installation in vertical or horizontal openings of fire separating constructions.
- The damper may be in any position between the position open and closed (those positions included) at the beginning of the risk of fire. Command to close the damper shall be started within 30 seconds from the beginning of the risk of fire; command to open the damper shall be started within 25 minutes from the beginning of the risk of fire.
- Dampers are designed for macroclimatic areas with mild climate according to EN IEC 60 721-3-3 ed.2., class 3K22. (Environment 3K22 is typically protected place with regulated temperature)
- Temperature in the place of installation is permitted to range from -30°C to +50°C.

## II. DESIGN


### Design with actuating mechanism

#### Design .44 and .54

- Belimo actuators are used for dampers, series BEN, BEE, BE for 230V AC resp. 24 V AC/DC, Schischek InMax 50.75-S actuators (universal 24V or 230V supply) are used for large size of dampers.
- After connection to the power supply voltage, the actuator moves the damper blade to the "OPEN" position or "CLOSED" (according to the corresponding connection, see wiring diagram). If the power supply is interrupted, the actuator stops at the current position. The signalling of the "OPEN" and "CLOSED" damper blade positions is ensured by two built-in fixed "potential-free" end- limit switches.
- The actuator for operating the damper blade is mounted in an insulated cover/box. It is accessible after removing the cover lid. The electrical connection of the actuator is made with a non-flammable cable (or a cable located in the adjoining cable duct), which passes through an opening made in the wall of the insulated cover/box when installing the damper or when connecting the actuator power cable. Cable penetrations must meet a minimum fire resistance of 30 minutes.


#### Design .65

- Belimo modulating actuators, BEN (BEE)-SR series for 24V AC/DC are specially designed for remote control of smoke control dampers. The position of the damper blade is adjustable by means of control voltage 0 (2)...10V DC.
- The signalling of the "OPEN" and "CLOSED" damper blade positions is ensured by two built-in fixed "potential-free" limit switches.
- The actuator for operating the damper blade is mounted in an insulated cover/box. It is accessible after removing the cover lid. The electrical connection of the actuator is made with non-flammable cables (or cables located in the adjoining cable duct), which pass through an opening made in the wall of the insulated cover when installing the damper or when connecting the power cables of the actuator. Cable penetrations must meet a minimum fire resistance of 30 minutes.

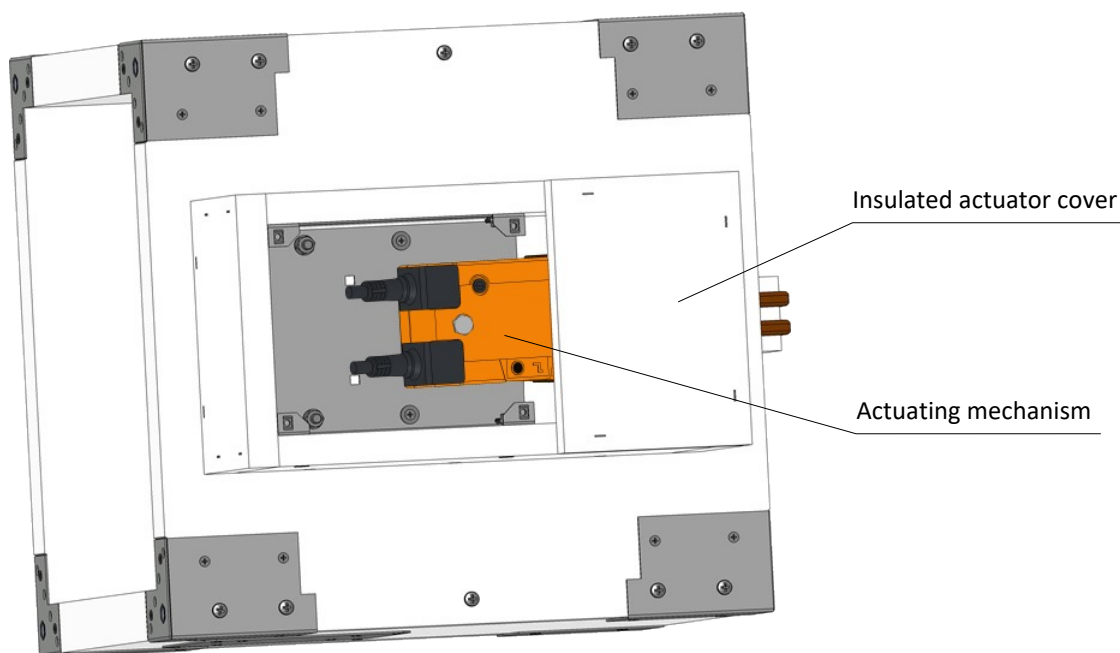


Design .44, .54 and .65


**Actuator BELIMO BEN 24(-ST)**

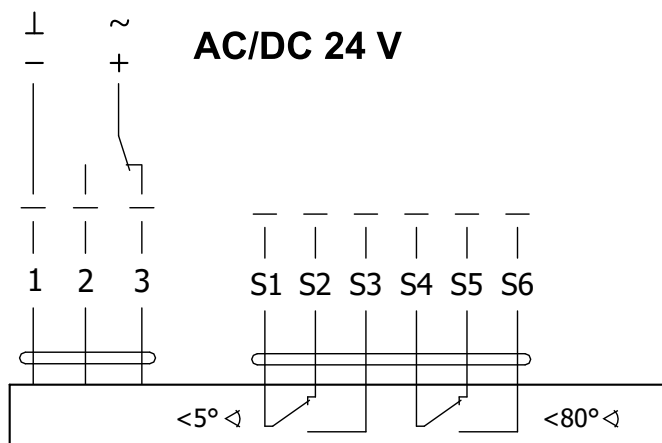

**Actuator BELIMO BEN 24-SR**

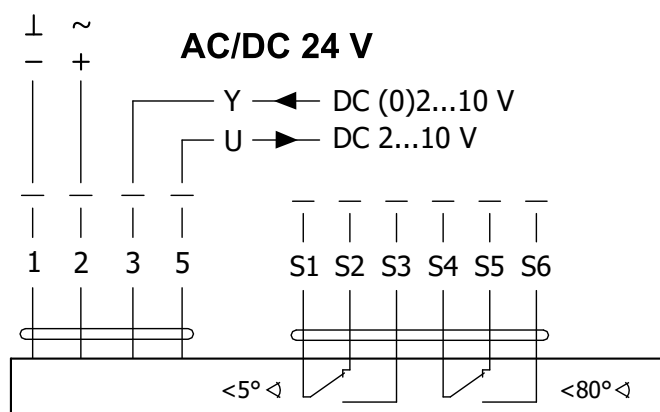

**Actuator BELIMO BEN 230**

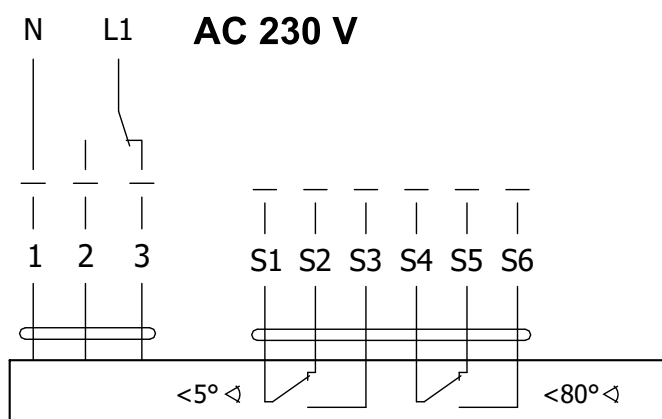


**Actuator BELIMO BEN 24(-ST), BEN 24-SR, BEN 230**


Actuator BELIMO - 15 Nm	BEN 24(-ST)	BEN 24-SR*	BEN 230
Power voltage	AC/DC 24 V 50/60Hz	AC/DC 24 V 50/60Hz	AC 230 V 50/60Hz
Power consumption - in operation - in the end position	3 W 0,1 W	3 W 0,3 W	4 W 0,4 W
Dimensioning	6 VA (I <sub>max</sub> 8,2 A @ 5 ms)	6,5 VA (I <sub>max</sub> 8.2 A @ 5 ms)	7 VA (I <sub>max</sub> 4 A @ 5 ms)
Protection class	III	III	II
Degree of protection		IP 54	
Adjustment time for 95°		< 30 s	
Ambient temperature Storage temperature		-30°C ... +55°C -40°C ... +80°C	
Connection - drive - auxiliary switch	Cable 1 m, 3 x 0,75 mm <sup>2</sup> Cable 1 m, 6 x 0,75 mm <sup>2</sup> (BEN 24(-ST) with plug connectors	Cable 1 m, 4 x 0,75 mm <sup>2</sup> Cable 1 m, 6 x 0,75 mm <sup>2</sup>	Cable 1 m, 3 x 0,75 mm <sup>2</sup> Cable 1 m, 6 x 0,75 mm <sup>2</sup>

\* Only available for 24V and selected damper sizes


Actuator BELIMO BEE 24(-ST)

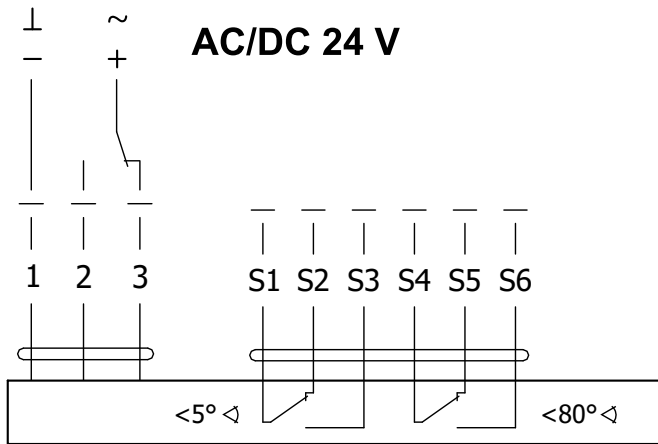

Actuator BELIMO BEE 24-SR

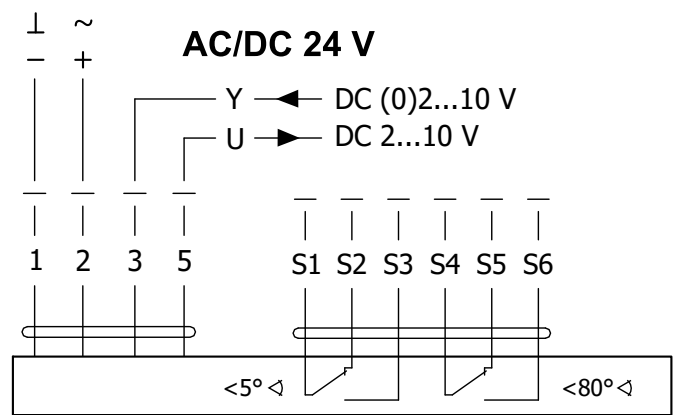

Actuator BELIMO BEE 230

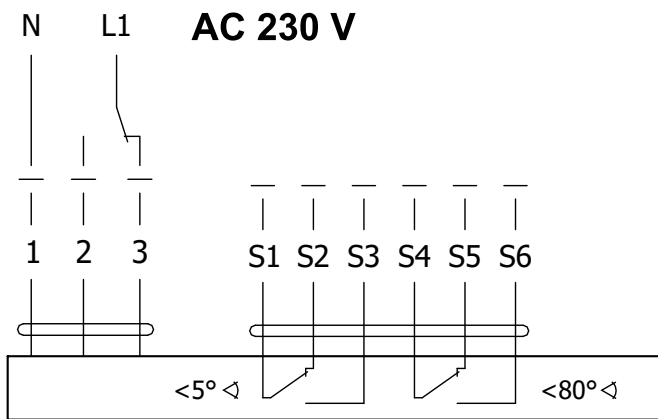


Actuator BELIMO BEE 24(-ST), BEE 24-SR, BEE 230


Actuator BELIMO - 25 Nm	BEE 24(-ST)	BEE 24-SR*	BEE 230
Power voltage	AC/DC 24 V 50/60Hz	AC/DC 24 V 50/60Hz	AC 230 V 50/60Hz
Power consumption - in operation - in the end position	2,5 W 0,1 W	3 W 0,3 W	3,5 W 0,4 W
Dimensioning	5 VA (Imax 8,2 A @ 5 ms)	5,5 VA (Imax 8.2 A @ 5 ms)	6 VA (Imax 4 A @ 5 ms)
Protection class	III	III	II
Degree of protection		IP 54	
Adjustment time for 95°		< 60 s	
Ambient temperature Storage temperature		-30°C ... +55°C -40°C ... +80°C	
Connection - drive - auxiliary switch	Cable 1 m, 3 x 0,75 mm <sup>2</sup> Cable 1 m, 6 x 0,75 mm <sup>2</sup> (BEE 24-ST) with plug connectors	Cable 1 m, 4 x 0,75 mm <sup>2</sup> Cable 1 m, 6 x 0,75 mm <sup>2</sup>	Cable 1 m, 3 x 0,75 mm <sup>2</sup> Cable 1 m, 6 x 0,75 mm <sup>2</sup>

\* Only available for 24V and selected damper sizes

**Actuator BELIMO BE 24-12(-ST)**

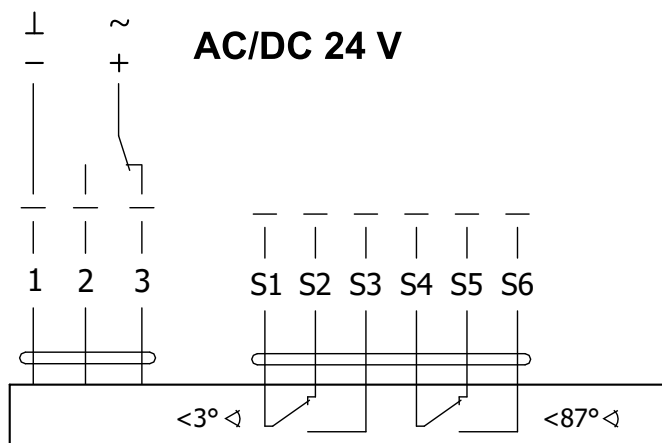

**Actuator BELIMO BE 230-12**

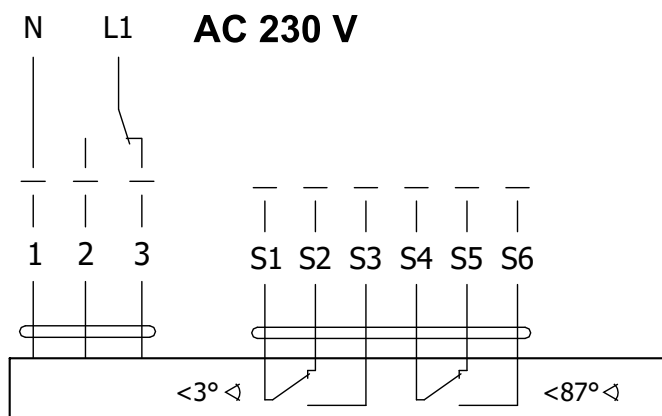


**Actuator BELIMO BE 24-12(-ST), BE 230-12**

Actuator BELIMO - 40 Nm	BE 24-12(-ST)	BE 230-12
Power voltage	AC/DC 24 V 50/60Hz	AC 230 V 50/60Hz
Power consumption - in operation - in the end position	12 W 0,5 W	8 W 0,5 W
Dimensioning	18 VA (I <sub>max</sub> 8,2 A @ 5 ms)	15 VA (I <sub>max</sub> 7.9 A @ 5 ms)
Protection class	III	II
Degree of protection	IP 54	
Adjustment time for 95°	< 60 s	
Ambient temperature	-30°C ... +55°C	
Storage temperature	-40°C ... +80°C	
Connection - drive - auxiliary switch	Cable 1 m, 3 x 0,75 mm <sup>2</sup> Cable 1 m, 6 x 0,75 mm <sup>2</sup> (BE 24-ST) with plug connectors	

**Actuator SCHISCHEK InMax 50.75-S**

24...230 VAC/DC

Integrated aux. switches max 24V/3A,  
240V/0,25A switching at 5° and 85°.

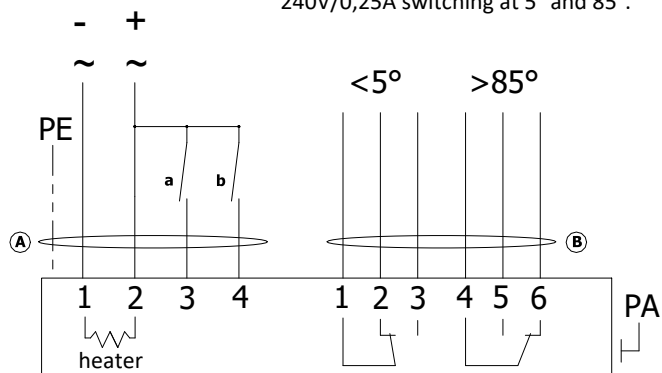


**Actuator SCHISCHEK InMax 50.75-S**

Actuator SCHISCHEK	InMax 50.75-S
Power voltage	24-240 VAC/DC 50/60Hz
Power consumption - in operation - heating	10 W 16 W (start at -20°C)
Protection class	I
Degree of protection	IP 66
Adjustment time for 95°	< 60 s
Ambient temperature	-40°C ... +50°C
Storage temperature	-40°C ... +70°C
Connection	cable 1 m, 0,5 mm <sup>2</sup>




### III. DIMENSIONS

SEDM without flange

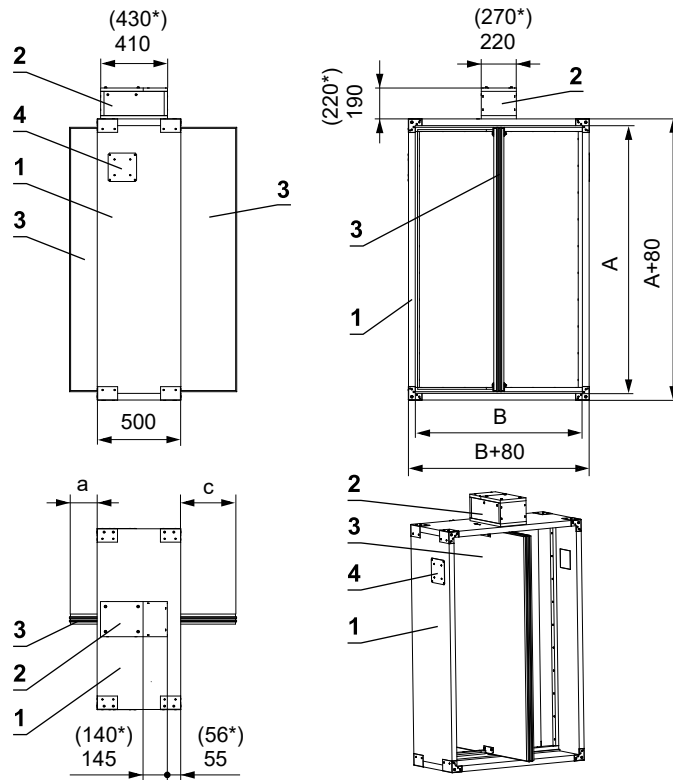

SEDM with flange

■ External dimensions of flange A(B) + 60 is not same as external dimensions of damper



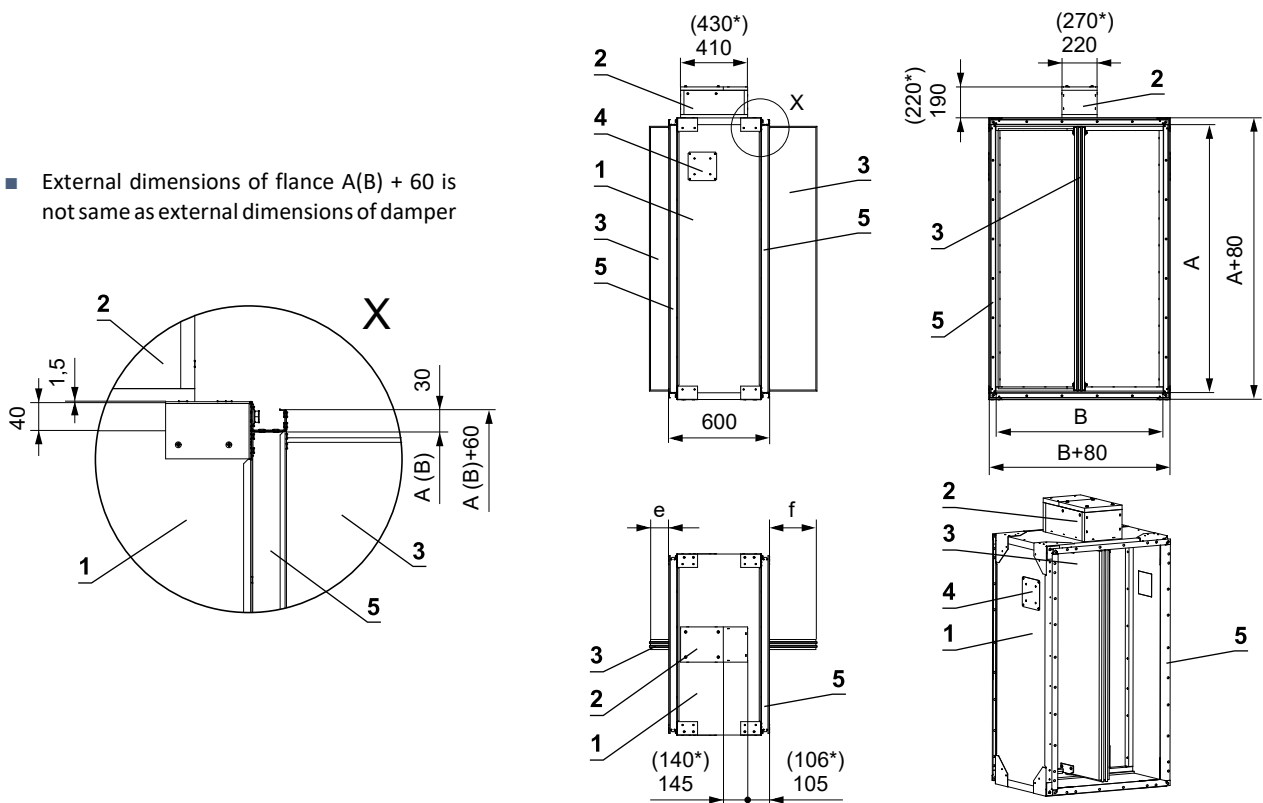


- 1 SEDM
- 2 Actuating mechanism
- 3 Damper blade
- 4 Inspection opening cover
- 5 Flange\*\*


\* Dimensions with actuating mechanism InMax 50.75S.  
 \*\* If it is necessary, arbitrary flange could be removed.

**Damper blade overlaps**

- For damper without flanges the open damper blade overlaps the damper body from dimension B = 250 by the value "c" or "a" and "c". These values are specified in chapter Technical parameters → see pages 11 to 22.
- For damper with flanges the open damper blade overlaps the damper body from dimension B = 355 by the value "f" or "e" and "f". These values are specified in chapter Technical parameters → see pages 11 to 22.

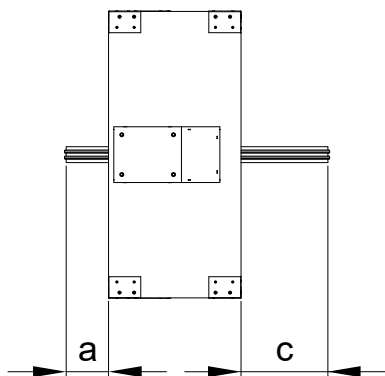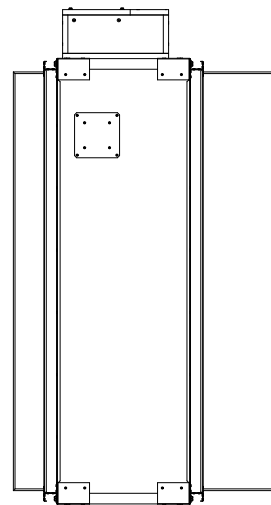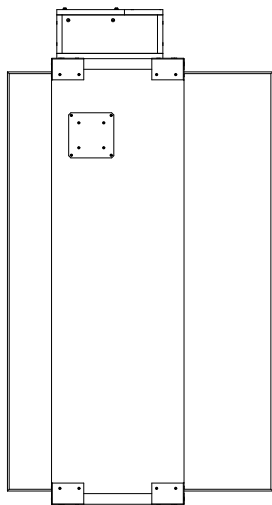


Values "a" and "c" - without flange

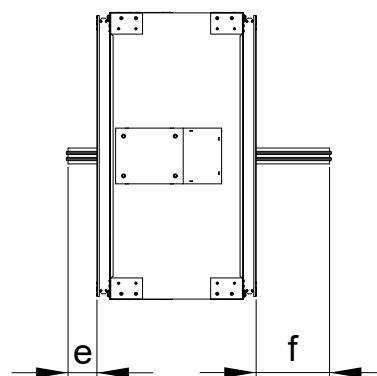

Hodnoty "e" and "f" - with flange

Values "a", "c", "e" a "f" has to be respected when projecting following air-conditioning duct.

**Flange of a damper**

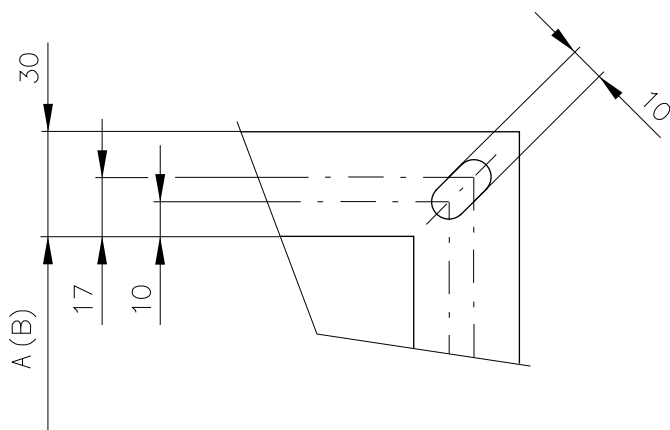

30 mm wide flanges are fitted with oval holes in the corners

### Technical parameters

A x B [mm]	Damper blade overlaps without flanges		Damper blade overlaps with flanges		Weight [kg]		Effective area Sef [m <sup>2</sup> ]	Actuating mechanism type	
	a [mm]	c [mm]	e [mm]	f [mm]	Without flanges	With flanges			
180 x	180	-	-	-	-	38,3	41,4	0,0077	BELIMO BEN (15 N.m)
	200	-	-	-	-	39,6	42,8	0,0099	
	225	-	-	-	-	41,2	44,4	0,0127	
	250	-	-	-	-	42,8	46,2	0,0154	
	280	-	-	-	-	44,6	48,2	0,0187	
	300	-	-	-	-	45,9	49,5	0,0209	
	315	-	-	-	-	46,8	50,6	0,0226	
	355	-	6,5	-	-	49,3	53,3	0,0270	
	400	-	29	-	-	52,1	56,4	0,0319	
	450	-	54	-	4	55,2	59,8	0,0374	
	500	-	79	-	29	58,3	63,2	0,0429	
	550	-	104	-	54	61,4	66,6	0,0484	
	560	-	109	-	59	62,1	67,2	0,0495	
	600	-	129	-	79	64,7	69,9	0,0539	
	630	-	144	-	94	66,6	72,1	0,0572	
	650	-	154	-	104	67,8	73,4	0,0594	
	700	11	179	-	129	70,9	76,8	0,0649	
	710	16	184	-	134	71,6	77,5	0,0660	
	750	36	204	-	154	74,0	80,2	0,0704	
	800	61	229	11	179	77,1	83,6	0,0759	
900	111	279	61	229	83,4	90,5	0,0869		
1000	161	329	111	279	89,6	97,2	0,0979		
180	-	-	-	-	39,6	42,7	0,0091	BELIMO BEN (15 N.m)	
200	-	-	-	-	40,9	44,1	0,0117		
225	-	-	-	-	42,4	45,8	0,0150		
250	-	-	-	-	44,0	47,5	0,0182		
280	-	-	-	-	45,9	49,7	0,0221		
300	-	-	-	-	47,3	51,0	0,0247		
315	-	-	-	-	48,2	52,1	0,0267		
355	-	6,5	-	-	50,8	54,8	0,0319		
400	-	29	-	-	53,6	58,1	0,0377		
450	-	54	-	4	56,8	61,4	0,0442		
500	-	79	-	29	60,1	64,9	0,0507		
550	-	104	-	54	63,2	68,4	0,0572		
560	-	109	-	59	63,9	69,1	0,0585		
600	-	129	-	79	66,4	72,0	0,0637		
630	-	144	-	94	68,3	74,0	0,0676		
650	-	154	-	104	69,7	75,3	0,0702		
700	11	179	-	129	72,8	78,8	0,0767		
710	16	184	-	134	73,4	79,5	0,0780		
750	36	204	-	154	76,0	82,4	0,0832		BELIMO BEE (25 N.m)
800	61	229	11	179	79,2	85,9	0,0897		
900	111	279	61	229	85,6	92,7	0,1027		
1000	161	329	111	279	91,9	99,8	0,1157		
225 x	180	-	-	-	-	41,0	44,4	0,0109	BELIMO BEN (15 N.m)
	200	-	-	-	-	42,4	45,8	0,0140	
	225	-	-	-	-	44,0	47,5	0,0178	
	250	-	-	-	-	45,6	49,3	0,0217	
	280	-	-	-	-	47,7	51,4	0,0264	
	300	-	-	-	-	49,0	52,9	0,0295	
	315	-	-	-	-	50,0	54,0	0,0318	
	355	-	6,5	-	-	52,5	56,8	0,0380	

A x B [mm]	Damper blade overlaps without flanges		Damper blade overlaps with flanges		Weight [kg]		Effective area Sef [m <sup>2</sup> ]	Actuating mechanism type	
	a [mm]	c [mm]	e [mm]	f [mm]	Without flanges	With flanges			
225 x	400	-	29	-	-	55,5	60,1	0,0450	BELIMO BEN (15 N.m)
	450	-	54	-	4	58,9	63,6	0,0527	
	500	-	79	-	29	62,1	67,2	0,0605	
	550	-	104	-	54	65,3	70,7	0,0682	
	560	-	109	-	59	66,0	71,4	0,0698	
	600	-	129	-	79	68,7	74,3	0,0760	
	630	-	144	-	94	70,6	76,4	0,0806	
	650	-	154	-	104	72,0	77,9	0,0837	
	700	11	179	-	129	75,2	81,4	0,0915	
	710	16	184	-	134	75,9	82,1	0,0930	
	750	36	204	-	154	78,6	85,1	0,0992	
	800	61	229	11	179	81,8	88,6	0,1070	
900	111	279	61	229	88,4	95,7	0,1225		
1000	161	329	111	279	94,9	102,9	0,1380		
180	-	-	-	-	42,5	46,0	0,0126	BELIMO BEN (15 N.m)	
200	-	-	-	-	43,9	47,5	0,0162		
225	-	-	-	-	45,6	49,3	0,0207		
250	-	-	-	-	47,3	51,2	0,0252		
280	-	-	-	-	49,3	53,3	0,0306		
300	-	-	-	-	50,6	54,8	0,0342		
315	-	-	-	-	51,7	55,9	0,0369		
355	-	6,5	-	-	54,4	58,7	0,0441		
400	-	29	-	-	57,4	62,1	0,0522		
450	-	54	-	4	60,8	65,7	0,0612		
500	-	79	-	29	64,1	69,4	0,0702		
550	-	104	-	54	67,5	73,0	0,0792		
560	-	109	-	59	68,2	73,7	0,0810		
600	-	129	-	79	70,9	76,7	0,0882		
630	-	144	-	94	72,9	78,8	0,0936		
650	-	154	-	104	74,3	80,3	0,0972		
700	11	179	-	129	77,6	84,0	0,1062		
710	16	184	-	134	78,3	84,8	0,1080		
750	36	204	-	154	81,0	87,6	0,1152	BELIMO BEE (25 N.m)	
800	61	229	11	179	84,4	91,3	0,1242		
900	111	279	61	229	91,1	98,6	0,1422		
1000	161	329	111	279	97,9	105,8	0,1602		
180	-	-	-	-	42,8	46,2	0,0147	BELIMO BEN (15 N.m)	
200	-	-	-	-	44,1	47,7	0,0189		
225	-	-	-	-	45,8	49,4	0,0242		
250	-	-	-	-	47,5	51,2	0,0294		
280	-	-	-	-	49,4	53,4	0,0357		
300	-	-	-	-	50,8	54,9	0,0399		
315	-	-	-	-	51,7	56,0	0,0431		
355	-	6,5	-	-	54,5	58,9	0,0515		
400	-	29	-	-	57,5	62,1	0,0609		
450	-	54	-	4	60,8	65,8	0,0714		
500	-	79	-	29	64,2	69,4	0,0819		
550	-	104	-	54	67,5	72,9	0,0924		
560	-	109	-	59	68,3	73,7	0,0945		
600	-	129	-	79	70,9	76,6	0,1029		
630	-	144	-	94	72,9	78,8	0,1092		

A x B [mm]	Damper blade overlaps without flanges		Damper blade overlaps with flanges		Weight [kg]		Effective area Sef [m <sup>2</sup> ]	Actuating mechanism type	
	a [mm]	c [mm]	e [mm]	f [mm]	Without flanges	With flanges			
280 x	650	-	154	-	104	74,2	80,2	0,1134	BELIMO BEN (15 N.m)
	700	11	179	-	129	77,6	83,9	0,1239	
	710	16	184	-	134	78,3	84,6	0,1260	
	750	36	204	-	154	80,9	87,5	0,1344	
	800	61	229	11	179	84,2	91,1	0,1449	
	900	111	279	61	229	91,0	98,3	0,1659	
	1000	161	329	111	279	97,6	105,6	0,1869	
300 x	180	-	-	-	-	43,9	47,5	0,0161	BELIMO BEN (15 N.m)
	200	-	-	-	-	45,2	49,0	0,0207	
	225	-	-	-	-	46,9	50,8	0,0265	
	250	-	-	-	-	48,8	52,7	0,0322	
	280	-	-	-	-	50,7	54,9	0,0391	
	300	-	-	-	-	52,1	56,3	0,0437	
	315	-	-	-	-	53,2	57,5	0,0472	
	355	-	6,5	-	-	55,9	60,3	0,0564	
	400	-	29	-	-	58,9	63,7	0,0667	
	450	-	54	-	4	62,4	67,3	0,0782	
	500	-	79	-	29	65,8	71,1	0,0897	
	550	-	104	-	54	69,2	74,8	0,1012	
	560	-	109	-	59	69,8	75,5	0,1035	
	600	-	129	-	79	72,5	78,4	0,1127	
	630	-	144	-	94	74,6	80,6	0,1196	
	650	-	154	-	104	76,1	82,2	0,1242	
	700	11	179	-	129	79,4	85,8	0,1357	
	710	16	184	-	134	80,1	86,6	0,1380	
	750	36	204	-	154	82,8	89,4	0,1472	
	800	61	229	11	179	86,3	93,2	0,1587	
900	111	279	61	229	93,1	100,6	0,1817		
1000	161	329	111	279	100,0	107,9	0,2047		
315 x	180	-	-	-	-	44,7	48,5	0,0172	BELIMO BEN (15 N.m)
	200	-	-	-	-	46,2	49,9	0,0221	
	225	-	-	-	-	47,8	51,7	0,0282	
	250	-	-	-	-	49,7	53,7	0,0343	
	280	-	-	-	-	51,7	55,9	0,0417	
	300	-	-	-	-	53,0	57,5	0,0466	
	315	-	-	-	-	54,1	58,5	0,0502	
	355	-	6,5	-	-	56,9	61,5	0,0600	
	400	-	29	-	-	60,1	64,9	0,0711	
	450	-	54	-	4	63,4	68,6	0,0833	
	500	-	79	-	29	67,0	72,4	0,0956	
	550	-	104	-	54	70,5	76,1	0,1078	
	560	-	109	-	59	71,1	76,8	0,1103	
	600	-	129	-	79	73,8	79,8	0,1201	
	630	-	144	-	94	75,9	82,0	0,1274	
	650	-	154	-	104	77,4	83,6	0,1323	
	700	11	179	-	129	80,9	87,4	0,1446	
	710	16	184	-	134	81,5	88,0	0,1470	
	750	36	204	-	154	84,2	91,0	0,1568	
	800	61	229	11	179	87,8	94,8	0,1691	
900	111	279	61	229	94,6	102,3	0,1936		
1000	161	329	111	279	101,7	109,7	0,2181		
								BELIMO BEE (25 N.m)	

A x B [mm]	Damper blade overlaps without flanges		Damper blade overlaps with flanges		Weight [kg]		Effective area Sef [m <sup>2</sup> ]	Actuating mechanism type	
	a [mm]	c [mm]	e [mm]	f [mm]	Without flanges	With flanges			
355 x	180	-	-	-	46,3	50,2	0,0200	BELIMO BEN (15 N.m)	
	200	-	-	-	47,7	51,7	0,0257		
	225	-	-	-	49,5	53,6	0,0328		
	250	-	-	-	51,3	55,6	0,0399		
	280	-	-	-	53,5	57,9	0,0485		
	300	-	-	-	54,9	59,4	0,0542		
	315	-	-	-	55,9	60,5	0,0584		
	355	-	6,5	-	58,8	63,5	0,0698		
	400	-	29	-	62,0	66,9	0,0827		
	450	-	54	-	65,5	70,8	0,0969		
	500	-	79	-	69,1	74,6	0,1112		
	550	-	104	-	72,6	78,5	0,1254		
	560	-	109	-	73,3	79,2	0,1283		
	600	-	129	-	76,2	82,2	0,1397		
	630	-	144	-	78,3	84,5	0,1482		
	650	-	154	-	79,7	86,0	0,1539		
	700	11	179	-	83,3	89,9	0,1682		
	710	16	184	-	84,0	90,6	0,1710		
	750	36	204	-	86,8	93,7	0,1824		
	800	61	229	11	179	90,4	97,5		0,1967
900	111	279	61	229	97,4	105,1	0,2252		
1000	161	329	111	279	104,6	112,8	0,2537		
400 x	180	-	-	-	49,7	53,8	0,0231	BELIMO BEN (15 N.m)	
	200	-	-	-	51,2	55,5	0,0297		
	225	-	-	-	53,0	57,5	0,0380		
	250	-	-	-	55,0	59,5	0,0462		
	280	-	-	-	57,2	61,9	0,0561		
	300	-	-	-	58,8	63,4	0,0627		
	315	-	-	-	59,8	64,7	0,0677		
	355	-	6,5	-	62,9	68,0	0,0809		
	400	-	29	-	66,2	71,5	0,0957		
	450	-	54	-	69,9	75,5	0,1122		
	500	-	79	-	73,7	79,6	0,1287		
	550	-	104	-	77,5	83,6	0,1452		
	560	-	109	-	78,3	84,4	0,1485		
	600	-	129	-	81,3	87,6	0,1617		
	630	-	144	-	83,5	90,1	0,1716		
	650	-	154	-	85,0	91,7	0,1782		
	700	11	179	-	129	88,8	95,7		0,1947
	710	16	184	-	134	89,6	96,5		0,1980
	750	36	204	-	154	92,6	99,7		0,2112
	800	61	229	11	179	96,3	103,7		0,2277
900	111	279	61	229	103,7	111,8	0,2607		
1000	161	329	111	279	111,3	119,9	0,2937		
450 x	180	-	-	-	52,7	57,1	0,0266	BELIMO BEN (15 N.m)	
	200	-	-	-	54,2	58,8	0,0342		
	225	-	-	-	56,2	60,8	0,0437		
	250	-	-	-	58,1	62,9	0,0532		
	280	-	-	-	60,5	65,4	0,0646		
	300	-	-	-	62,0	67,1	0,0722		
	315	-	-	-	63,2	68,4	0,0779		

A x B [mm]	Damper blade overlaps without flanges		Damper blade overlaps with flanges		Weight [kg]		Effective area Sef [m²]	Actuating mechanism type		
	a [mm]	c [mm]	e [mm]	f [mm]	Without flanges	With flanges				
450 x	355	-	6,5	-	-	66,3	71,8	0,0931	BELIMO BEN (15 N.m)	
	400	-	29	-	-	69,9	75,5	0,1102		
	450	-	54	-	4	73,8	79,7	0,1292		
	500	-	79	-	29	77,7	83,9	0,1482		
	550	-	104	-	54	81,6	88,0	0,1672		
	560	-	109	-	59	82,4	88,9	0,1710		
	600	-	129	-	79	85,5	92,3	0,1862		
	630	-	144	-	94	87,9	94,8	0,1976		
	650	-	154	-	104	89,4	96,5	0,2052		
	700	11	179	-	129	93,5	100,6	0,2242		
	710	16	184	-	134	94,3	101,5	0,2280		
	750	36	204	-	154	97,4	104,8	0,2432		
	800	61	229	11	179	101,3	109,1	0,2622		BELIMO BEE (25 N.m)
	900	111	279	61	229	109,1	117,4	0,3002		
1000	161	329	111	279	118,3	127,1	0,3382			
500 x	180	-	-	-	-	53,4	56,9	0,0301	BELIMO BEN (15 N.m)	
	200	-	-	-	-	55,0	58,7	0,0387		
	225	-	-	-	-	56,9	60,6	0,0495		
	250	-	-	-	-	58,9	62,7	0,0602		
	280	-	-	-	-	61,3	65,2	0,0731		
	300	-	-	-	-	62,9	66,9	0,0817		
	315	-	-	-	-	64,0	68,1	0,0882		
	355	-	6,5	-	-	67,1	71,5	0,1054		
	400	-	29	-	-	70,8	75,2	0,1247		
	450	-	54	-	4	74,6	79,2	0,1462		
	500	-	79	-	29	78,6	83,4	0,1677		
	550	-	104	-	54	82,5	87,5	0,1892		
	560	-	109	-	59	83,3	88,3	0,1935		
	600	-	129	-	79	86,5	91,6	0,2107		
	630	-	144	-	94	88,8	94,1	0,2236		
	650	-	154	-	104	90,4	95,8	0,2322		
	700	11	179	-	129	94,4	99,9	0,2537		
	710	16	184	-	134	95,1	100,7	0,2580		
	750	36	204	-	154	98,3	104,1	0,2752		
	800	61	229	11	179	102,3	108,1	0,2967		BELIMO BEE (25 N.m)
900	111	279	61	229	110,0	116,4	0,3397			
1000	161	329	111	279	119,3	126	0,3827			
550 x	180	-	-	-	-	56,1	61,0	0,0336	BELIMO BEN (15 N.m)	
	200	-	-	-	-	57,9	62,8	0,0432		
	225	-	-	-	-	59,9	64,9	0,0552		
	250	-	-	-	-	61,9	67,0	0,0672		
	280	-	-	-	-	64,4	69,6	0,0816		
	300	-	-	-	-	66,0	71,4	0,0912		
	315	-	-	-	-	67,3	72,8	0,0984		
	355	-	6,5	-	-	70,5	76,3	0,1176		
	400	-	29	-	-	74,3	80,1	0,1392		
	450	-	54	-	4	78,3	84,5	0,1632		
	500	-	79	-	29	82,4	88,9	0,1872		
	550	-	104	-	54	86,5	93,3	0,2112		
	560	-	109	-	59	87,4	94,1	0,2160		
	600	-	129	-	79	90,6	97,5	0,2352		

A x B [mm]	Damper blade overlaps without flanges		Damper blade overlaps with flanges		Weight [kg]		Effective area Sef [m <sup>2</sup> ]	Actuating mechanism type		
	a [mm]	c [mm]	e [mm]	f [mm]	Without flanges	With flanges				
550 x	630	-	144	-	94	93,1	100,1	0,2496	BELIMO BEN (15 N.m)	
	650	-	154	-	104	94,8	101,9	0,2592		
	700	11	179	-	129	98,8	106,3	0,2832		
	710	16	184	-	134	99,6	107,1	0,2880		
	750	36	204	-	154	102,9	110,6	0,3072		
	800	61	229	11	179	107,0	115,0	0,3312	BELIMO BEE (25 N.m)	
	900	111	279	61	229	116,5	125,0	0,3792		
	1000	161	329	111	279	124,6	133,6	0,4272	BELIMO BE (40 N.m)	
	560 x	180	-	-	-	-	56,8	61,5	0,0343	BELIMO BEN (15 N.m)
		200	-	-	-	-	58,4	63,4	0,0441	
225		-	-	-	-	60,5	65,5	0,0564		
250		-	-	-	-	62,5	67,8	0,0686		
280		-	-	-	-	65,0	70,4	0,0833		
300		-	-	-	-	66,6	72,1	0,0931		
315		-	-	-	-	67,9	73,4	0,1005		
355		-	6,5	-	-	71,3	76,9	0,1201		
400		-	29	-	-	74,9	80,9	0,1421		
450		-	54	-	4	79,0	85,3	0,1666		
500		-	79	-	29	83,1	89,6	0,1911		
550		-	104	-	54	87,3	94,0	0,2156		
560		-	109	-	59	88,1	94,9	0,2205		
600		-	129	-	79	91,5	98,4	0,2401		
630		-	144	-	94	93,9	101,1	0,2548		
650		-	154	-	104	95,6	102,9	0,2646		
700		11	179	-	129	99,8	107,3	0,2891		
710		16	184	-	134	100,5	108,1	0,2940		
750		36	204	-	154	103,9	111,6	0,3136		
800		61	229	11	179	108,0	116,0	0,3381	BELIMO BEE (25 N.m)	
900	111	279	61	229	117,5	126,0	0,3871			
1000	161	329	111	279	125,8	134,9	0,4361	BELIMO BE (40 N.m)		
600 x	180	-	-	-	-	59,0	64,0	0,0371	BELIMO BEN (15 N.m)	
	200	-	-	-	-	60,6	65,9	0,0477		
	225	-	-	-	-	62,8	68,1	0,0610		
	250	-	-	-	-	65,0	70,4	0,0742		
	280	-	-	-	-	67,5	73,0	0,0901		
	300	-	-	-	-	69,3	74,9	0,1007		
	315	-	-	-	-	70,5	76,3	0,1087		
	355	-	6,5	-	-	73,9	79,9	0,1299		
	400	-	29	-	-	77,8	83,9	0,1537		
	450	-	54	-	4	82,0	88,4	0,1802		
	500	-	79	-	29	86,3	92,9	0,2067		
	550	-	104	-	54	90,5	97,5	0,2332		
	560	-	109	-	59	91,4	98,4	0,2385		
	600	-	129	-	79	94,8	102,0	0,2597		
	630	-	144	-	94	97,4	104,8	0,2756		
	650	-	154	-	104	99,0	106,5	0,2862		
	700	11	179	-	129	103,3	111,0	0,3127		
	710	16	184	-	134	104,1	111,9	0,3180		
	750	36	204	-	154	107,5	115,5	0,3392		
	800	61	229	11	179	111,8	120,0	0,3657	BELIMO BEE (25 N.m)	
900	111	279	61	229	121,6	130,4	0,4187			



A x B [mm]	Damper blade overlaps without flanges		Damper blade overlaps with flanges		Weight [kg]		Effective area Sef [m <sup>2</sup> ]	Actuating mechanism type	
	a [mm]	c [mm]	e [mm]	f [mm]	Without flanges	With flanges			
600 x 1000	161	329	111	279	130,1	139,4	0,4717	BELIMO BE (40 N.m)	
	180	-	-	-	60,6	65,9	0,0392		
	200	-	-	-	62,4	67,6	0,0504		
	225	-	-	-	64,6	70,0	0,0644		
	250	-	-	-	66,8	72,3	0,0784		
	280	-	-	-	69,4	75,1	0,0952		
	300	-	-	-	71,1	76,9	0,1064		
	315	-	-	-	72,4	78,3	0,1148		
	355	-	6,5	-	-	75,9	82,0		0,1372
	400	-	29	-	-	79,9	86,1		0,1624
630 x	450	-	54	-	4	84,1	90,8	0,1904	BELIMO BEN (15 N.m)
	500	-	79	-	29	88,5	95,4	0,2184	
	550	-	104	-	54	92,9	100,0	0,2464	
	560	-	109	-	59	93,8	100,9	0,2520	
	600	-	129	-	79	97,3	104,6	0,2744	
	630	-	144	-	94	99,9	107,4	0,2912	
	650	-	154	-	104	101,6	109,3	0,3024	
	700	11	179	-	129	106,0	113,9	0,3304	
	710	16	184	-	134	106,9	114,8	0,3360	
	750	36	204	-	154	110,4	118,5	0,3584	
800	61	229	11	179	114,8	123,1	0,3864	BELIMO BEE (25 N.m)	
	900	111	279	61	229	124,6	133,6		0,4424
	1000	161	329	111	279	133,4	142,9		0,4984
	180	-	-	-	-	61,8	67,1		0,0406
650 x	200	-	-	-	-	63,5	68,9	0,0522	BELIMO BEN (15 N.m)
	225	-	-	-	-	65,8	71,3	0,0667	
	250	-	-	-	-	68,0	73,6	0,0812	
	280	-	-	-	-	70,6	76,4	0,0986	
	300	-	-	-	-	72,4	78,3	0,1102	
	315	-	-	-	-	73,8	79,8	0,1189	
	355	-	6,5	-	-	77,3	83,5	0,1421	
	400	-	29	-	-	81,3	87,6	0,1682	
	450	-	54	-	4	85,6	92,4	0,1972	
	500	-	79	-	29	90,1	97,0	0,2262	
700 x	550	-	104	-	54	94,5	101,8	0,2552	BELIMO BEE (25 N.m)
	560	-	109	-	59	95,4	102,6	0,2610	
	600	-	129	-	79	98,9	106,4	0,2842	
	630	-	144	-	94	101,6	109,3	0,3016	
	650	-	154	-	104	103,4	111,1	0,3132	
	700	11	179	-	129	107,8	115,8	0,3422	
	710	16	184	-	134	108,6	116,8	0,3480	
	750	36	204	-	154	112,3	120,5	0,3712	
	800	61	229	11	179	117,9	126,4	0,4002	
	900	111	279	61	229	126,8	135,8	0,4582	
1000	161	329	111	279	135,6	145,1	0,5162	BELIMO BE (40 N.m)	
700 x	180	-	-	-	-	64,5	66,2	0,0441	BELIMO BEN (15 N.m)
	200	-	-	-	-	66,4	68,0	0,0567	
	225	-	-	-	-	68,8	70,3	0,0725	
	250	-	-	-	-	71,0	72,6	0,0882	
	280	-	-	-	-	73,8	75,4	0,1071	
	300	-	-	-	-	75,6	77,2	0,1197	

A x B [mm]	Damper blade overlaps without flanges		Damper blade overlaps with flanges		Weight [kg]		Effective area Sef [m <sup>2</sup> ]	Actuating mechanism type
	a [mm]	c [mm]	e [mm]	f [mm]	Without flanges	With flanges		
700 x	315	-	-	-	77,0	78,6	0,1292	BELIMO BEN (15 N.m)
	355	-	6,5	-	80,6	82,2	0,1544	
	400	-	29	-	84,8	86,4	0,1827	
	450	-	54	-	89,4	90,9	0,2142	
	500	-	79	-	93,9	95,5	0,2457	
	550	-	104	-	98,5	100,1	0,2772	
	560	-	109	-	99,4	101,0	0,2835	
	600	-	129	-	103,1	104,7	0,3087	
	630	-	144	-	105,9	107,4	0,3276	BELIMO BEE (25 N.m)
	650	-	154	-	107,6	109,2	0,3402	
	700	11	179	-	112,3	113,8	0,3717	
	710	16	184	-	113,1	114,7	0,3780	
	750	36	204	-	116,9	118,4	0,4032	
	800	61	229	11	122,8	124,1	0,4347	
	900	111	279	61	131,9	133,2	0,4977	
	1000	161	329	111	141,0	142,4	0,5607	
710 x	180	-	-	-	63,6	69,1	0,0448	BELIMO BEN (15 N.m)
	200	-	-	-	65,4	70,9	0,0576	
	225	-	-	-	67,6	73,3	0,0736	
	250	-	-	-	69,9	75,8	0,0896	
	280	-	-	-	72,6	78,6	0,1088	
	300	-	-	-	74,4	80,5	0,1216	
	315	-	-	-	75,8	81,9	0,1312	
	355	-	6,5	-	79,3	85,6	0,1568	
	400	-	29	-	83,4	90,0	0,1856	
	450	-	54	-	87,8	94,8	0,2176	
	500	-	79	-	92,4	99,6	0,2496	
	550	-	104	-	96,9	104,3	0,2816	
	560	-	109	-	97,8	105,2	0,2880	
	600	-	129	-	101,4	109,1	0,3136	
	630	-	144	-	102,4	111,9	0,3328	
	650	-	154	-	104,2	113,8	0,3456	
700	11	179	-	108,6	118,6	0,3776		
710	16	184	-	109,6	119,6	0,3840		
750	36	204	-	113,0	123,3	0,4096		
800	61	229	11	118,7	129,3	0,4416		
900	111	279	61	127,6	138,8	0,5056		
1000	161	329	111	136,4	148,4	0,5696		
750 x	180	-	-	-	64,7	70,2	0,0476	BELIMO BEN (15 N.m)
	200	-	-	-	66,5	72,1	0,0612	
	225	-	-	-	68,8	74,6	0,0782	
	250	-	-	-	71,0	77,0	0,0952	
	280	-	-	-	73,8	79,9	0,1156	
	300	-	-	-	75,6	81,8	0,1292	
	315	-	-	-	76,9	83,3	0,1394	
	355	-	6,5	-	80,6	87,1	0,1666	
	400	-	29	-	84,7	91,4	0,1972	
	450	-	54	-	89,3	96,2	0,2312	
	500	-	79	-	93,8	101,0	0,2652	
	550	-	104	-	98,4	105,8	0,2992	
560	-	109	-	99,4	106,8	0,3060		

A x B [mm]	Damper blade overlaps without flanges		Damper blade overlaps with flanges		Weight [kg]		Effective area Sef [m <sup>2</sup> ]	Actuating mechanism type	
	a [mm]	c [mm]	e [mm]	f [mm]	Without flanges	With flanges			
750 x	600	-	129	-	79	103,0	110,6	0,3332	BELIMO BEN (15 N.m)
	630	-	144	-	94	105,7	113,5	0,3536	
	650	-	154	-	104	107,5	115,4	0,3672	
	700	11	179	-	129	112,1	120,2	0,4012	BELIMO BEE (25 N.m)
	710	16	184	-	134	113,0	121,2	0,4080	
	750	36	204	-	154	117,8	126,2	0,4352	
	800	61	229	11	179	122,4	131,0	0,4692	BELIMO BE (40 N.m)
	900	111	279	61	229	131,5	140,8	0,5372	
	1000	161	329	111	279	143,0	152,9	0,6052	
800 x	180	-	-	-	-	68,4	74,4	0,0511	BELIMO BEN (15 N.m)
	200	-	-	-	-	70,4	76,4	0,0657	
	225	-	-	-	-	72,8	78,9	0,0840	
	250	-	-	-	-	75,2	81,5	0,1022	
	280	-	-	-	-	78,1	84,5	0,1241	
	300	-	-	-	-	79,9	86,5	0,1387	
	315	-	-	-	-	81,4	88,1	0,1497	
	355	-	6,5	-	-	85,3	92,1	0,1789	
	400	-	29	-	-	89,5	96,6	0,2117	
	450	-	54	-	4	94,3	101,6	0,2482	
	500	-	79	-	29	99,2	106,8	0,2847	
	550	-	104	-	54	103,9	111,8	0,3212	
	560	-	109	-	59	104,9	112,7	0,3285	
	600	-	129	-	79	108,7	116,8	0,3577	
	630	-	144	-	94	111,6	119,8	0,3796	
	650	-	154	-	104	113,6	121,9	0,3942	
	700	11	179	-	129	118,3	126,9	0,4307	
	710	16	184	-	134	119,3	127,9	0,4380	
750	36	204	-	154	124,3	133,2	0,4672		
800	61	229	11	179	129,2	138,2	0,5037	BELIMO BE (40 N.m)	
900	111	279	61	229	138,7	148,4	0,5767		
1000	161	329	111	279	148,4	158,5	0,6497		
900 x	180	-	-	-	-	72,7	72,5	0,0581	BELIMO BEN (15 N.m)
	200	-	-	-	-	74,8	81,1	0,0747	
	225	-	-	-	-	77,3	83,8	0,0955	
	250	-	-	-	-	79,8	86,4	0,1162	
	280	-	-	-	-	82,8	89,6	0,1411	
	300	-	-	-	-	84,7	91,7	0,1577	
	315	-	-	-	-	86,3	93,4	0,1702	
	355	-	6,5	-	-	90,2	97,6	0,2034	
	400	-	29	-	-	94,8	102,2	0,2407	
	450	-	54	-	4	99,8	107,5	0,2822	
	500	-	79	-	29	104,9	112,8	0,3237	
	550	-	104	-	54	109,9	118,1	0,3652	
	560	-	109	-	59	110,9	119,2	0,3735	
	600	-	129	-	79	115,0	123,4	0,4067	
	630	-	144	-	94	118,0	126,6	0,4316	
	650	-	154	-	104	120,0	128,6	0,4482	
	700	11	179	-	129	126,2	135,1	0,4897	
	710	16	184	-	134	127,2	136,2	0,4980	
750	36	204	-	154	131,3	140,4	0,5312		
800	61	229	11	179	136,3	145,7	0,5727	BELIMO BE (40 N.m)	

A x B [mm]	Damper blade overlaps without flanges		Damper blade overlaps with flanges		Weight [kg]		Effective area Sef [m <sup>2</sup> ]	Actuating mechanism type	
	a [mm]	c [mm]	e [mm]	f [mm]	Without flanges	With flanges			
900 x	900	111	279	61	229	146,3	156,2	0,6557	BELIMO BE (40 N.m)
	1000	161	329	111	279	156,4	166,8	0,7387	
	180	-	-	-	-	78,1	83,5	0,0651	
	200	-	-	-	-	80,2	85,7	0,0837	
	225	-	-	-	-	82,9	88,5	0,1070	
	250	-	-	-	-	85,6	91,2	0,1302	
	280	-	-	-	-	88,8	94,5	0,1581	
	300	-	-	-	-	90,8	96,8	0,1767	
	315	-	-	-	-	92,5	98,4	0,1907	
	355	-	6,5	-	-	96,7	102,8	0,2279	
1000 x	400	-	29	-	-	101,5	107,7	0,2697	BELIMO BEN (15 N.m)
	450	-	54	-	4	106,9	113,2	0,3162	
	500	-	79	-	29	112,2	118,7	0,3627	
	550	-	104	-	54	117,6	124,1	0,4092	
	560	-	109	-	59	118,7	125,3	0,4185	
	600	-	129	-	79	122,9	129,7	0,4557	
	630	-	144	-	94	126,1	133,0	0,4836	
	650	-	154	-	104	129,5	136,4	0,5022	
	700	11	179	-	129	134,8	141,8	0,5487	
	710	16	184	-	134	135,8	143,0	0,5580	
1100 x	750	36	204	-	154	140,2	147,4	0,5952	BELIMO BEE (25 N.m)
	800	61	229	11	179	145,4	152,8	0,6417	
	900	111	279	61	229	156,1	163,9	0,7347	
	1000	161	329	111	279	166,8	174,9	0,8277	
	180	-	-	-	-	83,4	87,1	0,0721	
	200	-	-	-	-	85,7	89,2	0,0927	
	225	-	-	-	-	88,6	92,1	0,1185	
	250	-	-	-	-	91,3	95,0	0,1442	
	280	-	-	-	-	94,7	98,3	0,1751	
	300	-	-	-	-	97,0	100,6	0,1957	
1250 x	315	-	-	-	-	98,6	102,2	0,2112	BELIMO BEN (15 N.m)
	355	-	6,5	-	-	103,2	106,8	0,2524	
	400	-	29	-	-	108,2	111,9	0,2987	
	450	-	54	-	4	114,0	117,5	0,3502	
	500	-	79	-	29	119,6	123,2	0,4017	
	550	-	104	-	54	125,3	128,9	0,4532	
	560	-	109	-	59	126,4	130,0	0,4635	
	600	-	129	-	79	130,9	134,6	0,5047	
	630	-	144	-	94	135,5	139,0	0,5356	
	650	-	154	-	104	137,8	141,3	0,5562	
1300 x	700	11	179	-	129	143,4	147,0	0,6077	BELIMO BE (40 N.m)
	710	16	184	-	134	144,6	148,1	0,6180	
	750	36	204	-	154	149,0	152,6	0,6592	
	800	61	229	11	179	154,7	158,4	0,7107	
	900	111	279	61	229	166,1	169,6	0,8137	
	1000	161	329	111	279	177,4	180,9	0,9167	
	180	-	-	-	-	91,4	97,9	0,0826	
	200	-	-	-	-	94,0	100,4	0,1062	
	225	-	-	-	-	97,0	103,6	0,1357	
	250	-	-	-	-	100,1	106,7	0,1652	
280	-	-	-	-	103,7	110,4	0,2006		

A x B [mm]	Damper blade overlaps without flanges		Damper blade overlaps with flanges		Weight [kg]		Effective area Sef [m <sup>2</sup> ]	Actuating mechanism type
	a [mm]	c [mm]	e [mm]	f [mm]	Without flanges	With flanges		
1250 x	300	-	-	-	106,2	113,0	0,2242	BELIMO BEN (15 N.m)
	315	-	-	-	108,0	114,8	0,2419	
	355	-	6,5	-	112,9	119,9	0,2891	
	400	-	29	-	118,4	125,6	0,3422	
	450	-	54	-	124,6	131,8	0,4012	BELIMO BEE (25 N.m)
	500	-	79	-	130,7	138,1	0,4602	
	550	-	104	-	136,8	144,3	0,5192	
	560	-	109	-	138,0	145,5	0,5310	
	600	-	129	-	144,1	151,7	0,5782	BELIMO BE (40 N.m)
	630	-	144	-	147,7	155,5	0,6136	
	650	-	154	-	150,2	158,0	0,6372	
	700	11	179	-	156,4	164,3	0,6962	
	710	16	184	-	157,6	165,6	0,7080	
	750	36	204	-	162,5	170,5	0,7552	
	800	61	229	11	168,6	176,8	0,8142	
	900	111	279	61	180,8	189,4	0,9322	
	1000	161	329	111	192,9	204,6	1,0502	
1400 x	180	-	-	-	95,3	104,0	0,0931	
	200	-	-	-	97,9	106,5	0,1197	
	225	-	-	-	101,1	109,8	0,1530	
	250	-	-	-	104,2	113,0	0,1862	
	280	-	-	-	108,0	117,0	0,2261	
	300	-	-	-	110,5	119,6	0,2527	
	315	-	-	-	112,5	121,6	0,2727	
	355	-	6,5	-	117,4	126,8	0,3259	BELIMO BEE (25 N.m)
	400	-	29	-	123,2	132,7	0,3857	
	450	-	54	-	129,5	139,3	0,4522	
	500	-	79	-	135,8	145,8	0,5187	
	550	-	104	-	143,3	153,5	0,5852	BELIMO BE (40 N.m)
	560	-	109	-	144,6	154,9	0,5985	
	600	-	129	-	149,6	160,1	0,6517	
	630	-	144	-	153,4	164,1	0,6916	
	650	-	154	-	155,9	166,6	0,7182	
	700	11	179	-	162,2	173,2	0,7847	
	710	16	184	-	163,4	174,6	0,7980	
	750	36	204	-	168,5	179,7	0,8512	
	800	61	229	11	174,8	186,3	0,9177	
900	111	279	61	195,3	207,2	1,0507	SCHISCHEK InMax 50.75 (75 N.m)	
1000	161	329	111	207,9	220,3	1,1837		
1500 x	180	-	-	-	100,5	109,5	0,1001	BELIMO BEN (15 N.m)
	200	-	-	-	103,2	112,2	0,1287	
	225	-	-	-	106,5	115,7	0,1645	
	250	-	-	-	109,8	119,1	0,2002	
	280	-	-	-	113,7	123,3	0,2431	
	300	-	-	-	116,4	125,9	0,2717	
	315	-	-	-	118,3	128,0	0,2932	
	355	-	6,5	-	123,6	133,5	0,3504	BELIMO BEE (25 N.m)
	400	-	29	-	129,6	139,7	0,4147	
	450	-	54	-	136,3	146,5	0,4862	
	500	-	79	-	142,8	153,4	0,5577	
550	-	104	-	150,7	161,5	0,6292		

A x B [mm]	Damper blade overlaps without flanges		Damper blade overlaps with flanges		Weight [kg]		Effective area Sef [m <sup>2</sup> ]	Actuating mechanism type		
	a [mm]	c [mm]	e [mm]	f [mm]	Without flanges	With flanges				
1500 x	560	-	109	-	59	151,9	162,7	0,6435	BELIMO BE (40 N.m)	
	600	-	129	-	79	157,2	168,2	0,7007		
	630	-	144	-	94	161,2	172,4	0,7436		
	650	-	154	-	104	163,9	175,1	0,7722		
	700	11	179	-	129	170,4	181,9	0,8437		
	710	16	184	-	134	171,8	183,3	0,8580		
	750	36	204	-	154	177,1	188,8	0,9152		
	800	61	229	11	179	183,7	195,6	0,9867		
	900	111	279	61	229	204,7	217,2	1,1297		SCHISCHEK InMax 50.75 (75 N.m)
	1000	161	329	111	279	217,9	230,9	1,2727		
1600 x	180	-	-	-	-	105,7	115,1	0,1071	BELIMO BEN (15 N.m)	
	200	-	-	-	-	108,4	118,0	0,1377		
	225	-	-	-	-	111,9	121,6	0,1760		
	250	-	-	-	-	115,3	125,1	0,2142		
	280	-	-	-	-	119,5	129,5	0,2601		
	300	-	-	-	-	122,2	132,4	0,2907		
	315	-	-	-	-	124,3	134,4	0,3137		
	355	-	6,5	-	-	129,8	140,2	0,3749		BELIMO BEE (25 N.m)
	400	-	29	-	-	136,0	146,6	0,4437		
	450	-	54	-	4	142,9	153,8	0,5202		
	500	-	79	-	29	149,8	160,9	0,5967		
	550	-	104	-	54	158,0	169,3	0,6732		
	560	-	109	-	59	159,4	170,7	0,6885		
	600	-	129	-	79	164,9	176,4	0,7497		
	630	-	144	-	94	169,1	180,7	0,7956	BELIMO BE (40 N.m)	
	650	-	154	-	104	171,8	183,5	0,8262		
	700	11	179	-	129	178,7	190,7	0,9027		
	710	16	184	-	134	180,1	192,2	0,9180		
	750	36	204	-	154	185,6	197,8	0,9792		
	800	61	229	11	179	192,5	205,0	1,0557		
900	111	279	61	229	214,1	227,1	1,2087	SCHISCHEK InMax 50.75 (75 N.m)		
1000	161	329	111	279	228,0	241,4	1,3617			


## IV. INSTALLATION

### Placement and installation


- Dampers are designed to remove heat and combustion products (e.g. smoke) from fire compartments
- Dampers are suitable for installation in vertical and horizontal position passages of fire separating constructions. The damper installation procedures must be done so that all load transfer from the fire separating constructions to the damper is absolutely excluded.
- Following air-conditioning duct must be suspended or supported so that all load transfer from the following duct to the damper flange is absolutely excluded.
- The gap between the installed damper and the fire separating construction must be perfectly filled with approved material.
- After installing the damper, the damper blades must only be opened, or closed by operation of the actuator only.
- The distance between the damper and the construction (wall, ceiling) must be 75 mm at the minimum, according to EN 1366-2. If two or more dampers are to be installed in one fire separating construction, the distance between adjacent dampers must be 200 mm at the minimum, according to EN 1366-10.
- To provide the necessary space for access to the control device, it is recommended that other objects be at least 350 mm away from the control parts of the damper.

#### Minimum distance between the dampers and the construction


- minimum distance 200 mm between dampers, according to EN 1366-10
- minimum distance 75 mm between damper and construction (wall/ceiling), according to EN 1366-10

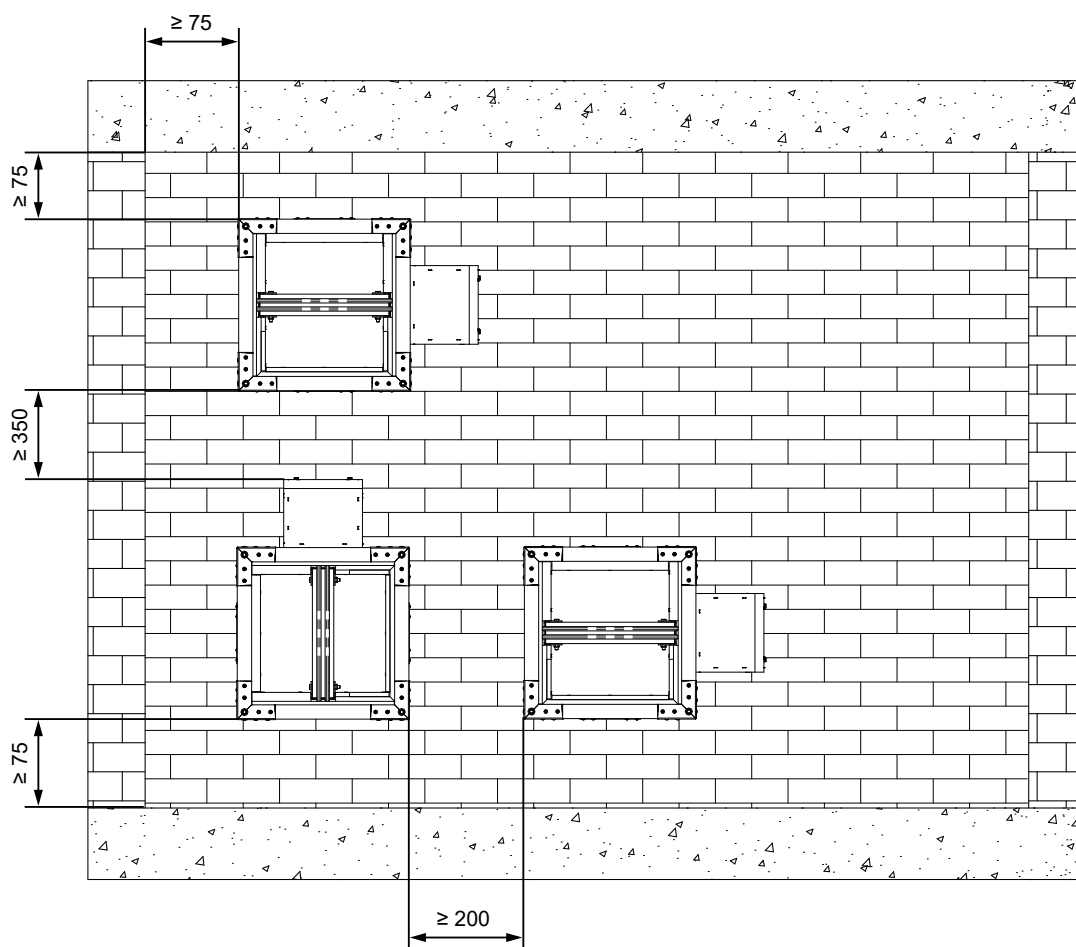

**Dimensions of an installation opening  
ABLATIVE COATED BATT**

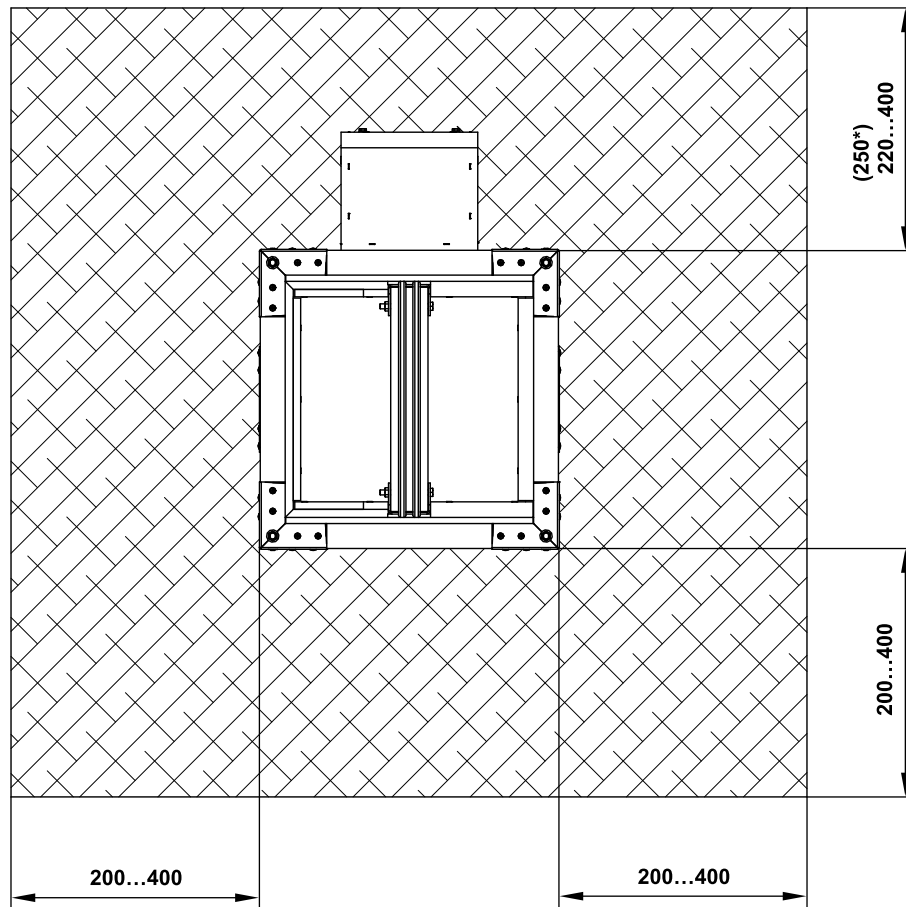

**Dimensions of an installation opening  
MORTAR OR GYPSUM / MINERAL WOOL AND BOARDS**

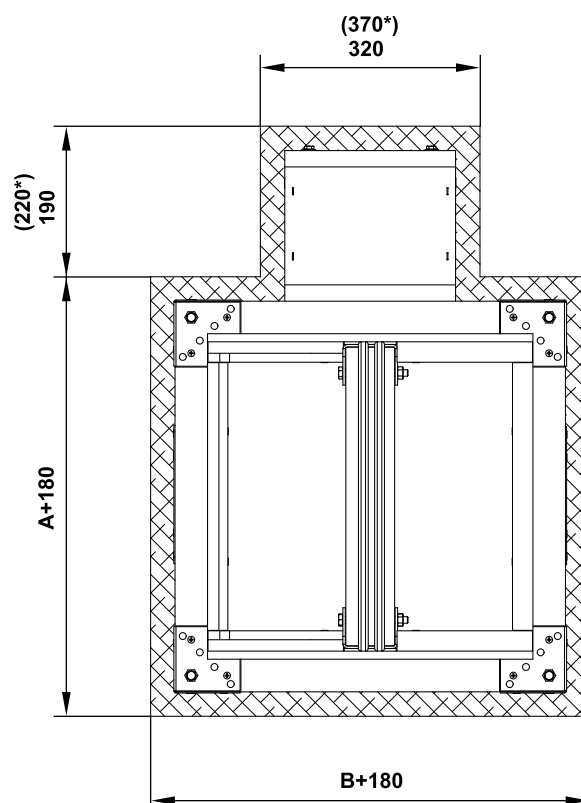

\* Dimensions with actuating mechanism InMax 50.75S.




## Statement of installations

Type of construction	Min. thickness of construction [mm]	Penetration seal	Classification	Page
In solid wall construction	100	Mortar or gypsum	EI 120 (v <sub>ew</sub> i↔o) S1500C <sub>mod</sub> HOT 400/30MAmulti	26
		Ablative Coated Batt		27
		Mineral wool and boards		28
In gypsum wall construction	100	Mortar or gypsum	EI 120 (v <sub>ew</sub> i↔o) S1500C <sub>mod</sub> HOT 400/30MAmulti	29
		Ablative Coated Batt		30
		Mineral wool and boards		31
In solid ceiling construction	150	Mortar or gypsum	EI 120 (h <sub>ow</sub> i↔o) S1500C <sub>mod</sub> HOT 400/30MAmulti	32
		Ablative Coated Batt		33
		Mineral wool and boards		34
Battery in solid wall construction	100	Mortar or gypsum	EI 120 (v <sub>ew</sub> i↔o) S1500C <sub>mod</sub> HOT 400/30MAmulti	2 dampers side by side
				2 dampers on top of each other
				3 dampers on top of each other
				4 dampers
				2 dampers side by side
				2 dampers on top of each other
				3 dampers on top of each other
				4 dampers
				2 dampers side by side
				2 dampers on top of each other
Battery in gypsum wall construction	100	Ablative Coated Batt	EI 120 (v <sub>ew</sub> i↔o) S1500C <sub>mod</sub> HOT 400/30MAmulti	37
				2 dampers on top of each other
				3 dampers on top of each other
				4 dampers
				4 dampers
Horizontal or vertical smoke extraction ducts	Connection to single or multi compartment smoke extraction ducts tested according to EN 1366-8 or EN 1366-9	EI 120 (h <sub>od</sub> -V <sub>ed</sub> i↔o) S1000C <sub>mod</sub> HOT 400/30MAmulti	47-50	

**Installation in solid wall construction**

**Solid wall - mortar or gypsum - vertical blade axis position**


- For connection of following duct → see pages 57 to 61
- Examples of anchors to the fire dividing construction → see pages 51 to 56

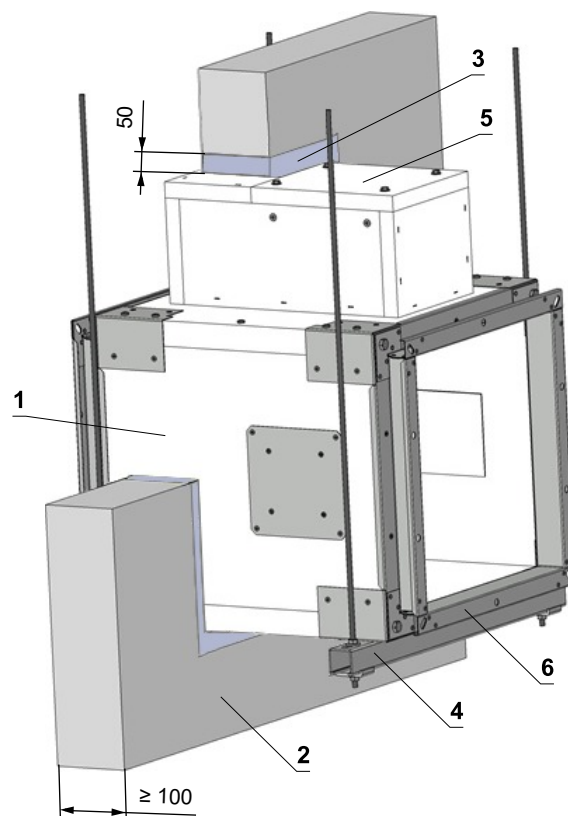

- 1 SEDM
- 2 Solid wall construction
- 3 Mortar or gypsum
- 4 Profile with threaded rod → see pages 51 to 52
- 5 Actuator cover - must be removable after installation of the damper
- 6 Flange

**Solid wall - mortar or gypsum - horizontal blade axis position**


- For connection of following duct → see pages 57 to 61
- Examples of anchors to the fire dividing construction → see pages 51 to 56

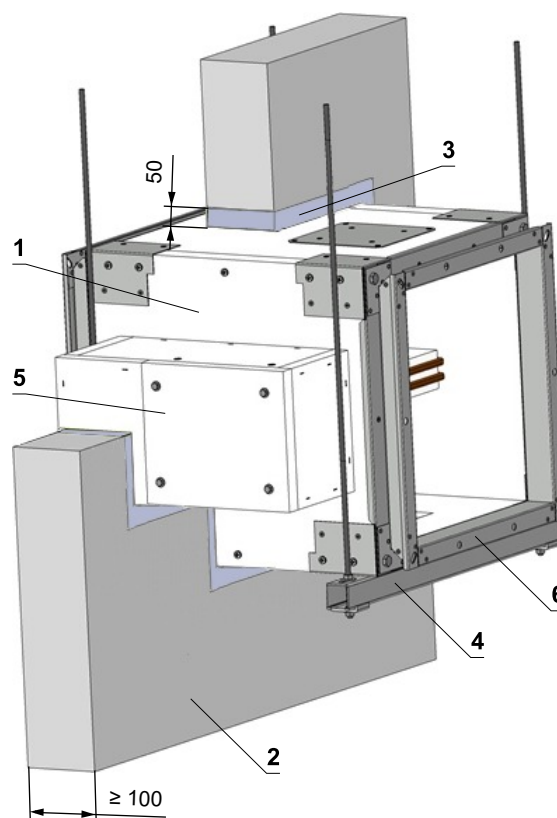

- 1 SEDM
- 2 Solid wall construction
- 3 Mortar or gypsum
- 4 Profile with threaded rod → see pages 51 to 52
- 5 Actuator cover - must be removable after installation of the damper
- 6 Flange

**Solid wall - Ablative Coated Batt - vertical blade axis position**


- For connection of following duct → see pages 57 to 61
- Examples of anchors to the fire dividing construction → see pages 51 to 56

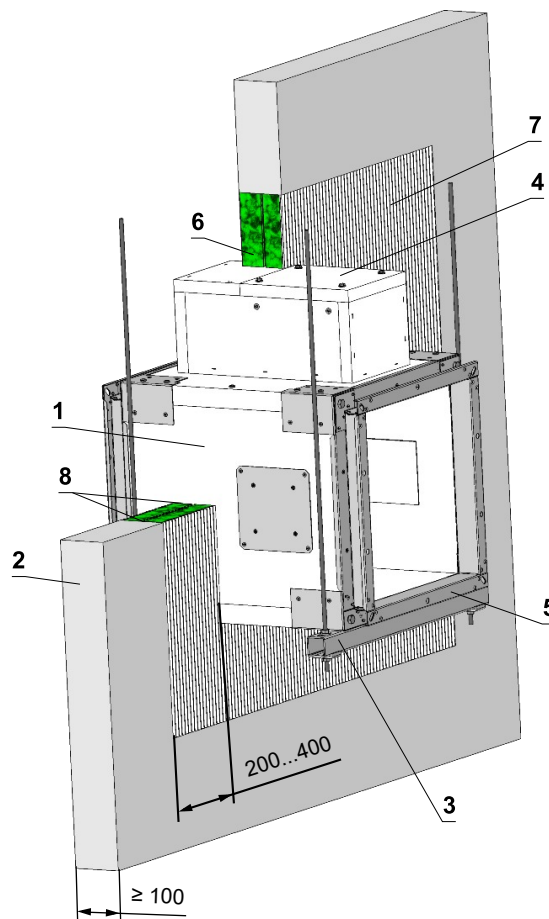

- 1 SEDM
- 2 Solid wall construction
- 3 Profile with threaded rod → see pages 51 to 52
- 4 Actuator cover - must be removable after installation of the damper
- 5 Flange
- 6 Ablative Coated Batt System HILTI
- 6 Mineral wool board - min. density 140 kg/m<sup>3</sup> (HILTI CFS-CT B 1S 140/50...)
- 7 Fire stop coating - th. 1 mm (HILTI CFS-CT...) - coating is overcoated on the support construction and on the damper casing/duct.
- 8 Fire-resistant mastic - (HILTI CFS-S ACR...) fill the gap from both sides of the fire separation construction and around the perimeter of penetration and damper casing.

**Solid wall - Ablative Coated Batt - horizontal blade axis position**


- For connection of following duct → see pages 57 to 61
- Examples of anchors to the fire dividing construction → see pages 51 to 56

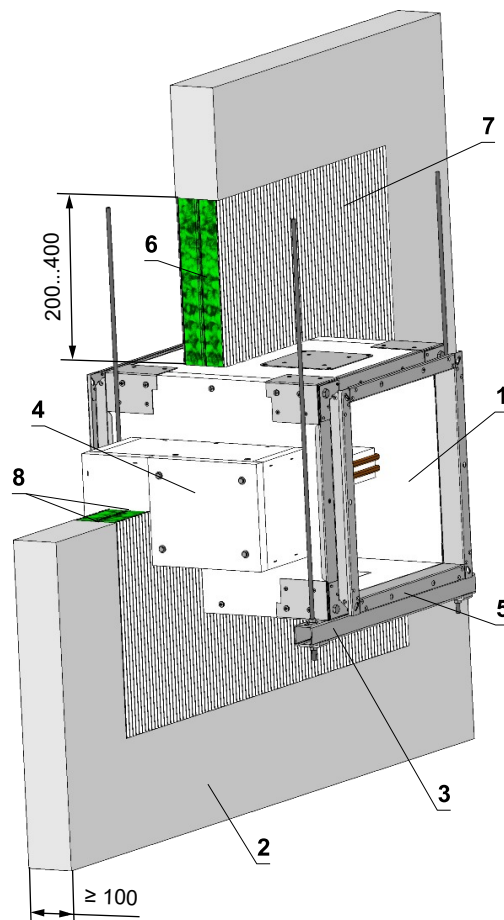

- 1 SEDM
- 2 Solid wall construction
- 3 Profile with threaded rod → see pages 51 to 52
- 4 Actuator cover - must be removable after installation of the damper
- 5 Flange
- 6 Ablative Coated Batt System HILTI
- 6 Mineral wool board - min. density 140 kg/m<sup>3</sup> (HILTI CFS-CT B 1S 140/50...)
- 7 Fire stop coating - th. 1 mm (HILTI CFS-CT...) - coating is overcoated on the support construction and on the damper casing/duct.
- 8 Fire-resistant mastic - (HILTI CFS-S ACR...) fill the gap from both sides of the fire separation construction and around the perimeter of penetration and damper casing.

**Solid wall - mineral wool and boards - vertical blade axis position**


- For connection of following duct → see pages 57 to 61
- Examples of anchors to the fire dividing construction → see pages 51 to 56

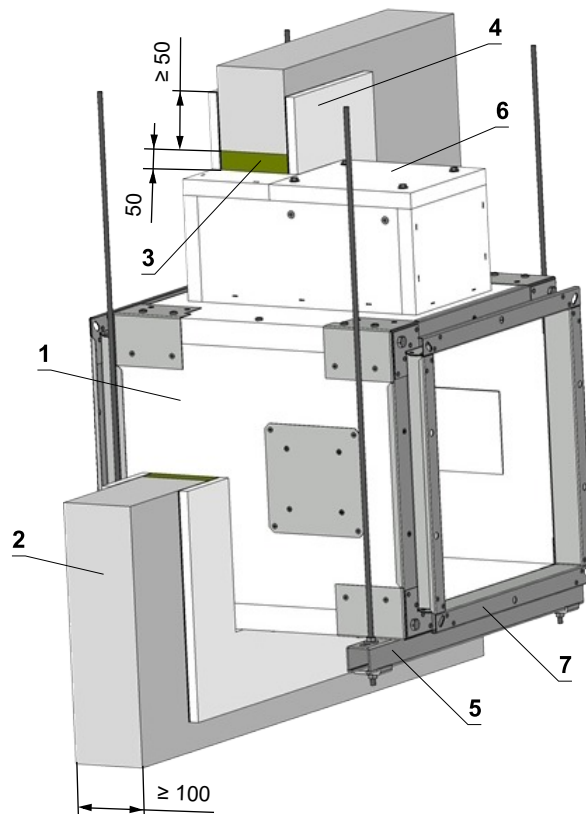

- 1 SEDM
- 2 Solid wall construction
- 3 Mineral wool board - min. density 140 kg/m<sup>3</sup> (e.g. PROMAPYR-T150, ROCKWOOL HARDROCK / STEPROCK HD)
- 4 Fire-resistant board - min. th. 15 mm, min. density 870 kg/m<sup>3</sup> (e.g. PROMATECT-H)
- 5 Profile with threaded rod → see pages 51 to 52
- 6 Actuator cover - must be removable after installation of the damper
- 7 Flange

**Solid wall - mineral wool and boards - horizontal blade axis position**

- For connection of following duct → see pages 57 to 61
- Examples of anchors to the fire dividing construction → see pages 51 to 56

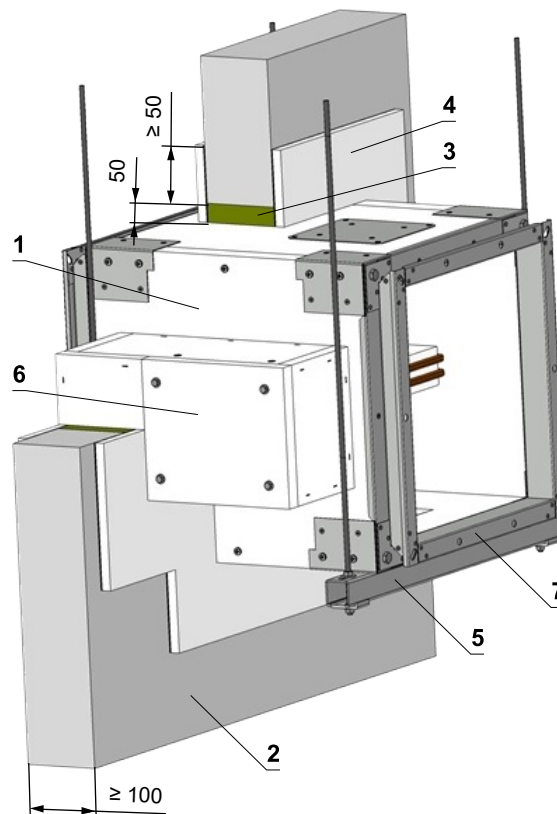


- 1 SEDM
- 2 Solid wall construction
- 3 Mineral wool board - min. density 140 kg/m<sup>3</sup> (e.g. PROMAPYR-T150, ROCKWOOL HARDROCK / STEPROCK HD)
- 4 Fire-resistant board - min. th. 15 mm, min. density 870 kg/m<sup>3</sup> (e.g. PROMATECT-H)
- 5 Profile with threaded rod → see pages 51 to 52
- 6 Actuator cover - must be removable after installation of the damper
- 7 Flange

## Installation in gypsum wall construction

### Gypsum wall - mortar or gypsum


- For connection of following duct → see pages 57 to 61
- Examples of anchors to the fire dividing construction → see pages 51 to 56

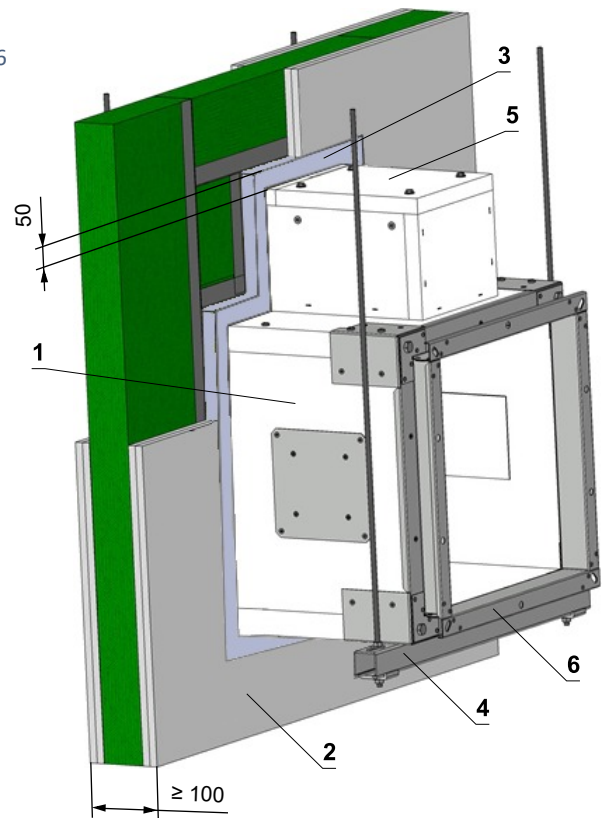

- 1 SEDM
- 2 Gypsum wall construction
- 3 Mortar or gypsum
- 4 Profile with threaded rod → see pages 51 to 52
- 5 Actuator cover - must be removable after installation of the damper
- 6 Flange

**Gypsum wall - Ablative Coated Batt - vertical blade axis position**


- For connection of following duct → see pages 57 to 61
- Examples of anchors to the fire dividing construction → see pages 51 to 56

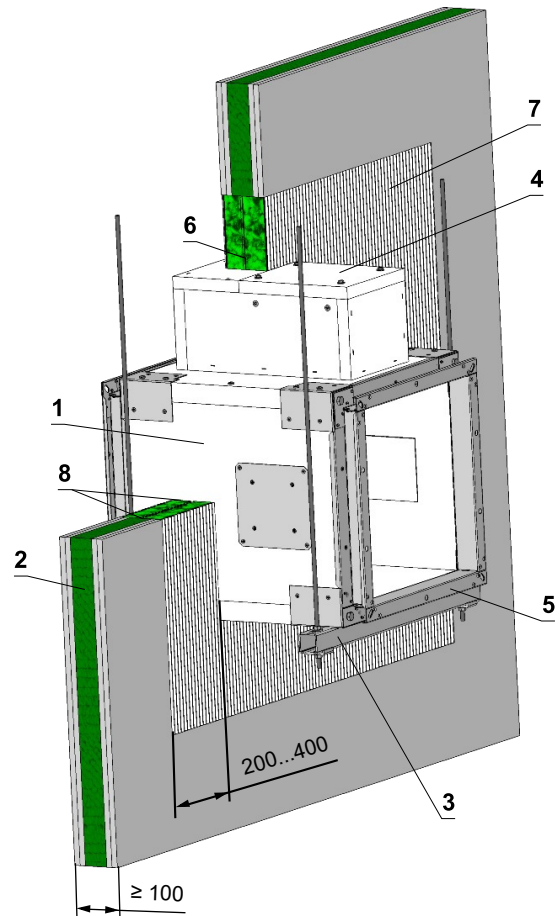

- 1 SEDM
- 2 Gypsum wall construction
- 3 Profile with threaded rod → see pages 51 to 52
- 4 Actuator cover - must be removable after installation of the damper
- 5 Flange  
Ablative Coated Batt System HILTI
- 6 Mineral wool board - min. density 140 kg/m<sup>3</sup> (HILTI CFS-CT B 1S 140/50...)
- 7 Fire stop coating - th. 1 mm (HILTI CFS-CT...) - coating is overcoated on the support construction and on the damper casing/duct.
- 8 Fire-resistant mastic - (HILTI CFS-S ACR...) fill the gap from both sides of the fire separation construction and around the perimeter of penetration and damper casing.

**Gypsum wall - Ablative Coated Batt - horizontal blade axis position**


- For connection of following duct → see pages 57 to 61
- Examples of anchors to the fire dividing construction → see pages 51 to 56

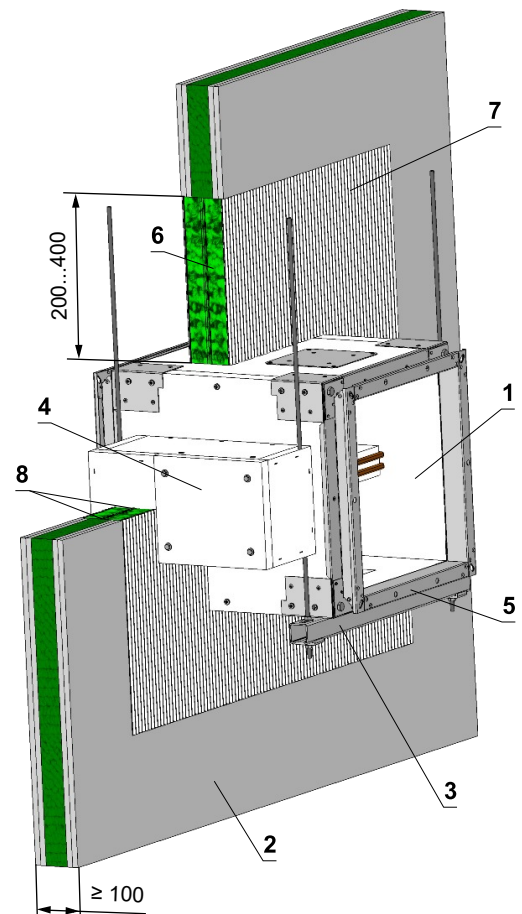

- 1 SEDM
- 2 Gypsum wall construction
- 3 Profile with threaded rod → see pages 51 to 52
- 4 Actuator cover - must be removable after installation of the damper
- 5 Flange  
Ablative Coated Batt System HILTI
- 6 Mineral wool board - min. density 140 kg/m<sup>3</sup> (HILTI CFS-CT B 1S 140/50...)
- 7 Fire stop coating - th. 1 mm (HILTI CFS-CT...) - coating is overcoated on the support construction and on the damper casing/duct.
- 8 Fire-resistant mastic - (HILTI CFS-S ACR...) fill the gap from both sides of the fire separation construction and around the perimeter of penetration and damper casing.

**Gypsum wall - mineral wool and boards**

- For connection of following duct → see pages 57 to 61
- Examples of anchors to the fire dividing construction → see pages 51 to 56

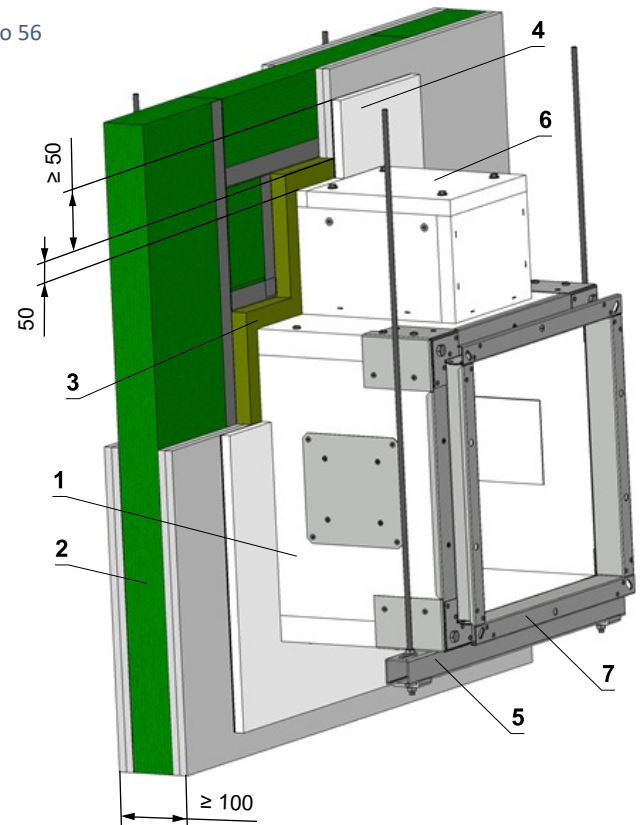


- 1 SEDM
- 2 Gypsum wall construction
- 3 Mineral wool board - min. density  $140 \text{ kg/m}^3$  (e.g. PROMAPYR-T150, ROCKWOOL HARDROCK / STEPROCK HD)
- 4 Fire-resistant board - min. th. 15 mm, min. density  $870 \text{ kg/m}^3$  (e.g. PROMATECT-H)
- 5 Profile with threaded rod → see pages 51 to 52
- 6 Actuator cover - must be removable after installation of the damper
- 7 Flange

## Installation in solid ceiling construction

### In solid ceiling construction - mortar or gypsum - actuator under ceiling


- For connection of following duct → see pages 57 to 61
- Examples of anchors to the fire dividing construction → see pages 51 to 56
- Number of L-holders and their placement, acc. to AxB dimension → see page 53

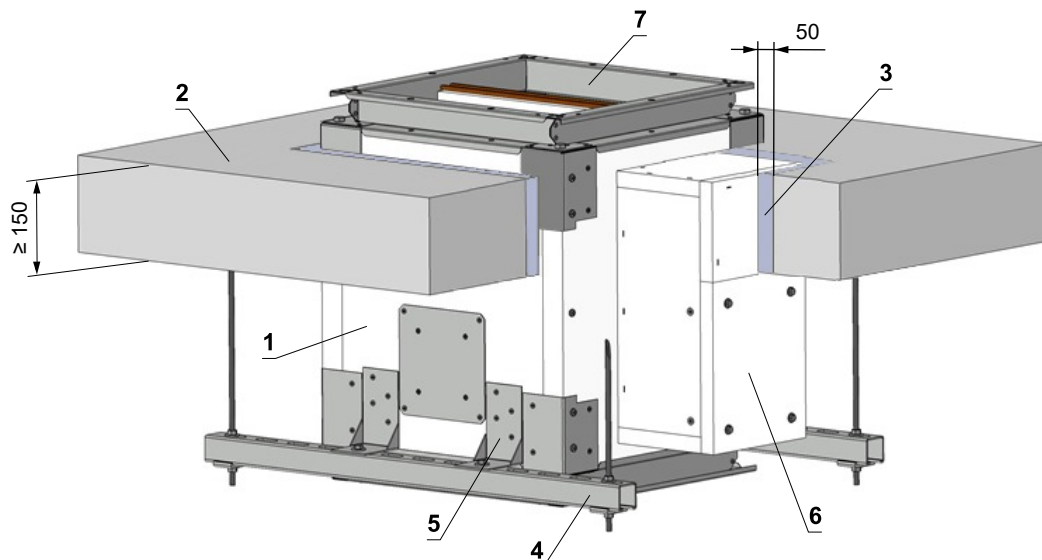

- 1 SEDM
- 2 Solid ceiling construction
- 3 Mortar or gypsum
- 4 Profile with threaded rod → see pages 51 to 52
- 5 L-holder → see page 53
- 6 Actuator cover - must be removable after installation of the damper
- 7 Flange

### In solid ceiling construction - mortar or gypsum - actuator above ceiling

- For connection of following duct → see pages 57 to 61
- Examples of anchors to the fire dividing construction → see pages 51 to 56
- Number of L-holders and their placement, acc. to AxB dimension → see page 53

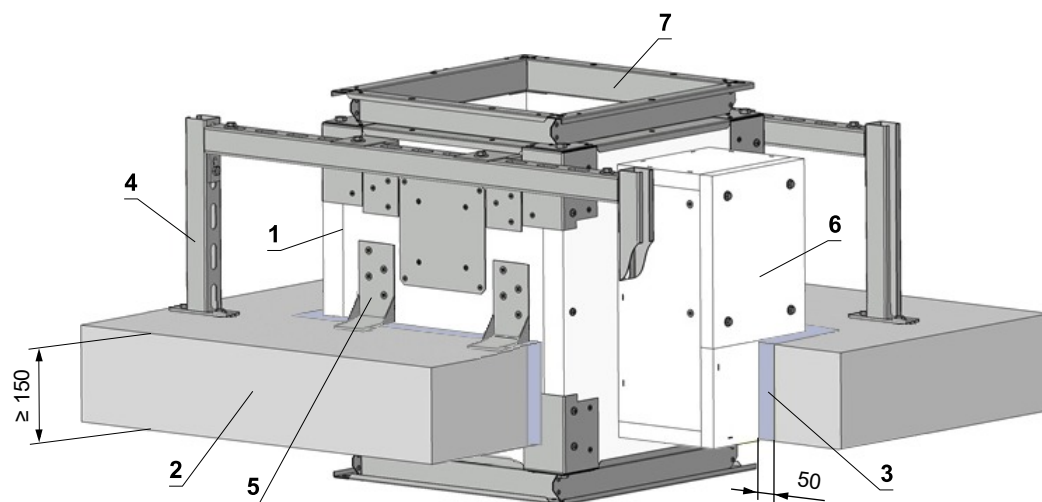


- 1 SEDM
- 2 Solid ceiling construction
- 3 Mortar or gypsum
- 4 Fixing profile with support console
- 5 L-holder → see page 53
- 6 Actuator cover - must be removable after installation of the damper
- 7 Flange



### In solid ceiling construction - Ablative Coated Batt - actuator under ceiling


- For connection of following duct → see pages 57 to 61
- Examples of anchors to the fire dividing construction → see pages 51 to 56
- Number of L-holders and their placement, acc. to AxB dimension → see page 53

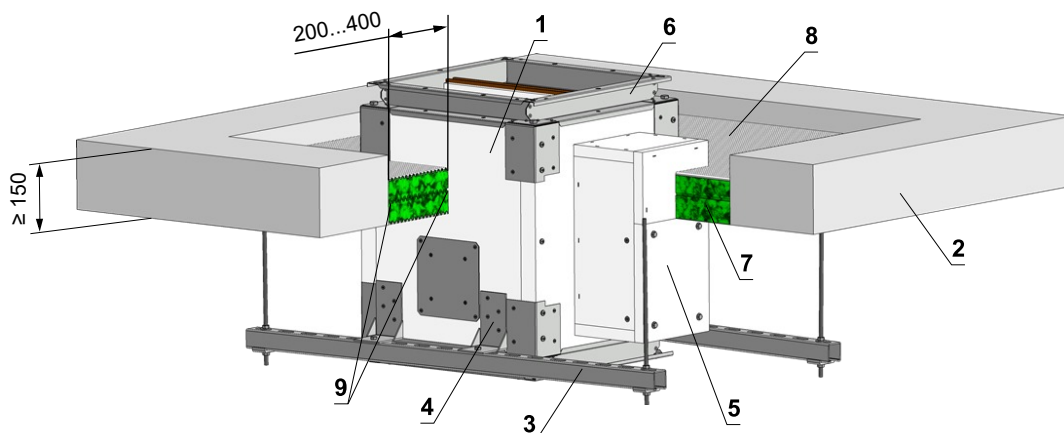

- 1 SEDM
- 2 Solid ceiling construction
- 3 Profile with threaded rod → see pages 51 to 52
- 4 L-holder → see page 53
- 5 Actuator cover - must be removable after installation of the damper
- 6 Flange  
Ablative Coated Batt System HILTI
- 7 Mineral wool board - min. density 140 kg/m<sup>3</sup> (HILTI CFS-CT B 1S 140/50...)
- 8 Fire stop coating - th. 1 mm (HILTI CFS-CT...) - coating is overcoated on the support construction and on the damper casing/duct.
- 9 Fire-resistant mastic - (HILTI CFS-S ACR...) fill the gap from both sides of the fire separation construction and around the perimeter of penetration and damper casing.

### In solid ceiling construction - Ablative Coated Batt - actuator above ceiling


- For connection of following duct → see pages 57 to 61
- Examples of anchors to the fire dividing construction → see pages 51 to 56
- Number of L-holders and their placement, acc. to AxB dimension → see page 53

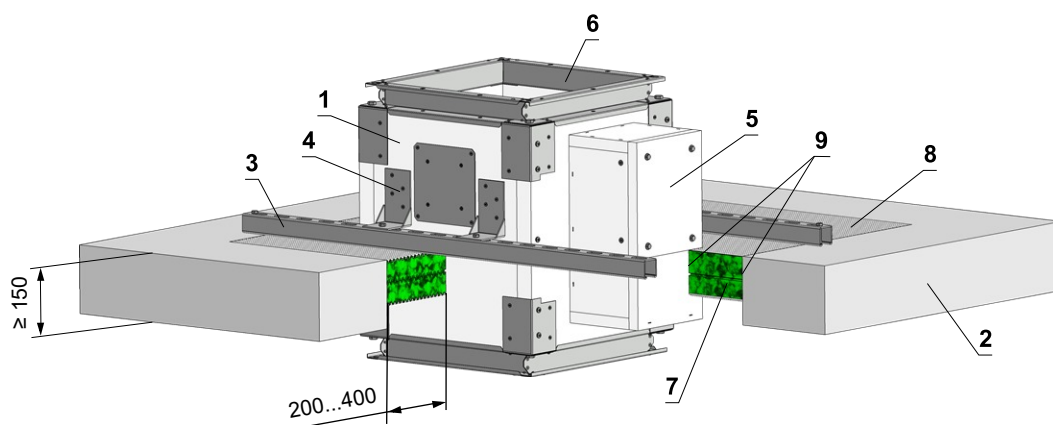

- 1 SEDM
- 2 Solid ceiling construction
- 3 Fixing profile
- 4 L-holder → see page 53
- 5 Actuator cover - must be removable after installation of the damper
- 6 Flange  
Ablative Coated Batt System HILTI
- 7 Mineral wool board - min. density 140 kg/m<sup>3</sup> (HILTI CFS-CT B 1S 140/50...)
- 8 Fire stop coating - th. 1 mm (HILTI CFS-CT...) - coating is overcoated on the support construction and on the damper casing/duct.
- 9 Fire-resistant mastic - (HILTI CFS-S ACR...) fill the gap from both sides of the fire separation construction and around the perimeter of penetration and damper casing.

**In solid ceiling construction - mineral wool and boards - actuator under ceiling**


- For connection of following duct → see pages 57 to 61
- Examples of anchors to the fire dividing construction → see pages 51 to 56
- Number of L-holders and their placement, acc. to AxB dimension → see page 53

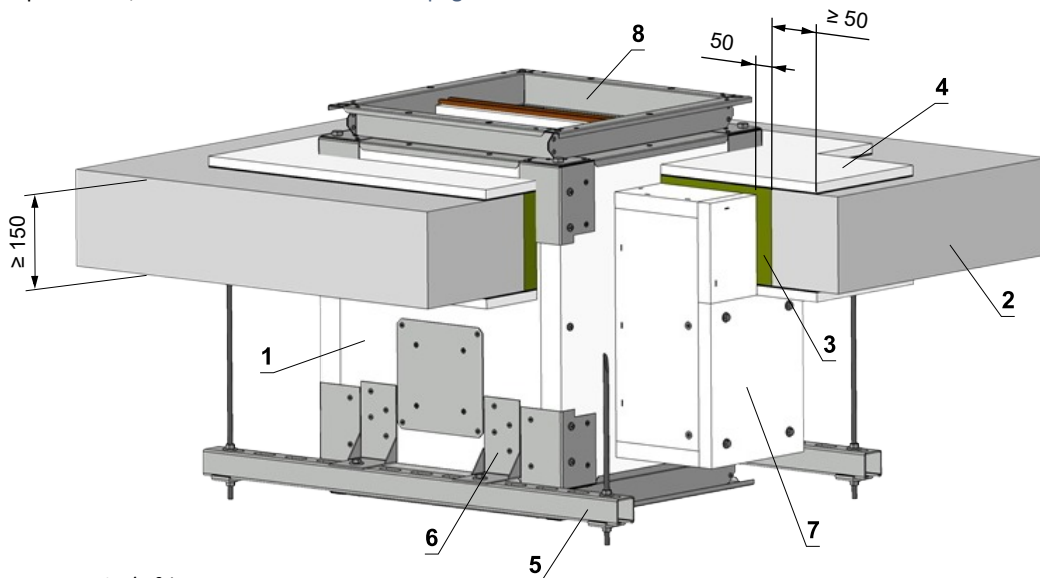

- 1 SEDM
- 2 Solid ceiling construction
- 3 Mineral wool board - min. density 140 kg/m<sup>3</sup> (e.g. PROMAPYR-T150, ROCKWOOL HARDROCK / STEP ROCK HD)
- 4 Fire-resistant board - min. th. 15 mm, min. density 870 kg/m<sup>3</sup> (e.g. PROMATECT-H)
- 5 Profile with threaded rod → see pages 51 to 52
- 6 L-holder → see page 53
- 7 Actuator cover - must be removable after installation of the damper
- 8 Flange

**In solid ceiling construction - mineral wool and boards - actuator above ceiling**


- For connection of following duct → see pages 57 to 61
- Examples of anchors to the fire dividing construction → see pages 51 to 56
- Number of L-holders and their placement, acc. to AxB dimension → see page 53

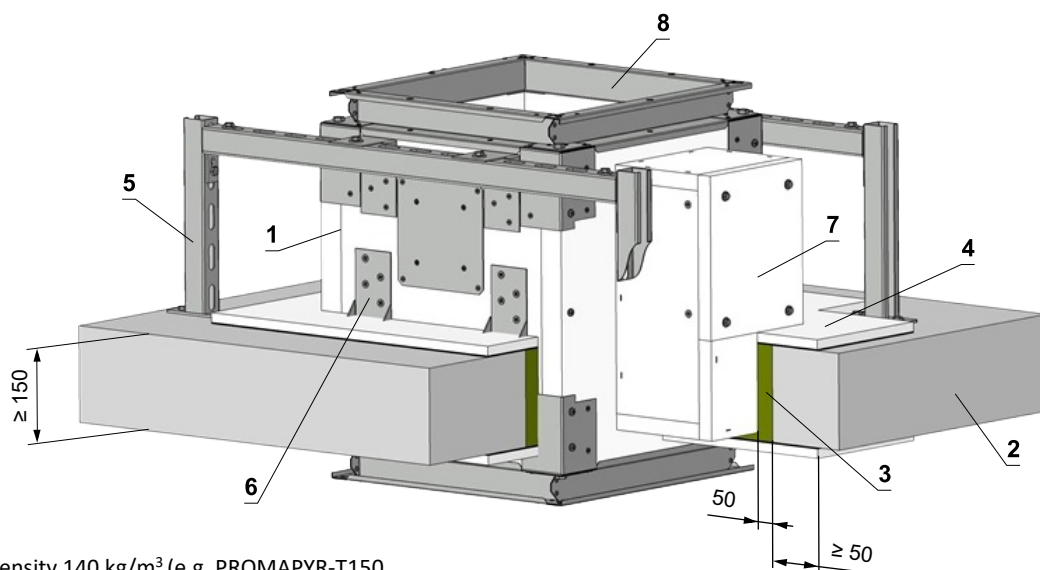

- 1 SEDM
- 2 Solid ceiling construction
- 3 Mineral wool board - min. density 140 kg/m<sup>3</sup> (e.g. PROMAPYR-T150, ROCKWOOL HARDROCK / STEP ROCK HD)
- 4 Fire-resistant board - min. th. 15 mm, min. density 870 kg/m<sup>3</sup> (e.g. PROMATECT-H)
- 5 Fixing profile with support console
- 6 L-holder → see page 53
- 7 Actuator cover - must be removable after installation of the damper
- 8 Flange


**Installation in battery**

**2 dampers side by side - solid wall - mortar or gypsum**

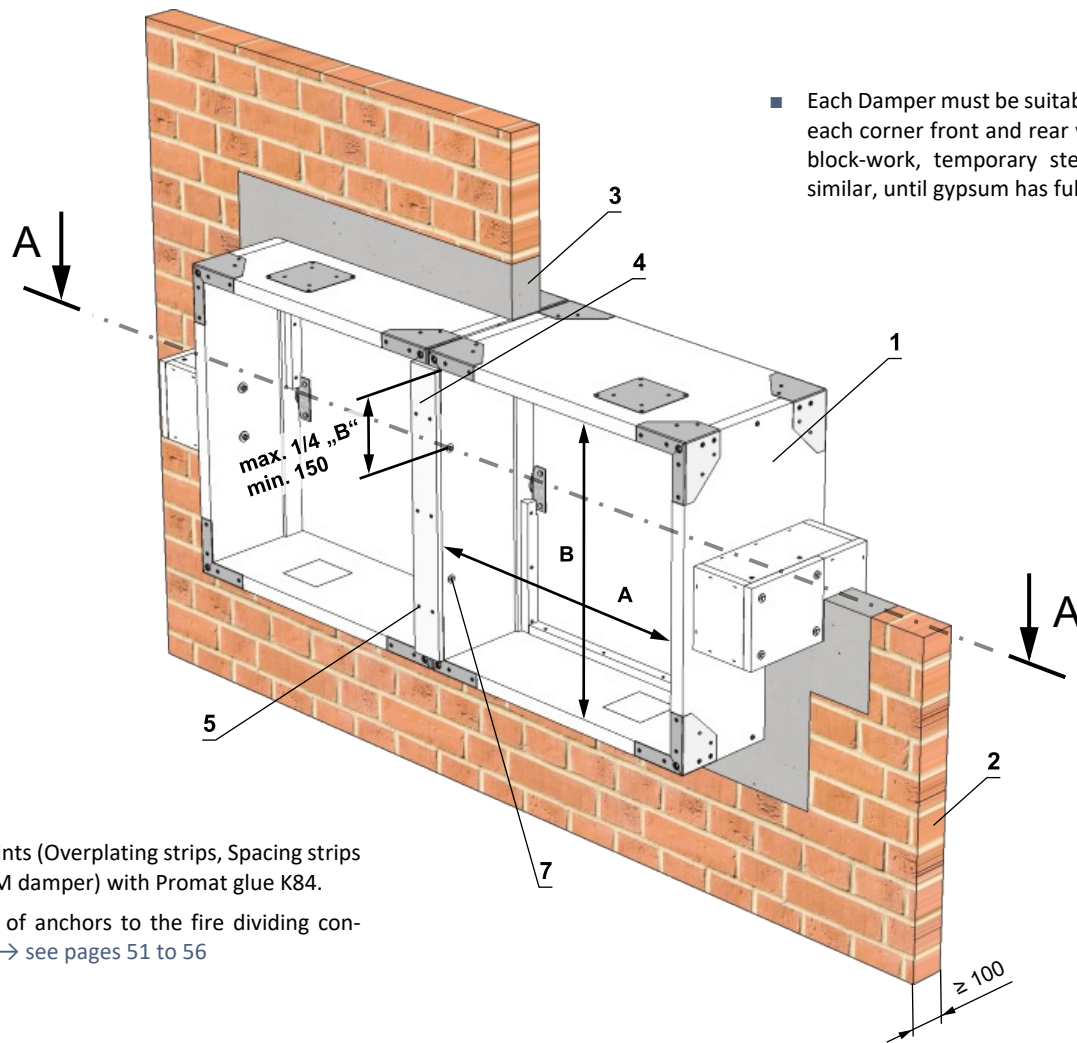


■ Each Damper must be suitably supported in each corner front and rear with temporary block-work, temporary steel supports or similar, until gypsum has fully hardened.

- Seal all joints (Overplating strips, Spacing strips with SEDM damper) with Promat glue K84.
- Examples of anchors to the fire dividing construction → see pages 51 to 56

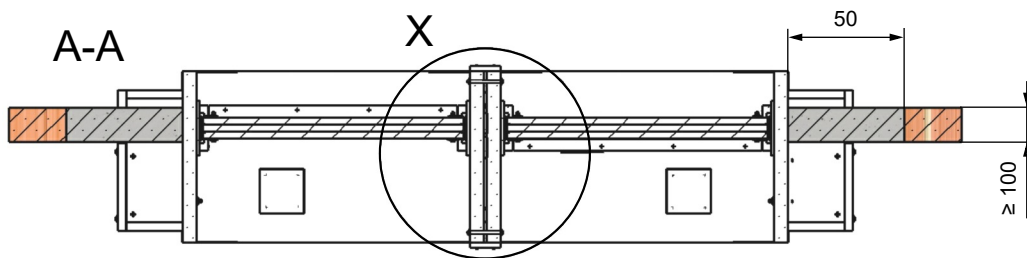


- \* **RESPECT JOINT POSITION !**  
Bolts and nuts shall not prevent free rotation on the blades.
- \*\* When installing a flange, overplating strip is not installed.

- 1 SEDM
- 2 Solid wall construction
- 3 Mortar or gypsum
- 4 Overplating strip (e.g. Promatect-H, th. 15 mm)\*\*
- 5 Screw UNI 4x40 mm (span 200-250 mm)
- 6 Spacing strip (e.g. Promatect-H, th. 10 mm, width 40-50 mm)
- 7 M8 bolt assembly on damper side „B“ (bolt M8x105 mm, 2x large washer M8, nut M8), distance from edge see fig. \*

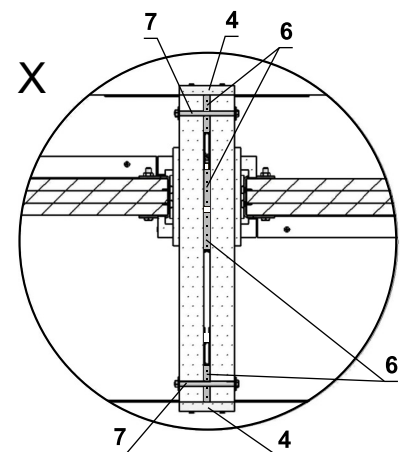


**Connecting straps, spacer straps, screws, screw connections and Promat glue K84 are not included in the delivery !**

2 dampers side by side - solid wall - Ablative Coated Batt

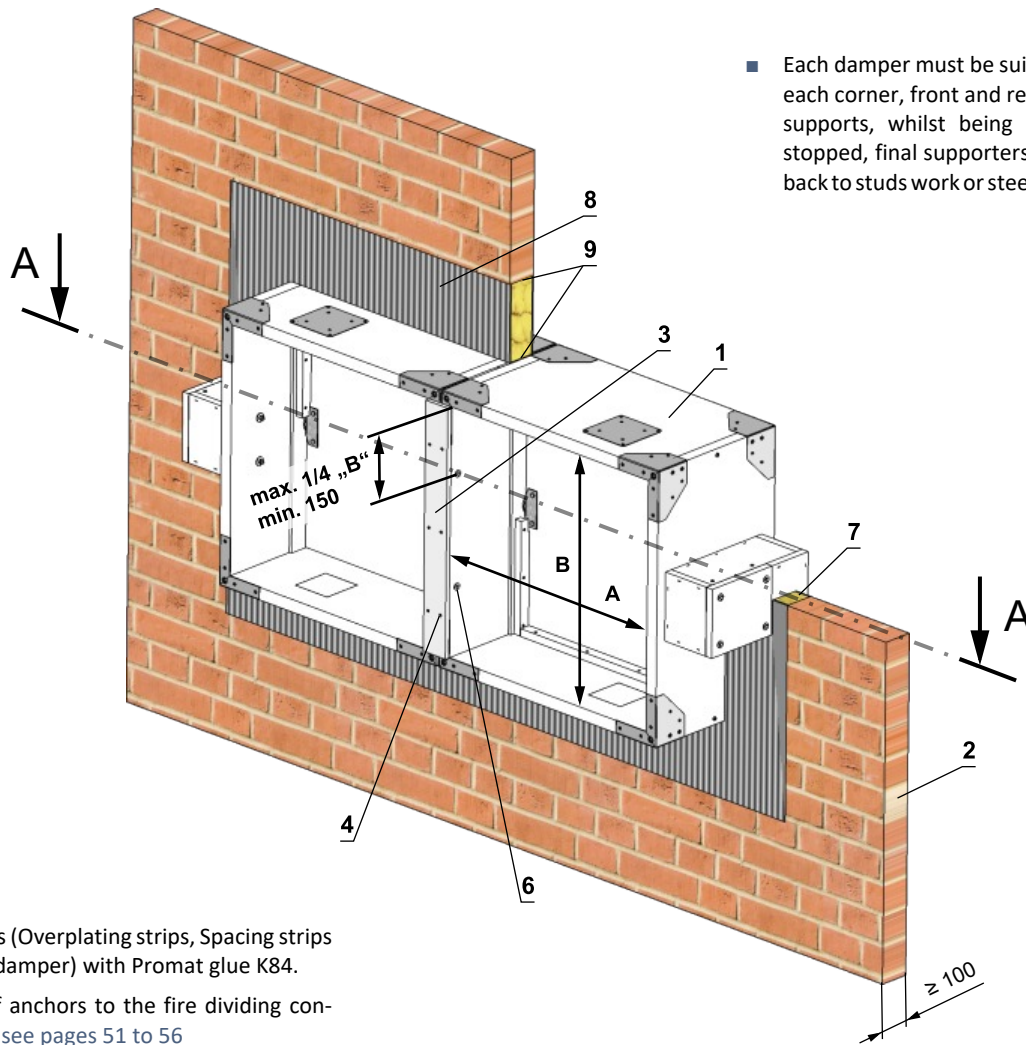


■ Each damper must be suitably supported in each corner, front and rear with temporary supports, whilst being installed and fire stopped, final supporters must be installed back to studs work or steel work as required.

- Seal all joints (Overplating strips, Spacing strips with SEDM damper) with Promat glue K84.
- Examples of anchors to the fire dividing construction → see pages 51 to 56

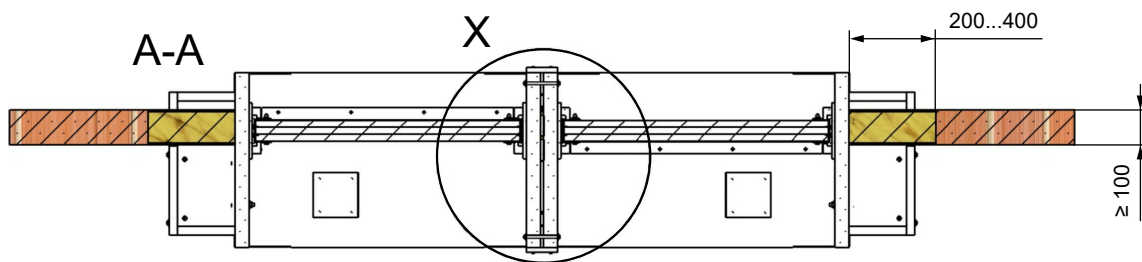


- \* **RESPECT JOINT POSITION !**  
Bolts and nuts shall not prevent free rotation on the blades.
- \*\* When installing a flange, overplating strip is not installed.

- 1 SEDM
- 2 Solid wall construction
- 3 Overplating strip (e.g. Promatect-H, th. 15 mm)\*\*
- 4 Screw UNI 4x40 mm (span 200-250 mm)
- 5 Spacing strip (e.g. Promatect-H, th. 10 mm, width 40-50 mm)
- 6 M8 bolt assembly on damper side „B“ (bolt M8x105 mm, 2x large washer M8, nut M8), distance from edge see fig. \*
- Ablative Coated Batt System HILTI
- 7 Mineral wool board - min. density 140 kg/m<sup>3</sup> (HILTI CFS-CT B 1S 140/50...)
- 8 Fire stop coating - th. 1 mm (HILTI CFS-CT...) - coating is overcoated on the support construction and on the damper casing/duct.
- 9 Fire-resistant mastic - (HILTI CFS-S ACR...) fill the gap from both sides of the fire separation construction and around the perimeter of penetration and damper casing.

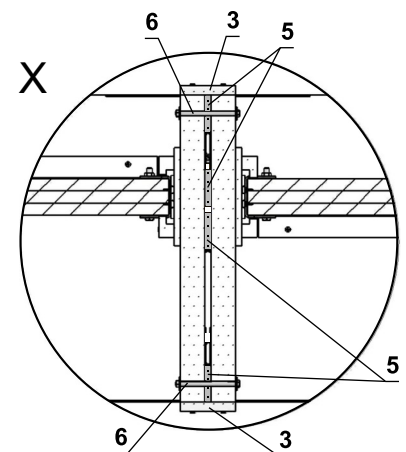


**Connecting straps, spacer straps, screws, screw connections and Promat glue K84 are not included in the delivery !**

2 dampers side by side - gypsum wall - Ablative Coated Batt

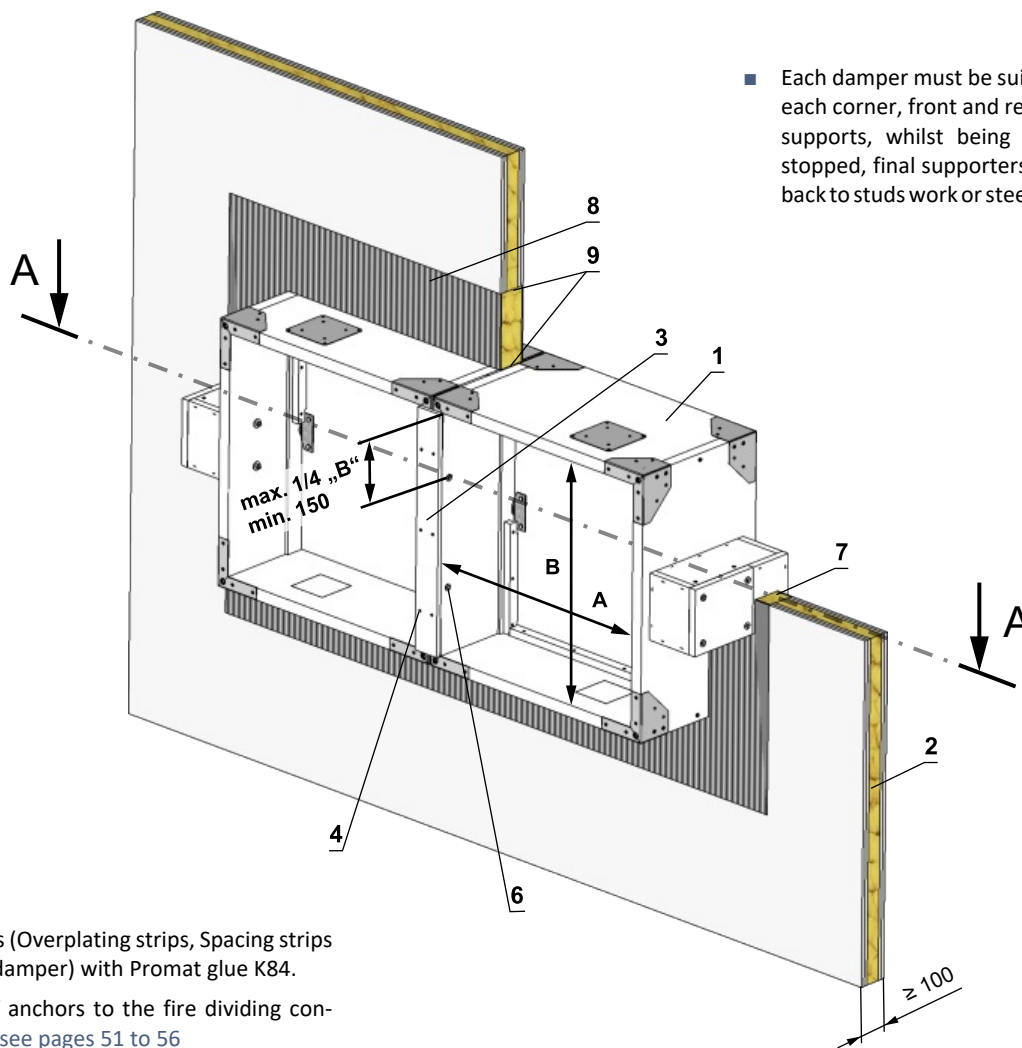


■ Each damper must be suitably supported in each corner, front and rear with temporary supports, whilst being installed and fire stopped, final supporters must be installed back to studs work or steel work as required.

- Seal all joints (Overplating strips, Spacing strips with SEDM damper) with Promat glue K84.
- Examples of anchors to the fire dividing construction → see pages 51 to 56

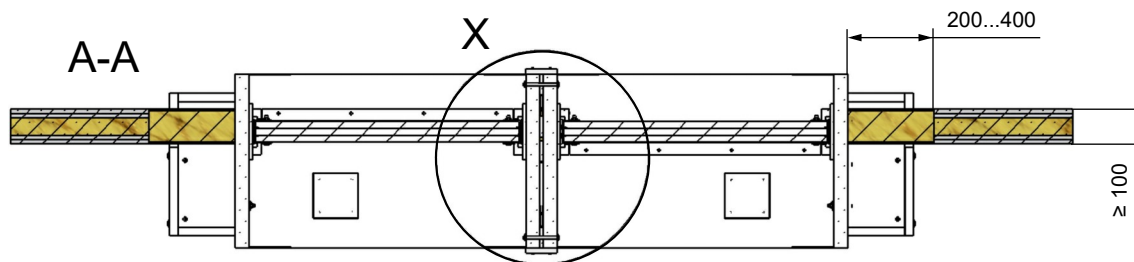


- \* **RESPECT JOINT POSITION !**  
Bolts and nuts shall not prevent free rotation on the blades.
- \*\* When installing a flange, overplating strip is not installed.

- 1 SEDM
- 2 Gypsum wall construction
- 3 Overplating strip (e.g. Promatect-H, th. 15 mm)\*\*
- 4 Screw UNI 4x40 mm (span 200-250 mm)
- 5 Spacing strip (e.g. Promatect-H, th. 10 mm, width 40-50 mm)
- 6 M8 bolt assembly on damper side „B“ (bolt M8x105 mm, 2x large washer M8, nut M8), distance from edge see fig. \*
- Ablative Coated Batt System HILTI
- 7 Mineral wool board - min. density 140 kg/m<sup>3</sup> (HILTI CFS-CT B 1S 140/50...)
- 8 Fire stop coating - th. 1 mm (HILTI CFS-CT...) - coating is overcoated on the support construction and on the damper casing/duct.
- 9 Fire-resistant mastic - (HILTI CFS-S ACR...) fill the gap from both sides of the fire separation construction and around the perimeter of penetration and damper casing.

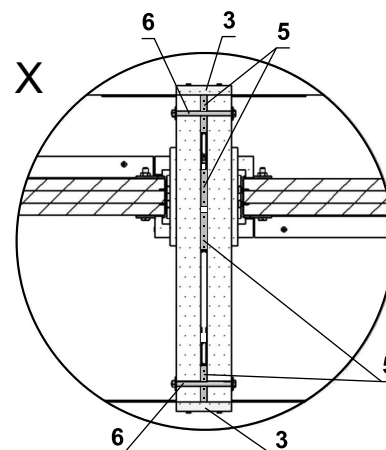


**Connecting straps, spacer straps, screws, screw connections and Promat glue K84 are not included in the delivery !**

2 dampers on top of each other - solid wall - mortar or gypsum

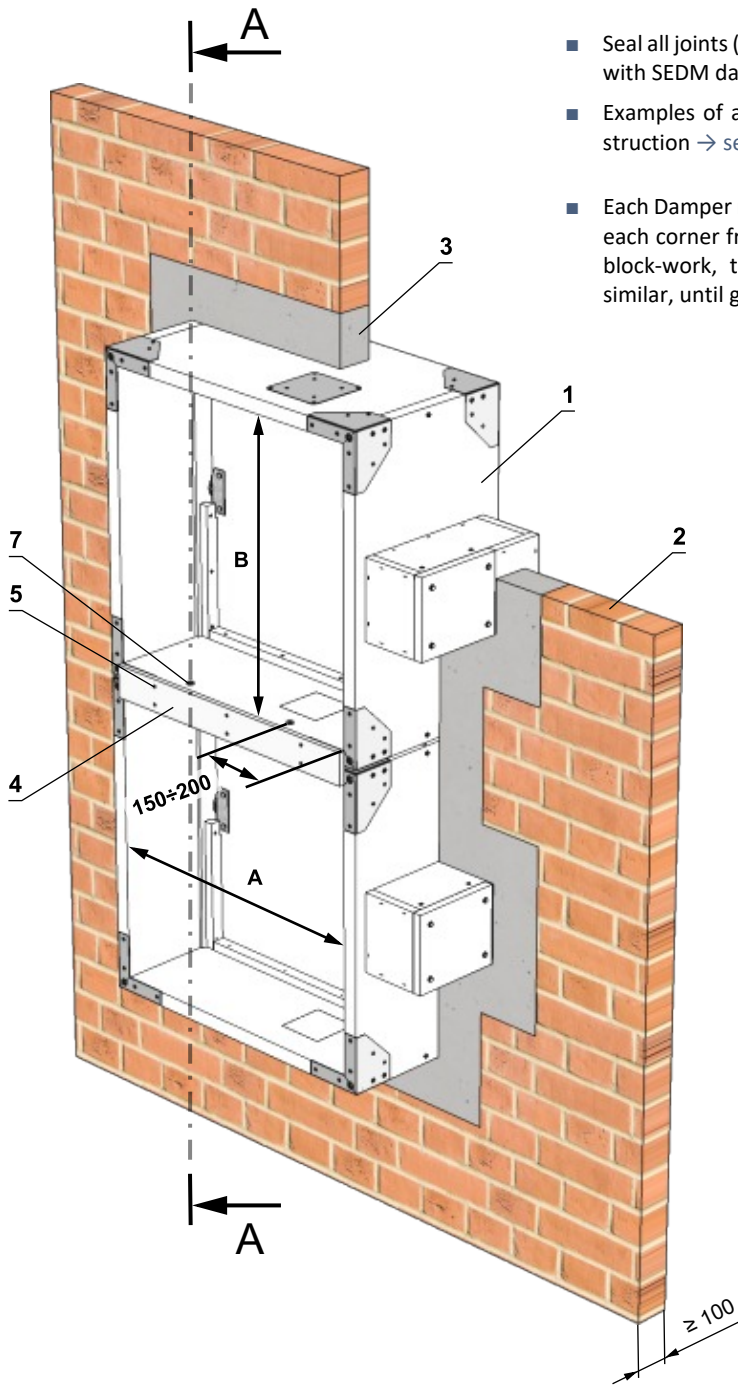


- Seal all joints (Overplating strips, Spacing strips with SEDM damper) with Promat glue K84.
- Examples of anchors to the fire dividing construction → see pages 51 to 56
- Each Damper must be suitably supported in each corner front and rear with temporary block-work, temporary steel supports or similar, until gypsum has fully hardened.

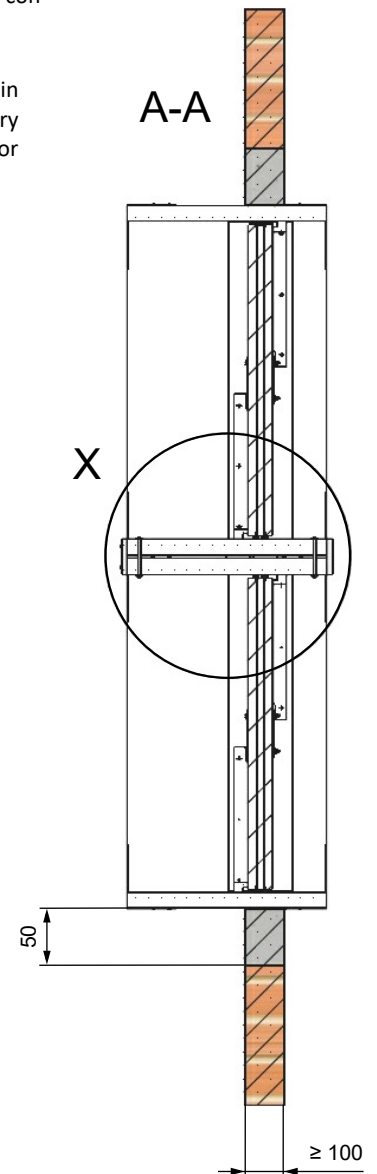


\* When installing a flange, overplating strip is not installed.

- 1 SEDM
- 2 Solid wall construction
- 3 Mortar or gypsum
- 4 Overplating strip (e.g. Promatect-H, th. 15 mm)\*
- 5 Screw UNI 4x40 mm (span 200-250 mm)
- 6 Spacing strip (e.g. Promatect-H, th. 10 mm, width 40-50 mm)
- 7 M8 bolt assembly on damper side „A“ (bolt M8x105 mm, 2x large washer M8, nut M8), distance from edge see fig., span max. 400 mm

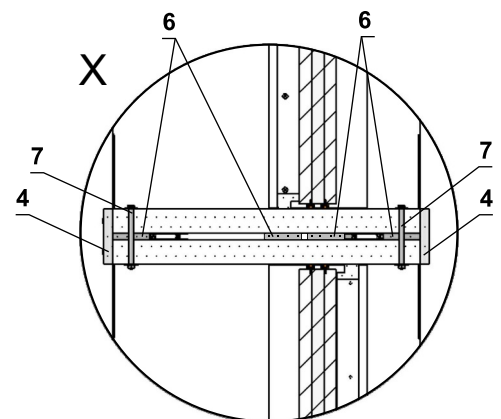


**Connecting straps, spacer straps, screws, screw connections and Promat glue K84 are not included in the delivery !**

**2 dampers on top of each other - solid wall - Ablative Coated Batt**

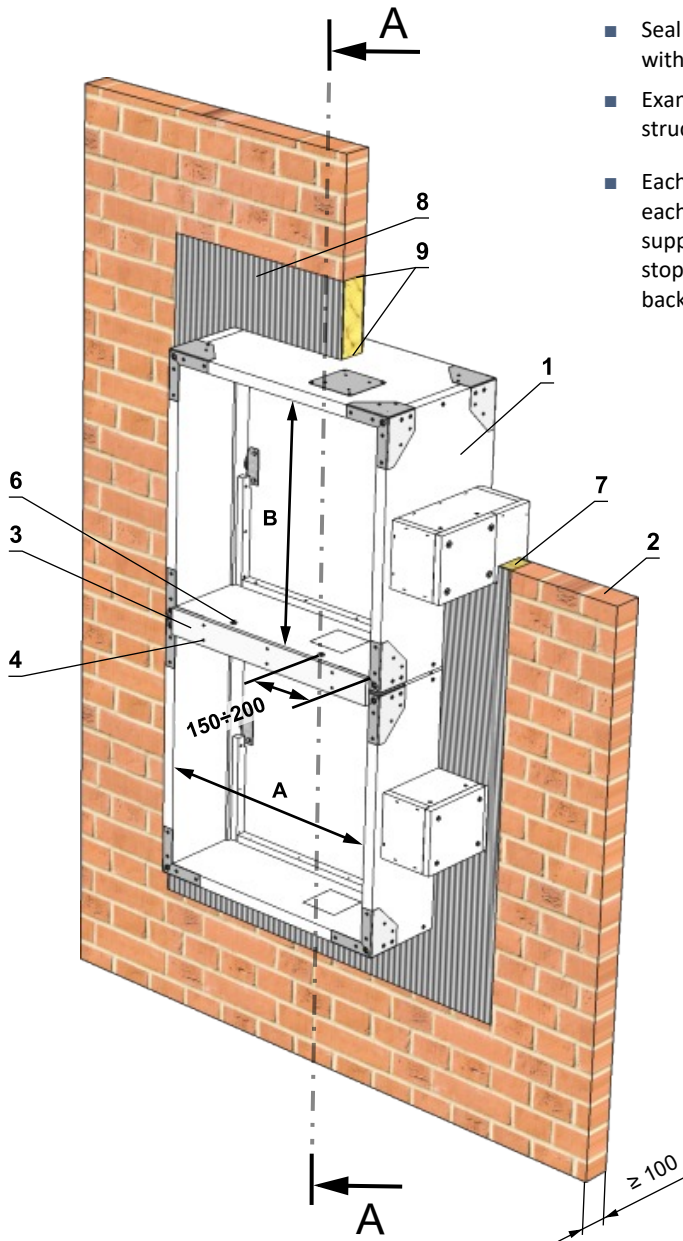


- Seal all joints (Overplating strips, Spacing strips with SEDM damper) with Promat glue K84.
- Examples of anchors to the fire dividing construction → see pages 51 to 56
- Each damper must be suitably supported in each corner, front and rear with temporary supports, whilst being installed and fire stopped, final supporters must be installed back to studs work or steel work as required.

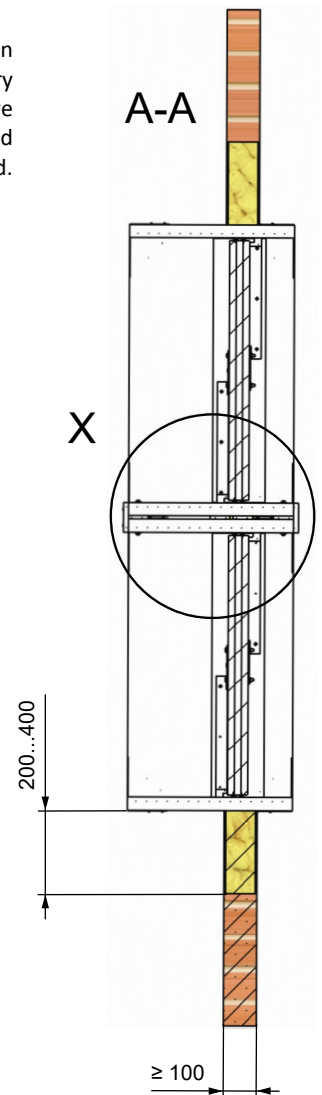


\* When installing a flange, overplating strip is not installed.

- 1 SEDM
- 2 Solid wall construction
- 3 Overplating strip (e.g. Promatect-H, th. 15 mm)\*
- 4 Screw UNI 4x40 mm (span 200-250 mm)
- 5 Spacing strip (e.g. Promatect-H, th. 10 mm, width 40-50 mm)
- 6 M8 bolt assembly on damper side „A“ (bolt M8x105 mm, 2x large washer M8, nut M8), distance from edge see fig., span max. 400 mm  
Ablative Coated Batt System HILTI
- 7 Mineral wool board - min. density 140 kg/m<sup>3</sup> (HILTI CFS-CT B 1S 140/50...)
- 8 Fire stop coating - th. 1 mm (HILTI CFS-CT...) - coating is overcoated on the support construction and on the damper casing/duct.
- 9 Fire-resistant mastic - (HILTI CFS-S ACR...) fill the gap from both sides of the fire separation construction and around the perimeter of penetration and damper casing.

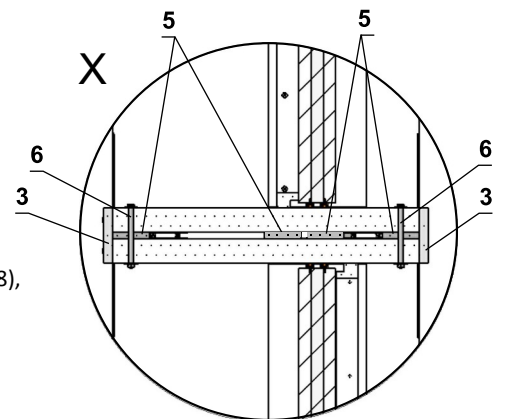


**Connecting straps, spacer straps, screws, screw connections and Promat glue K84 are not included in the delivery !**

2 dampers on top of each other - gypsum wall - Ablative Coated Batt

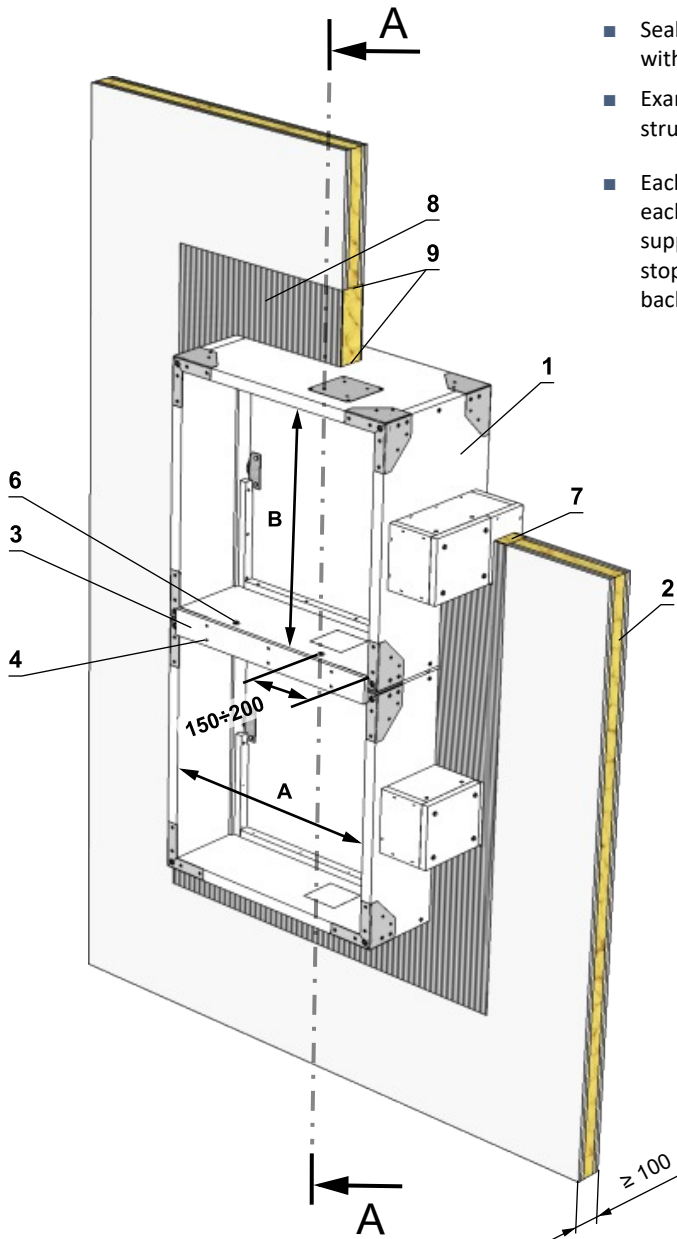


- Seal all joints (Overplating strips, Spacing strips with SEDM damper) with Promat glue K84.
- Examples of anchors to the fire dividing construction → see pages 51 to 56
- Each damper must be suitably supported in each corner, front and rear with temporary supports, whilst being installed and fire stopped, final supporters must be installed back to studs work or steel work as required.

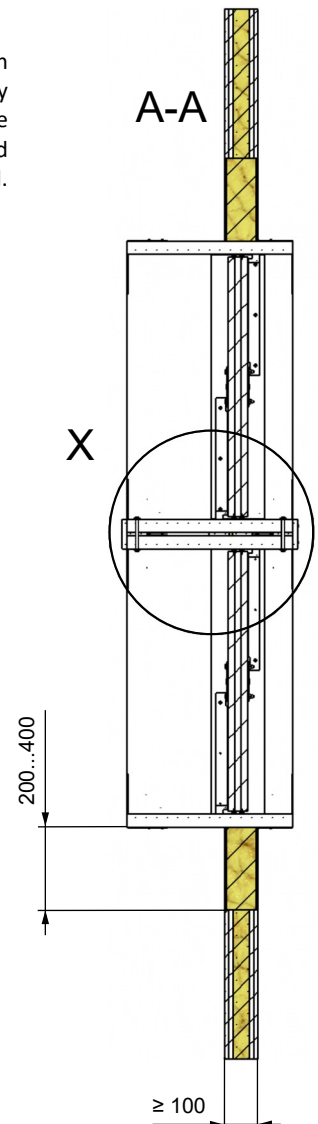

\* When installing a flange, overplating strip is not installed.


- 1 SEDM
- 2 Gypsum wall construction
- 3 Overplating strip (e.g. Promatect-H, th. 15 mm)\*
- 4 Screw UNI 4x40 mm (span 200-250 mm)
- 5 Spacing strip (e.g. Promatect-H, th. 10 mm, width 40-50 mm)
- 6 M8 bolt assembly on damper side „A“ (bolt M8x105 mm, 2x large washer M8, nut M8), distance from edge see fig., span max. 400 mm  
Ablative Coated Batt System HILTI
- 7 Mineral wool board - min. density 140 kg/m<sup>3</sup> (HILTI CFS-CT B 1S 140/50...)
- 8 Fire stop coating - th. 1 mm (HILTI CFS-CT...) - coating is overcoated on the support construction and on the damper casing/duct.
- 9 Fire-resistant mastic - (HILTI CFS-S ACR...) fill the gap from both sides of the fire separation construction and around the perimeter of penetration and damper casing.

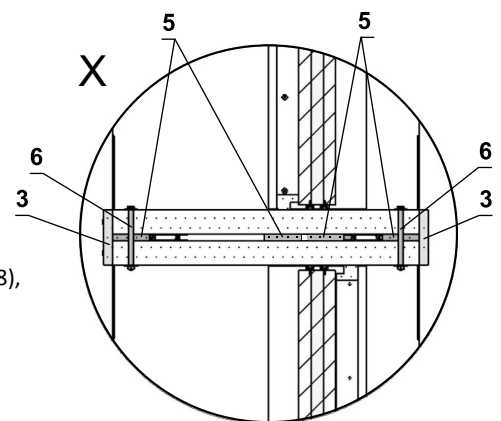



**Connecting straps, spacer straps, screws, screw connections and Promat glue K84 are not included in the delivery !**



3 dampers on top of each other - solid wall - mortar or gypsum

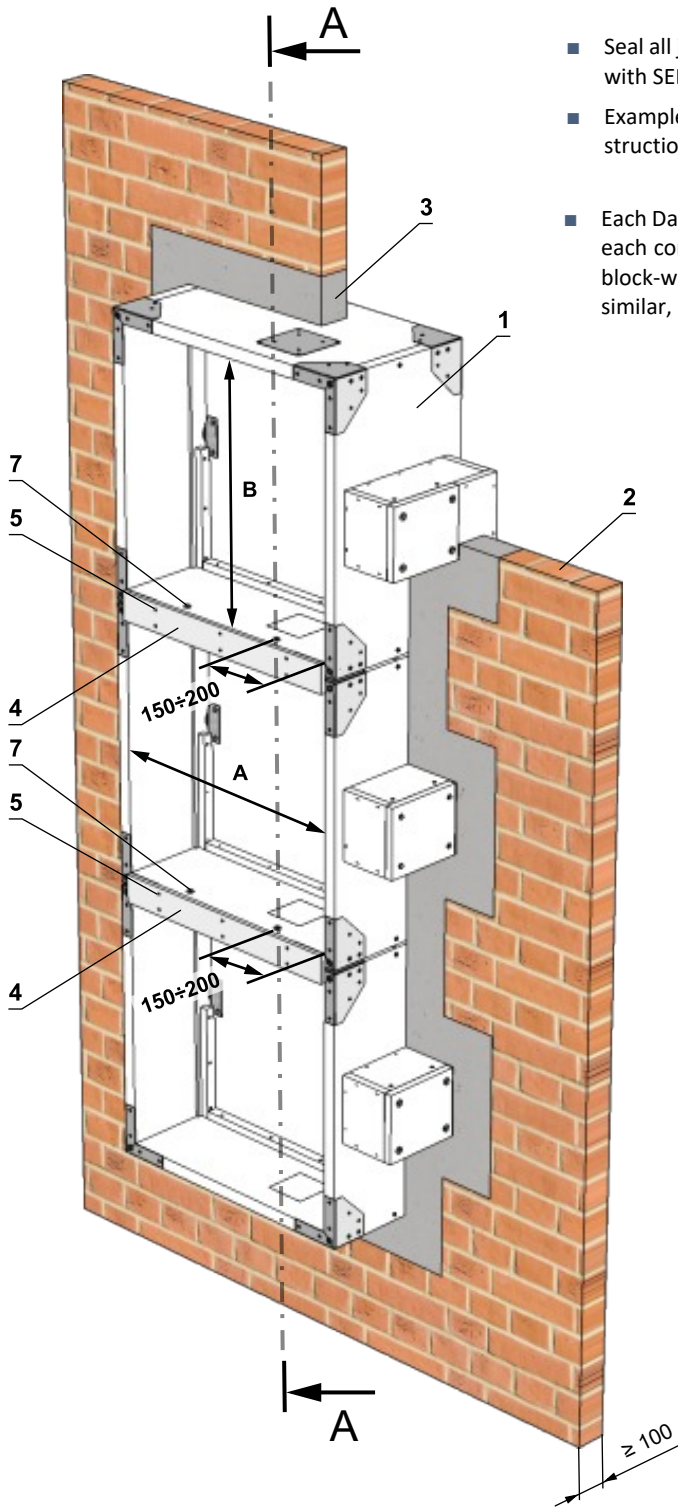

- Seal all joints (Overplating strips, Spacing strips with SEDM damper) with Promat glue K84.
- Examples of anchors to the fire dividing construction → see pages 51 to 56
- Each Damper must be suitably supported in each corner front and rear with temporary block-work, temporary steel supports or similar, until gypsum has fully hardened.

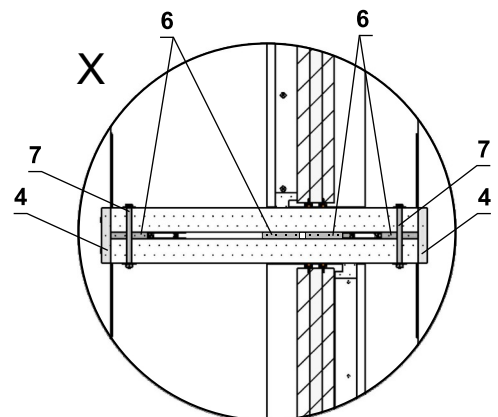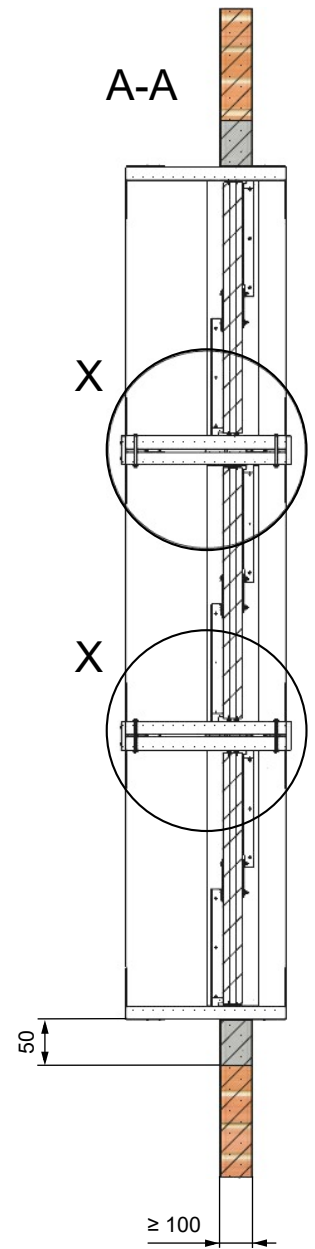


\* When installing a flange, overplating strip is not installed.


- 1 SEDM
- 2 Solid wall construction
- 3 Mortar or gypsum
- 4 Overplating strip (e.g. Promatect-H, th. 15 mm)\*
- 5 Screw UNI 4x40 mm (span 200-250 mm)
- 6 Spacing strip (e.g. Promatect-H, th. 10 mm, width 40-50 mm)
- 7 M8 bolt assembly on damper side „A“ (bolt M8x105 mm, 2x large washer M8, nut M8), distance from edge see fig., span max. 400 mm

**Connecting straps, spacer straps, screws, screw connections and Promat glue K84 are not included in the delivery !**

3 dampers on top of each other - solid wall - Ablative Coated Batt

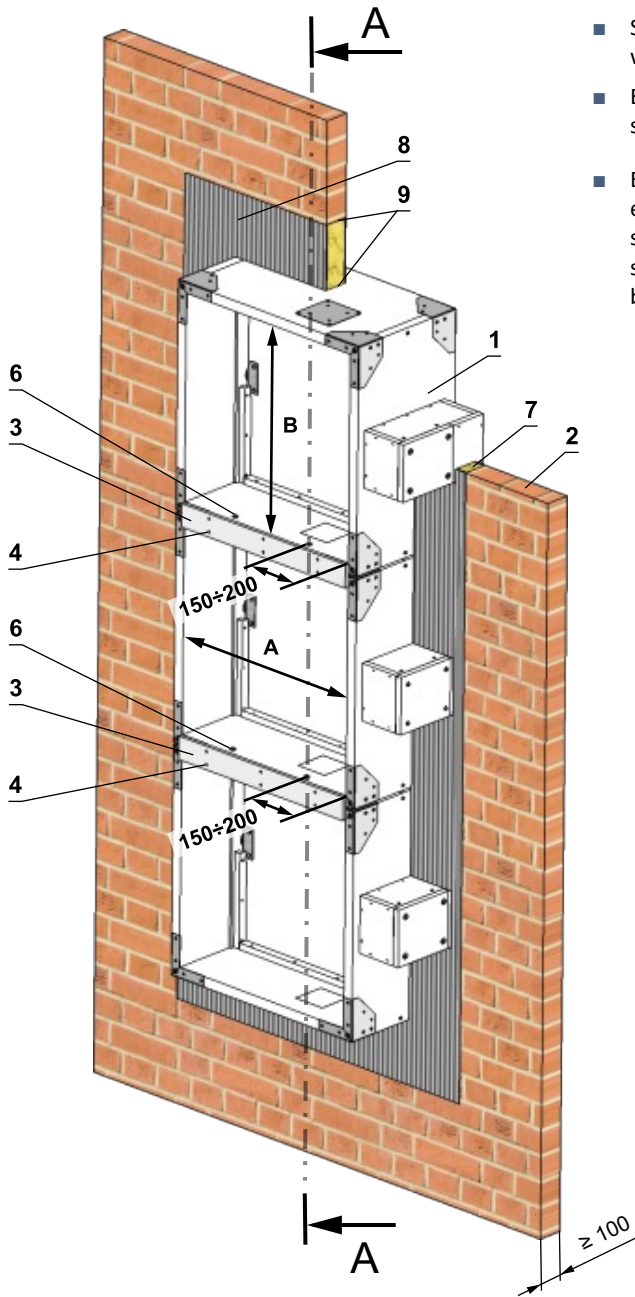


- Seal all joints (Overplating strips, Spacing strips with SEDM damper) with Promat glue K84.
- Examples of anchors to the fire dividing construction → see pages 51 to 56
- Each damper must be suitably supported in each corner, front and rear with temporary supports, whilst being installed and fire stopped, final supporters must be installed back to studs work or steel work as required.

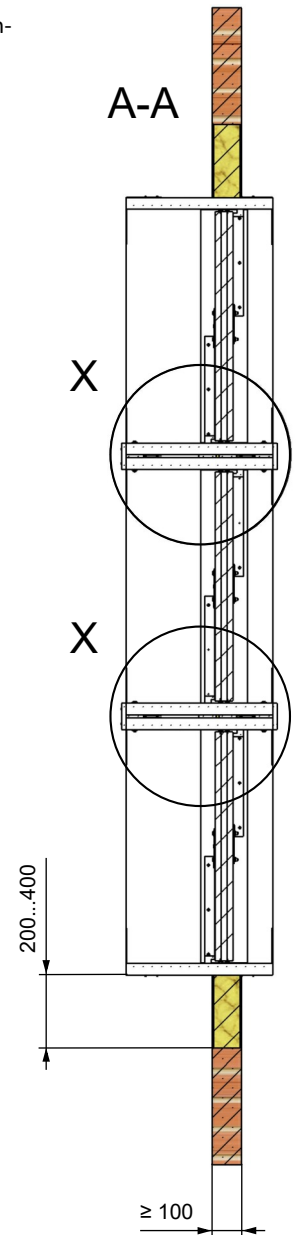


\* When installing a flange, overplating strip is not installed.

- 1 SEDM
  - 2 Solid wall construction
  - 3 Overplating strip (e.g. Promatect-H, th. 15 mm)\*
  - 4 Screw UNI 4x40 mm (span 200-250 mm)
  - 5 Spacing strip (e.g. Promatect-H, th. 10 mm, width 40-50 mm)
  - 6 M8 bolt assembly on damper side „A“ (bolt M8x105 mm, 2x large washer M8, nut M8), distance from edge see fig., span max. 400 mm
- Ablative Coated Batt System HILTI
- 7 Mineral wool board - min. density 140 kg/m<sup>3</sup> (HILTI CFS-CT B 1S 140/50...)
  - 8 Fire stop coating - th. 1 mm (HILTI CFS-CT...) - coating is overcoated on the support construction and on the damper casing/duct.
  - 9 Fire-resistant mastic - (HILTI CFS-S ACR...) fill the gap from both sides of the fire separation construction and around the perimeter of penetration and damper casing.

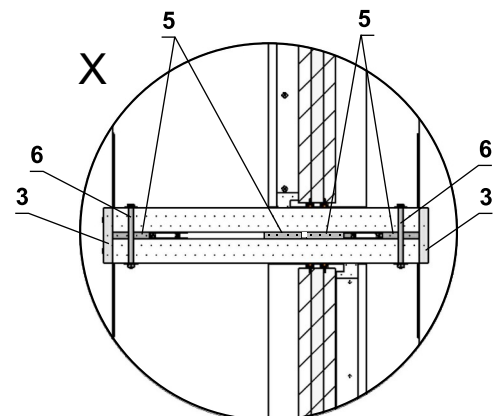


**Connecting straps, spacer straps, screws, screw connections and Promat glue K84 are not included in the delivery !**

3 dampers on top of each other - gypsum wall - Ablative Coated Batt

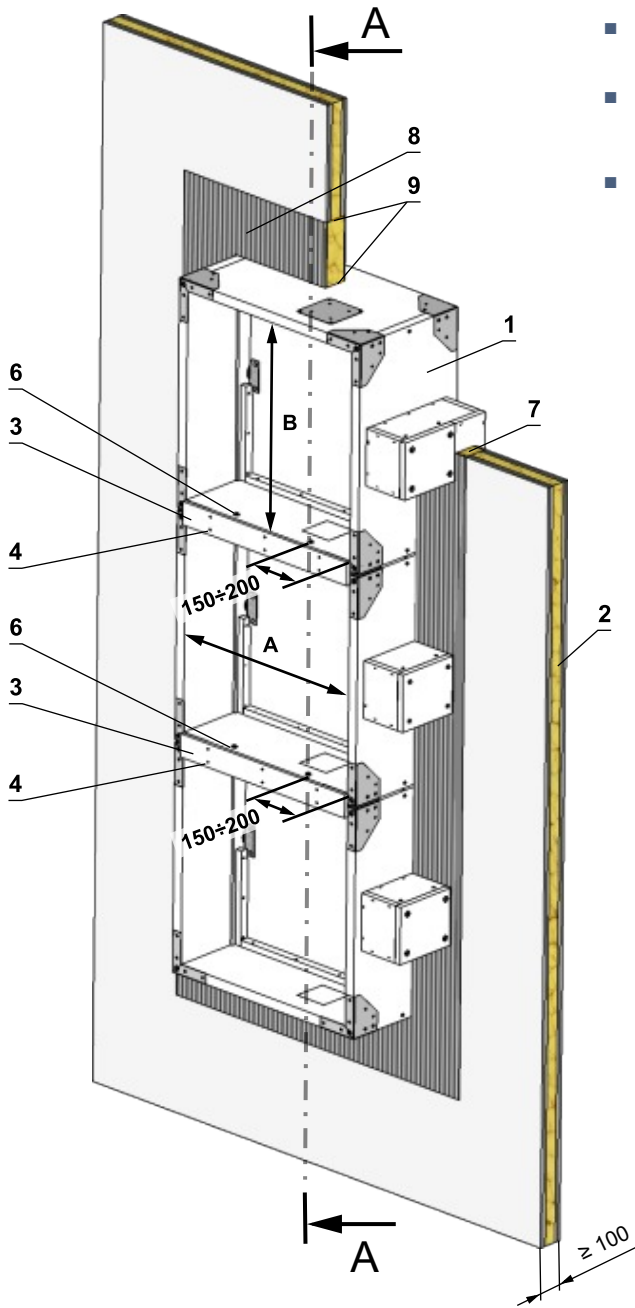


- Seal all joints (Overplating strips, Spacing strips with SEDM damper) with Promat glue K84.
- Examples of anchors to the fire dividing construction → see pages 51 to 56
- Each damper must be suitably supported in each corner, front and rear with temporary supports, whilst being installed and fire stopped, final supporters must be installed back to studs work or steel work as required.

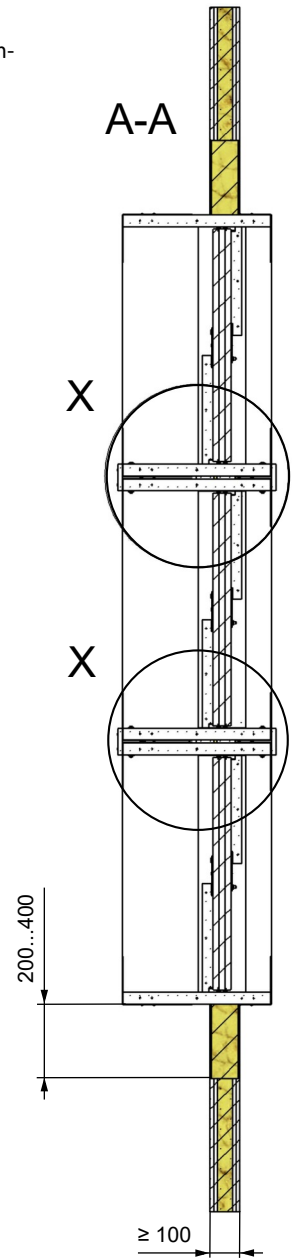

\* When installing a flange, overplating strip is not installed.


- 1 SEDM
- 2 Gypsum wall construction
- 3 Overplating strip (e.g. Promatect-H, th. 15 mm)\*
- 4 Screw UNI 4x40 mm (span 200-250 mm)
- 5 Spacing strip (e.g. Promatect-H, th. 10 mm, width 40-50 mm)
- 6 M8 bolt assembly on damper side „A“ (bolt M8x105 mm, 2x large washer M8, nut M8), distance from edge see fig., span max. 400 mm  
Ablative Coated Batt System HILTI
- 7 Mineral wool board - min. density 140 kg/m<sup>3</sup> (HILTI CFS-CT B 1S 140/50...)
- 8 Fire stop coating - th. 1 mm (HILTI CFS-CT...) - coating is overcoated on the support construction and on the damper casing/duct.
- 9 Fire-resistant mastic - (HILTI CFS-S ACR...) fill the gap from both sides of the fire separation construction and around the perimeter of penetration and damper casing.

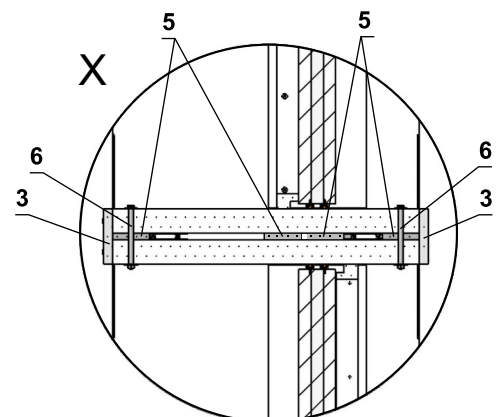

**Connecting straps, spacer straps, screws, screw connections and Promat glue K84 are not included in the delivery !**

4 dampers - solid wall - mortar or gypsum

- Seal all joints (Overplating strips, Spacing strips with SEDM damper) with Promat glue K84.
- Examples of anchors to the fire dividing construction → see pages 51 to 56
- Each Damper must be suitably supported in each corner front and rear with temporary block-work, temporary steel supports or similar, until gypsum has fully hardened.

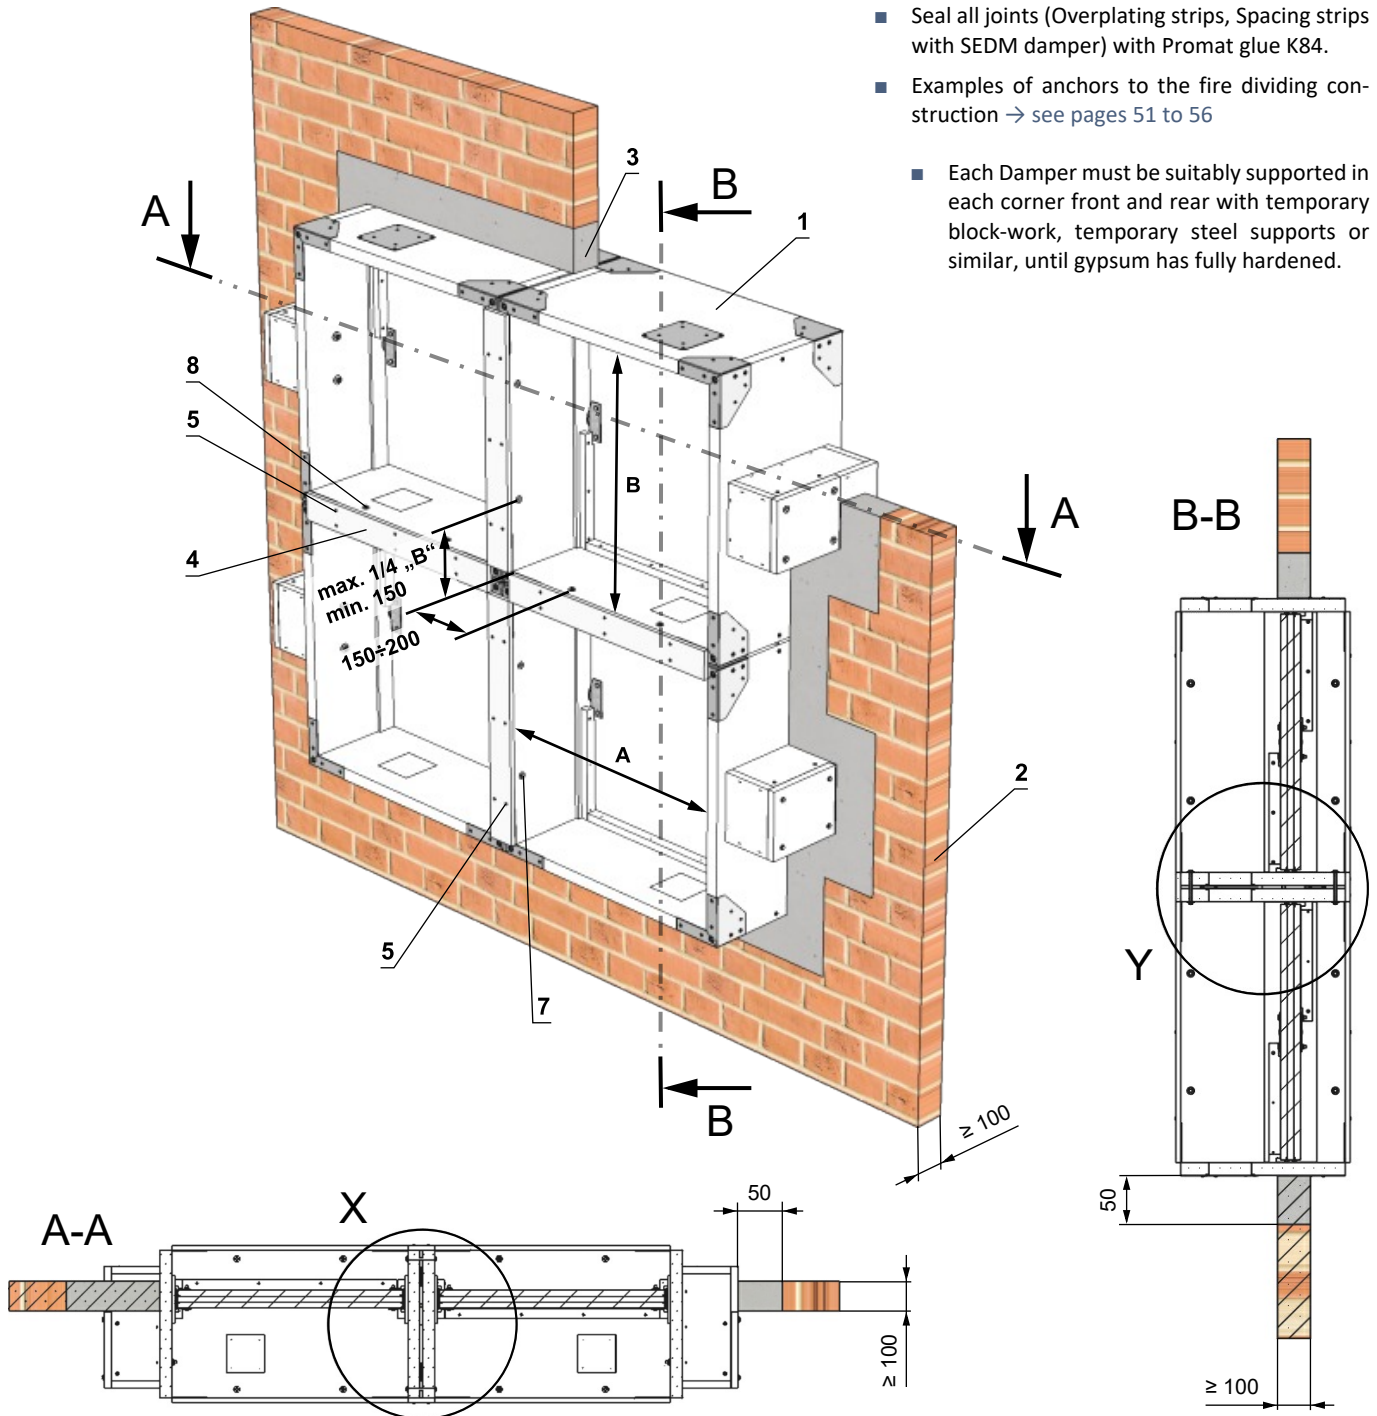


\* **RESPECT JOINT POSITION !**  
Bolts and nuts shall not prevent free rotation on the blades.

\*\* When installing a flange, overplating strip is not installed.

- 1 SEDM
- 2 Solid wall construction
- 3 Mortar or gypsum
- 4 Overplating strip (e.g. Promatect-H, th. 15 mm)\*\*
- 5 Screw UNI 4x40 mm (span 200-250 mm)
- 6 Spacing strip (e.g. Promatect-H, th. 10 mm, width 40-50 mm)
- 7 M8 bolt assembly on damper side „B“ (bolt M8x105 mm, 2x large washer M8, nut M8), distance from edge see fig. \*
- 8 M8 bolt assembly on damper side „A“ (bolt M8x105 mm, 2x large washer M8, nut M8), distance from edge see fig., span max. 400 mm




**Connecting straps, spacer straps, screws, screw connections and Promat glue K84 are not included in the delivery !**

4 dampers - solid wall - Ablative Coated Batt

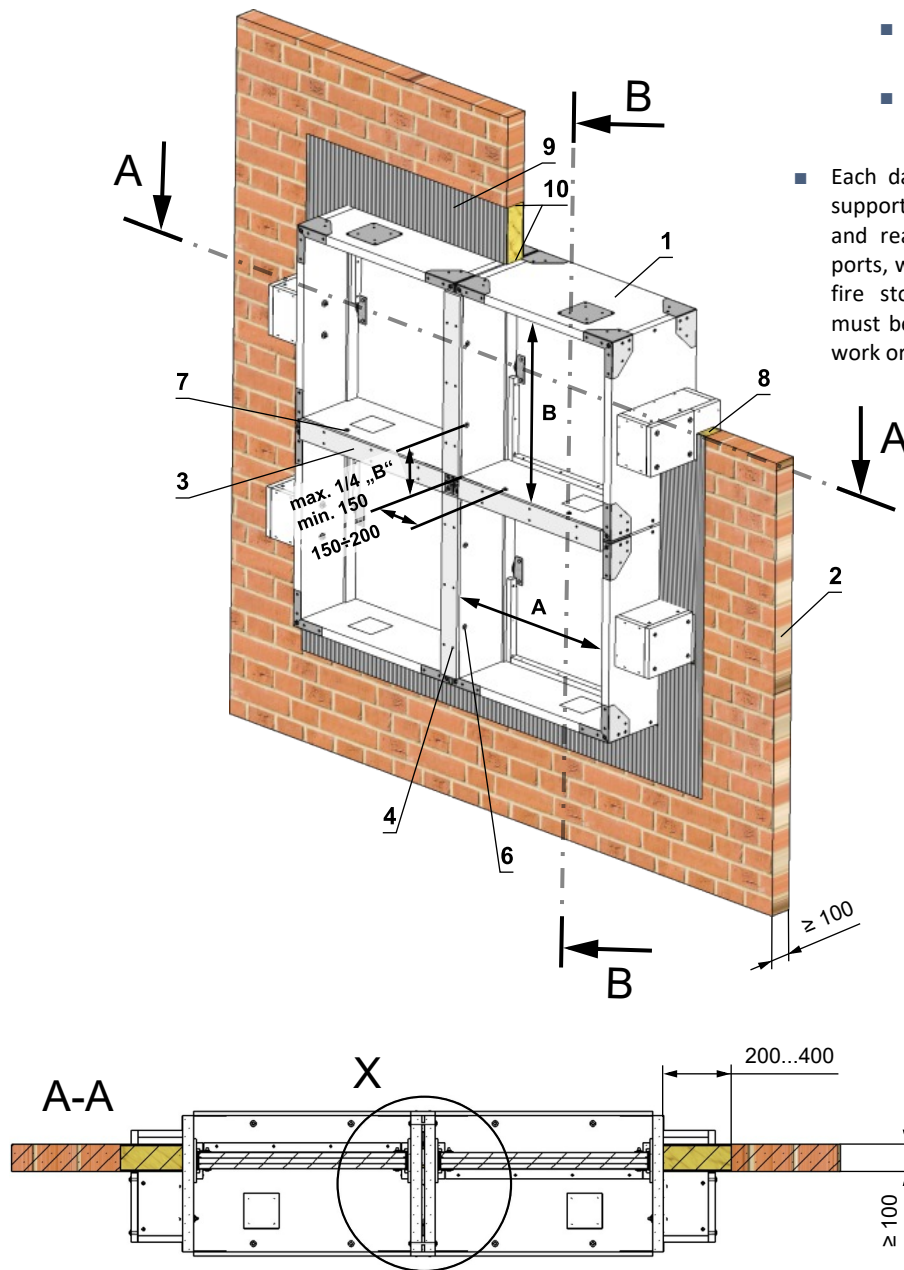

- Seal all joints (Overplating strips, Spacing strips with SEDM damper) with Promat glue K84.
- Examples of anchors to the fire dividing construction → see pages 51 to 56

■ Each damper must be suitably supported in each corner, front and rear with temporary supports, whilst being installed and fire stopped, final supporters must be installed back to studs work or steel work as required.

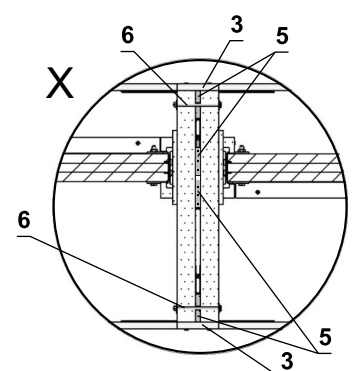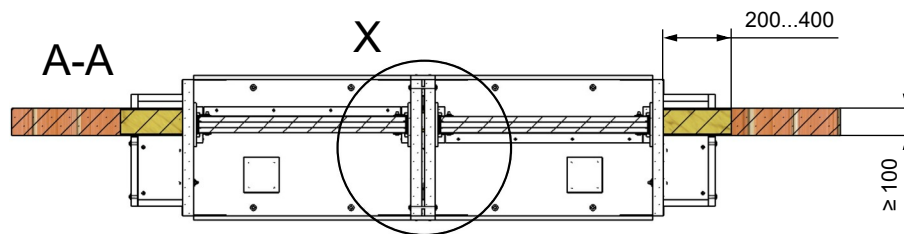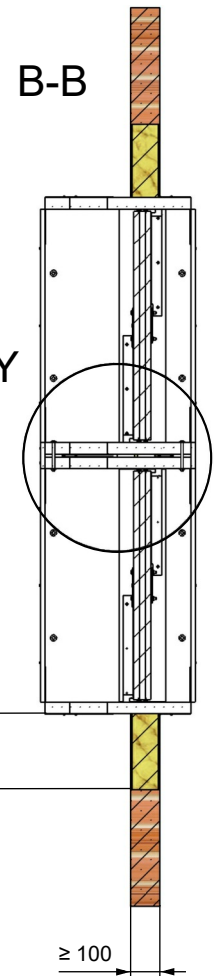


\* RESPECT JOINT POSITION !

Bolts and nuts shall not prevent free rotation on the blades.


\*\* When installing a flange, overplating strip is not installed.

- 1 SEDM
- 2 Solid wall construction
- 3 Overplating strip (e.g. Promatect-H, th. 15 mm)\*\*
- 4 Screw UNI 4x40 mm (span 200-250 mm)
- 5 Spacing strip (e.g. Promatect-H, th. 10 mm, width 40-50 mm)
- 6 M8 bolt assembly on damper side „B“ (bolt M8x105 mm, 2x large washer M8, nut M8), distance from edge see fig. \*
- 7 M8 bolt assembly on damper side „A“ (bolt M8x105 mm, 2x large washer M8, nut M8), distance from edge see fig., span max. 400 mm  
Ablative Coated Batt System HILTI
- 8 Mineral wool board - min. density 140 kg/m<sup>3</sup> (HILTI CFS-CT B 1S 140/50...)
- 9 Fire stop coating - th. 1 mm (HILTI CFS-CT...) - coating is overcoated on the support construction and on the damper casing/duct.
- 10 Fire-resistant mastic - (HILTI CFS-S ACR...) fill the gap from both sides of the fire separation construction and around the perimeter of penetration and damper casing.

Connecting straps, spacer straps, screws, screw connections and Promat glue K84 are not included in the delivery !


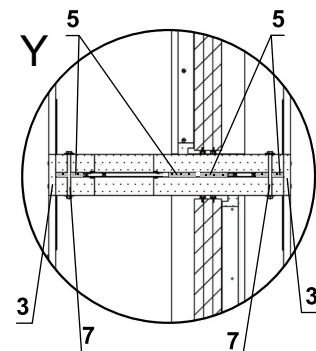


4 dampers - gypsum wall - Ablative Coated Batt

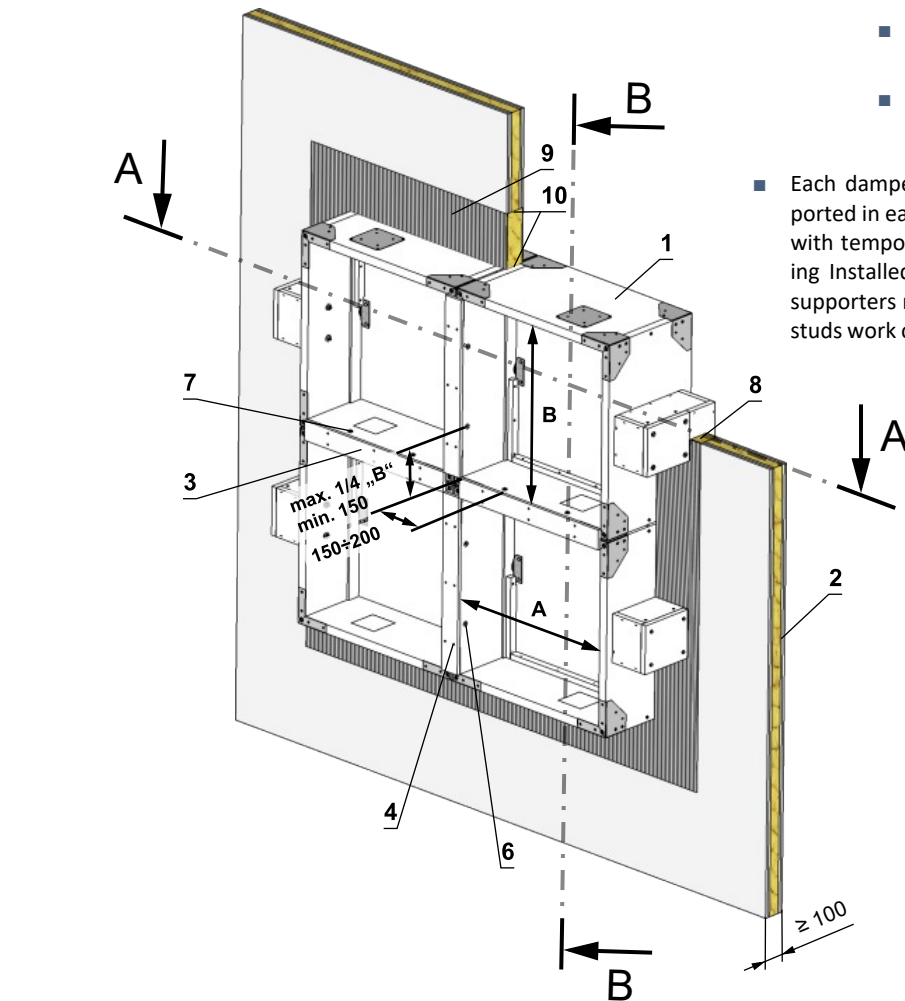

- Seal all joints (Overplating strips, Spacing strips with SEDM damper) with Promat glue K84.
- Examples of anchors to the fire dividing construction → see pages 51 to 56

- Each damper must be suitably supported in each corner, front and rear with temporary supports, whilst being installed and fire stopped, final supporters must be installed back to studs work or steel work as required.

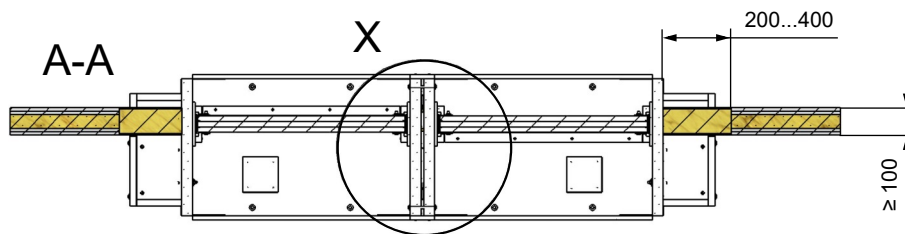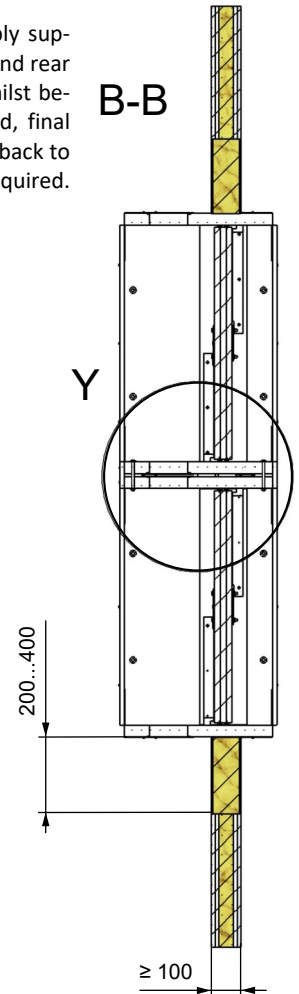


\* RESPECT JOINT POSITION !

Bolts and nuts shall not prevent free rotation on the blades.

\*\* When installing a flange, overplating strip is not installed.

- 1 SEDM
- 2 Gypsum wall construction
- 3 Overplating strip (e.g. Promatect-H, th. 15 mm)\*\*
- 4 Screw UNI 4x40 mm (span 200-250 mm)
- 5 Spacing strip (e.g. Promatect-H, th. 10 mm, width 40-50 mm)
- 6 M8 bolt assembly on damper side „B“ (bolt M8x105 mm, 2x large washer M8, nut M8), distance from edge see fig. \*
- 7 M8 bolt assembly on damper side „A“ (bolt M8x105 mm, 2x large washer M8, nut M8), distance from edge see fig., span max. 400 mm  
Ablative Coated Batt System HILTI
- 8 Mineral wool board - min. density 140 kg/m<sup>3</sup> (HILTI CFS-CT B 1S 140/50...)
- 9 Fire stop coating - th. 1 mm (HILTI CFS-CT...) - coating is overcoated on the support construction and on the damper casing/duct.
- 10 Fire-resistant mastic - (HILTI CFS-S ACR...) fill the gap from both sides of the fire separation construction and around the perimeter of penetration and damper casing.





Connecting straps, spacer straps, screws, screw connections and Promat glue K84 are not included in the delivery !

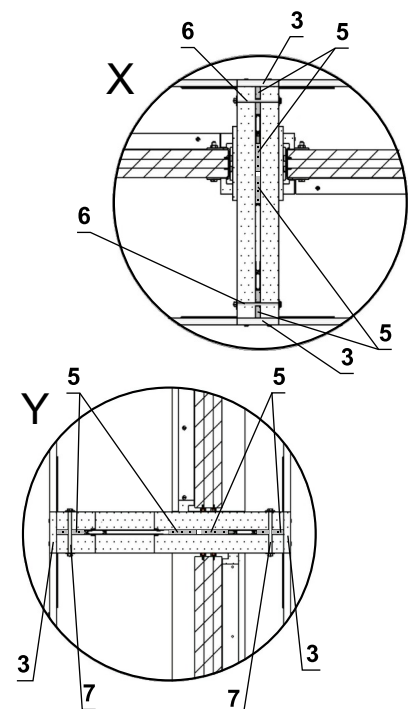

## Installation into/onto vertical or horizontal smoke extraction duct

### Installation of the damper into/onto vertical steel smoke extraction duct





- The dampers and duct must be suspended separately.
- Number of L-holders and their placement, acc. to AxB dimension → see page 53
- Examples of anchors to the fire dividing construction → see pages 51 to 56
- For connection of following duct → see pages 57 to 61

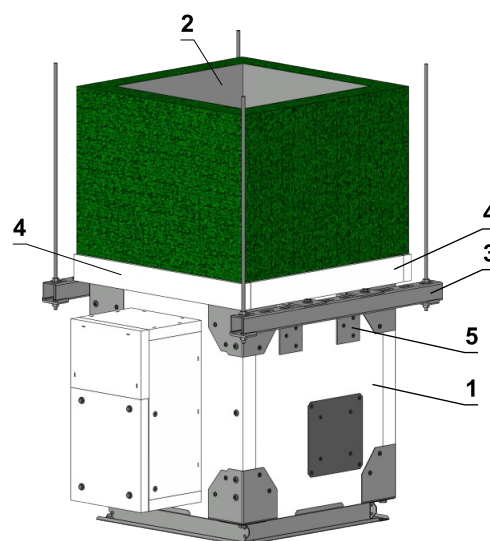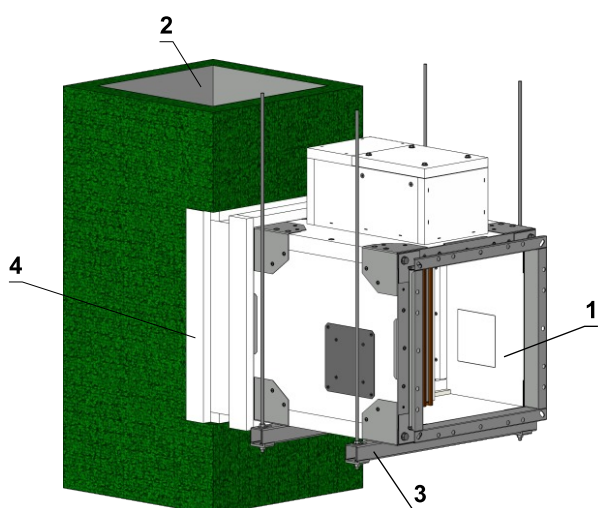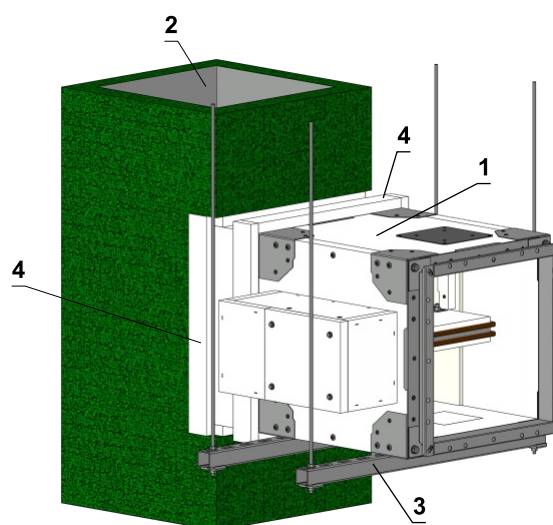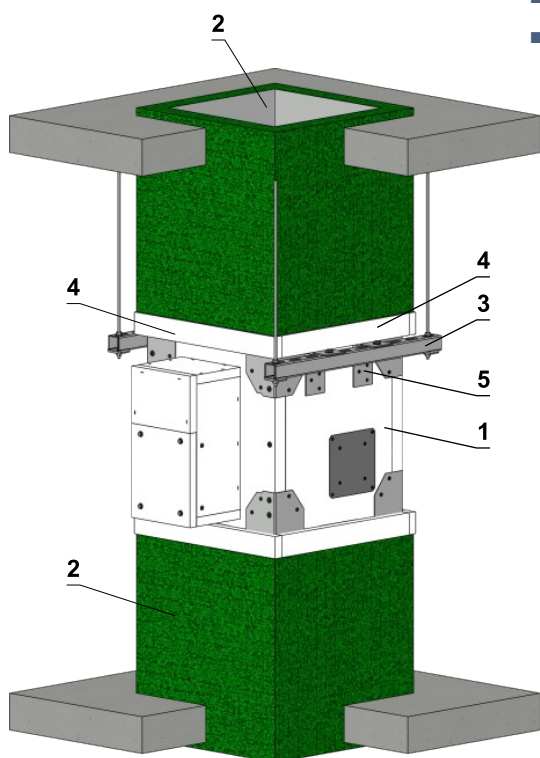

- 1 SEDM
- 2 Smoke extraction duct
- 3 Profile with threaded rod → see page 51
- 4 Insulating connecting strip
- 5 L-holder → see page 53

Installation of the damper into/onto horizontal steel smoke extraction duct

- The dampers and duct must be suspended separately.
- Number of L-holders and their placement, acc. to AxB dimension → see page 53
- Examples of anchors to the fire dividing construction → see pages 51 to 56
- For connection of following duct → see pages 57 to 61

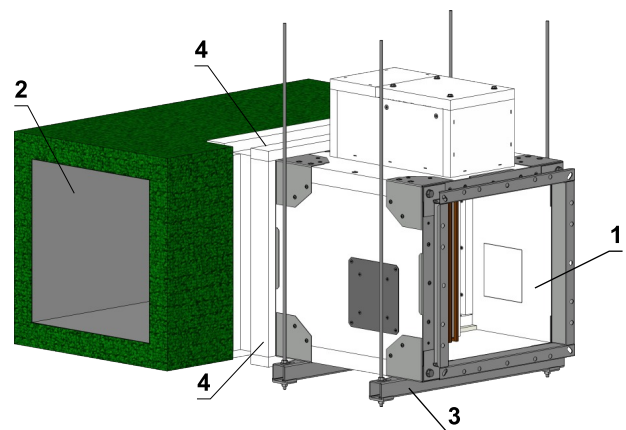
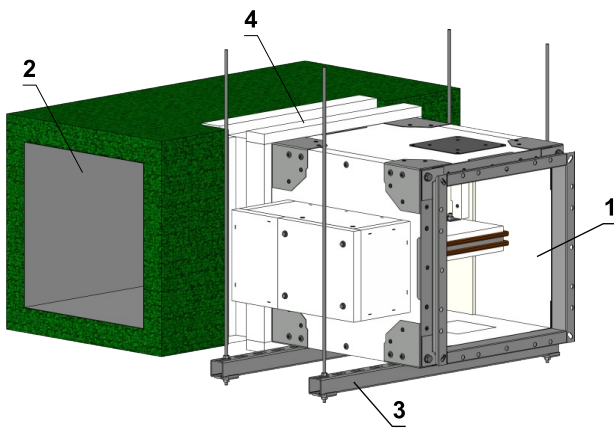
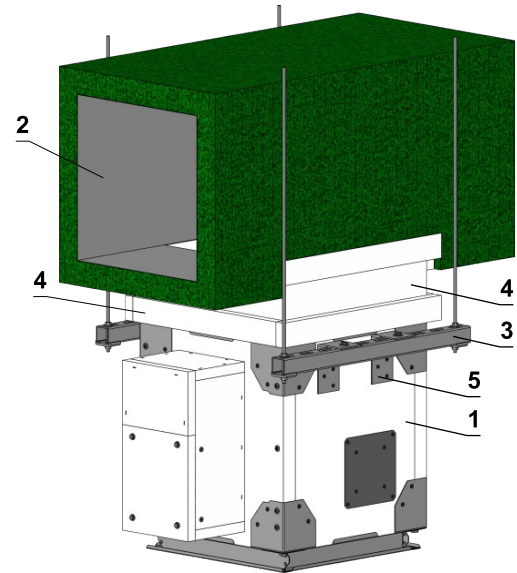
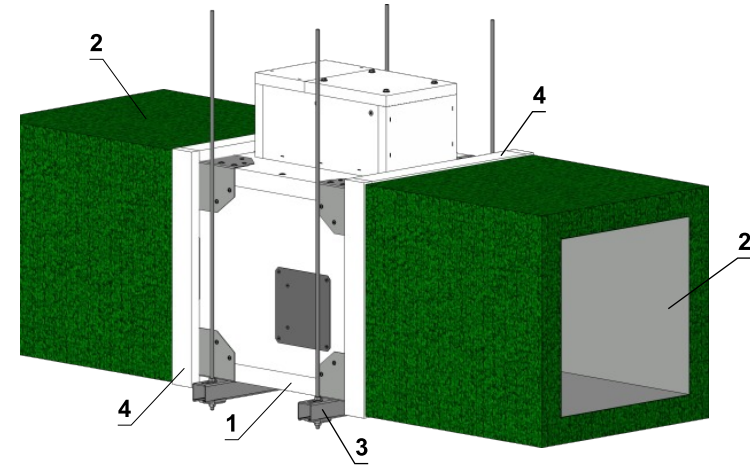


- 1 SEDM
- 2 Smoke extraction duct
- 3 Profile with threaded rod → see page 51
- 4 Insulating connecting strip
- 5 L-holder → see page 53



Installation of the damper into/onto vertical duct made of fire-resistant boards for smoke extraction





- The dampers and duct must be suspended separately.
- Number of L-holders and their placement, acc. to AxB dimension → see page 53
- Examples of anchors to the fire dividing construction → see pages 51 to 56
- For connection of following duct → see pages 57 to 61

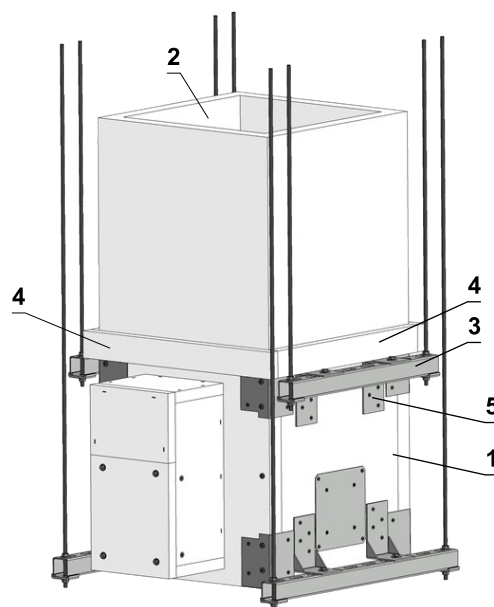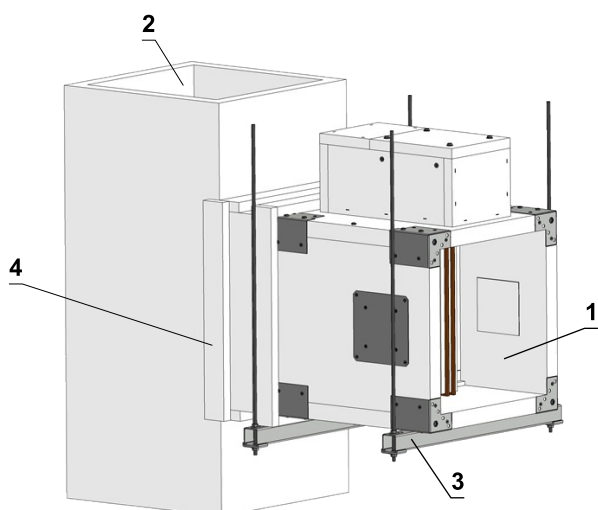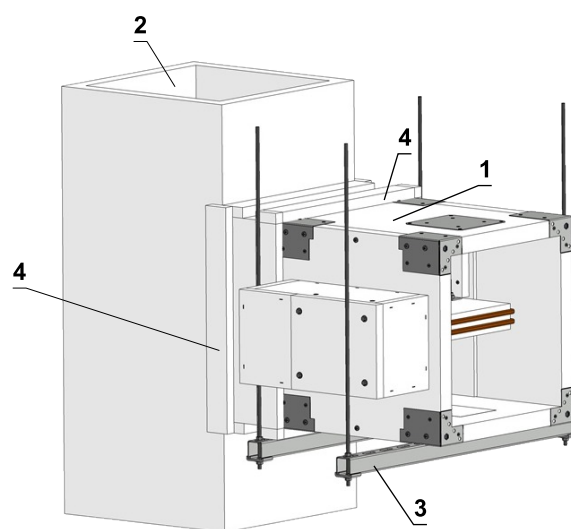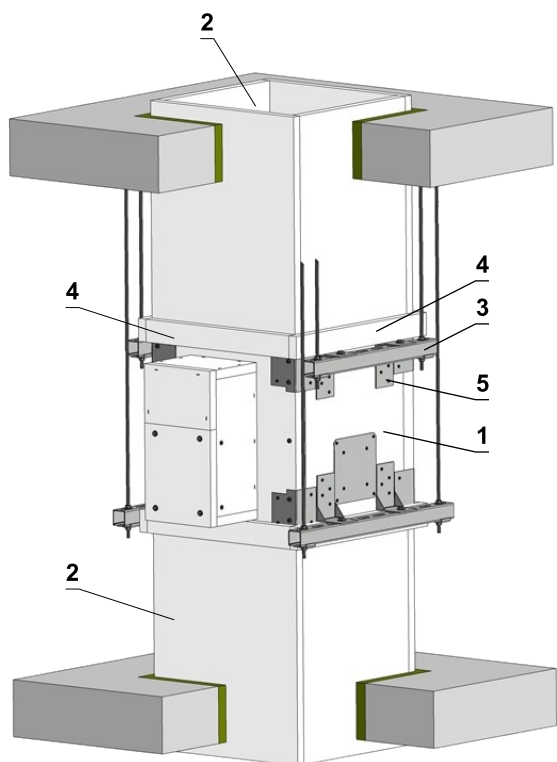

- 1 SEDM
- 2 Smoke extraction duct
- 3 Profile with threaded rod → see page 51
- 4 Insulating connecting strip
- 5 L-holder → see page 53

Installation of the damper into/onto horizontal duct made of fire-resistant boards for smoke extraction

- The dampers and duct must be suspended separately.
- Number of L-holders and their placement, acc. to AxB dimension → see page 53
- Examples of anchors to the fire dividing construction → see pages 51 to 56
- For connection of following duct → see pages 57 to 61

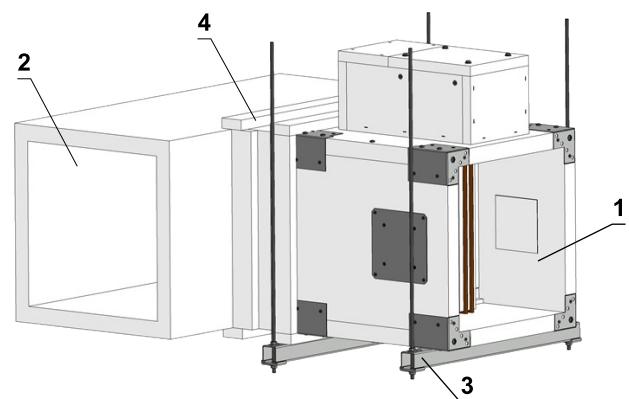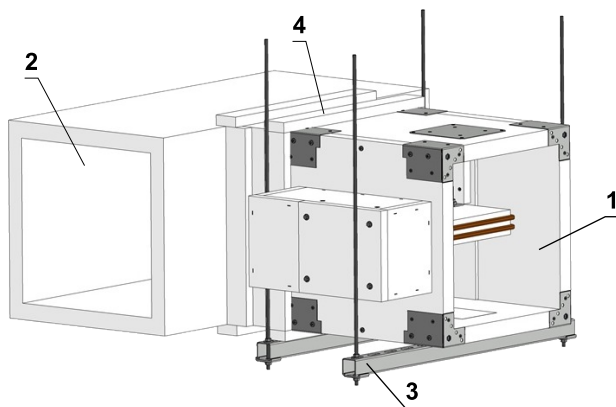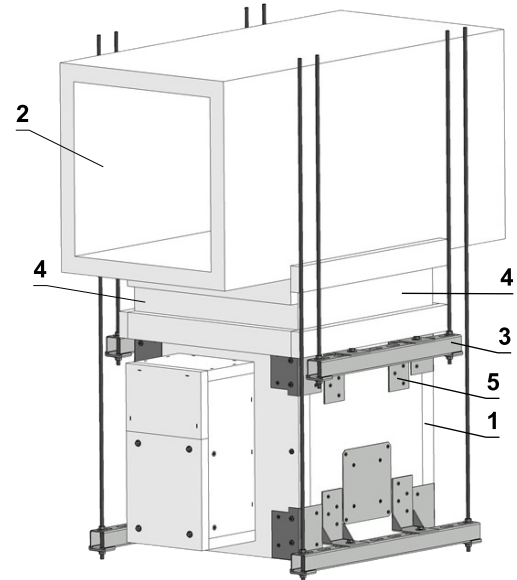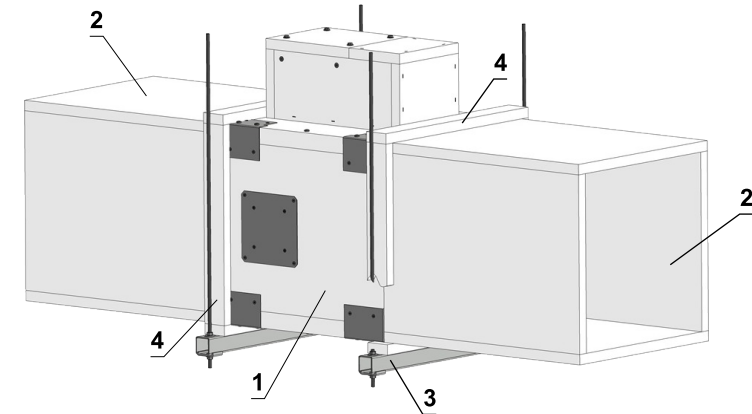


- 1 SEDM
- 2 Smoke extraction duct
- 3 Profile with threaded rod → see page 51
- 4 Insulating connecting strip
- 5 L-holder → see page 53

# V. SUSPENSION SYSTEMS



## Mounting to the ceiling wall

- The dampers must be suspended using threaded rods and mounting profiles. Their dimensioning depend on the weight of the damper.
- The dampers and the duct must be suspended separately.
- Following air-conditioning duct must be suspended or supported so that all load transfer from the following duct to the damper flanges is absolutely excluded. Adjacent duct must be suspended or supported, as required by the duct suppliers.
- Threaded rods longer than 1,5 m must be protected by fire insulation.

### Examples of anchoring to the ceiling construction Follow the instructions of fixing specialist or installation company

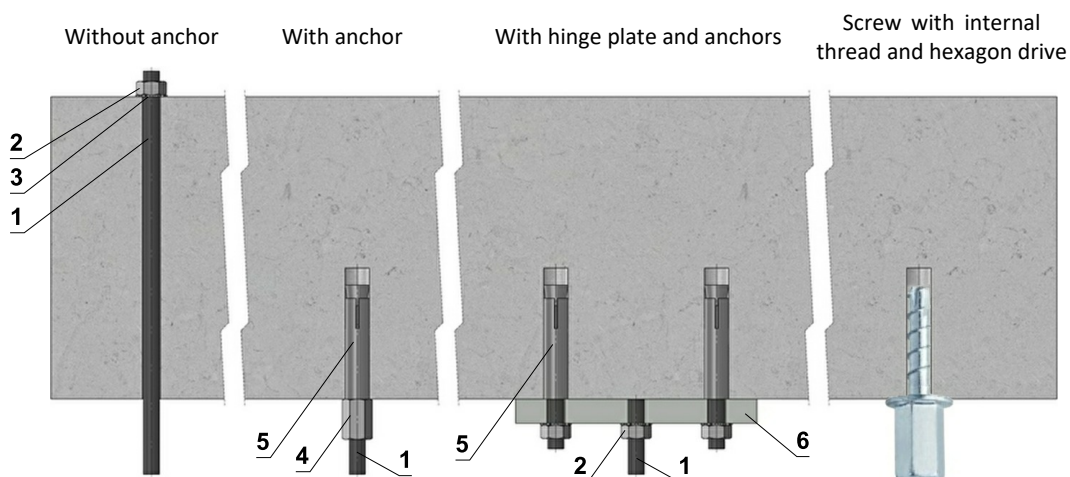

Hinge plates

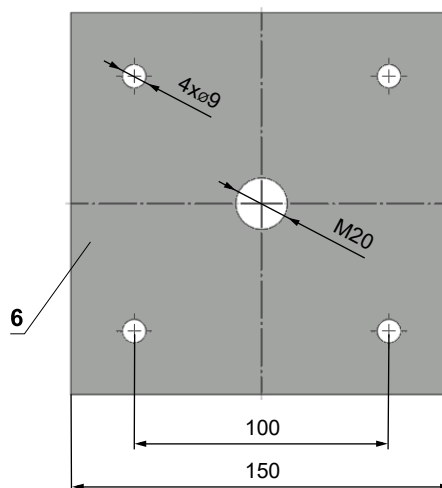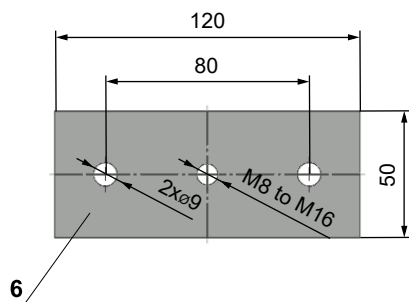




- If in doubt, always consult an anchor specialist engineer such as Halfen or Hilti.

#### Load capacities of threaded rods at the required fire resistance 60 min. <math>t \le 120 \text{ min.}</math>

Size	As [mm <sup>2</sup> ]	Weight [kg]	
		for 1 rod	for 2 rods
M8	36,6	22	44
M10	58	35	70
M12	84,3	52	104
M16	157	96	192
M18	192	117	234
M20	245	150	300

- 1 Threaded rod M8 - M20
- 2 Nut M8 - M20
- 3 Washer for M8 - M20
- 4 Coupling Nut M8 - M20
- 5 Anchor
- 6 Hinge plate - min. thickness 10 mm
- 7 Concrete screw tested for fire resistance R30-R90, max. Tension up to 0.75 KN (length 35 mm)


Example of placing of mounting profiles HILTI

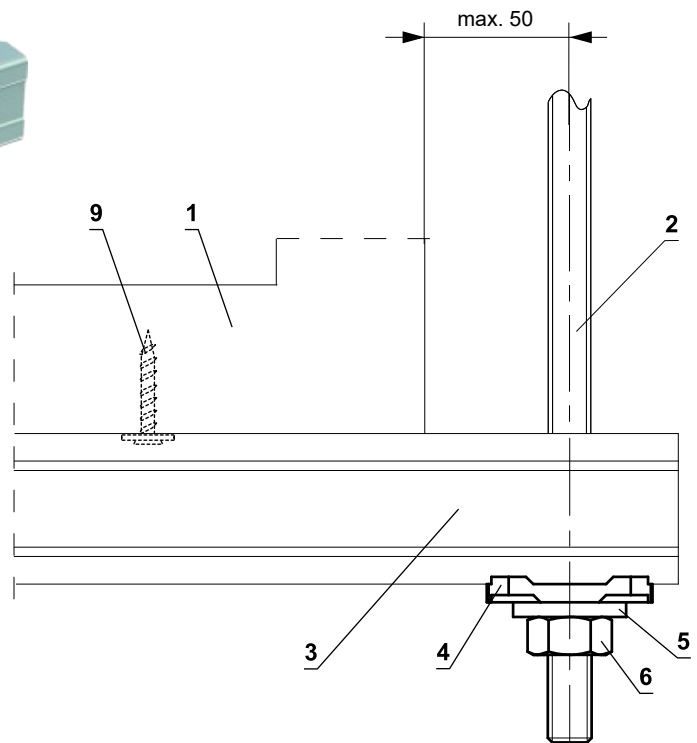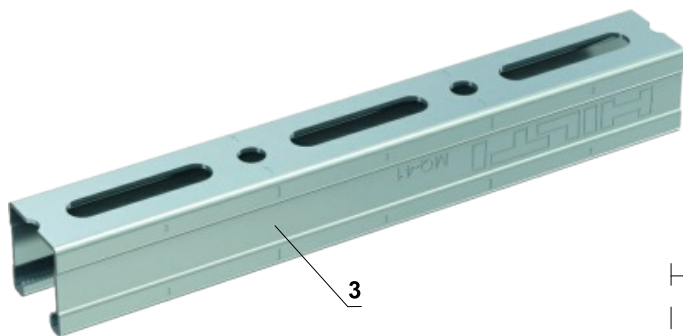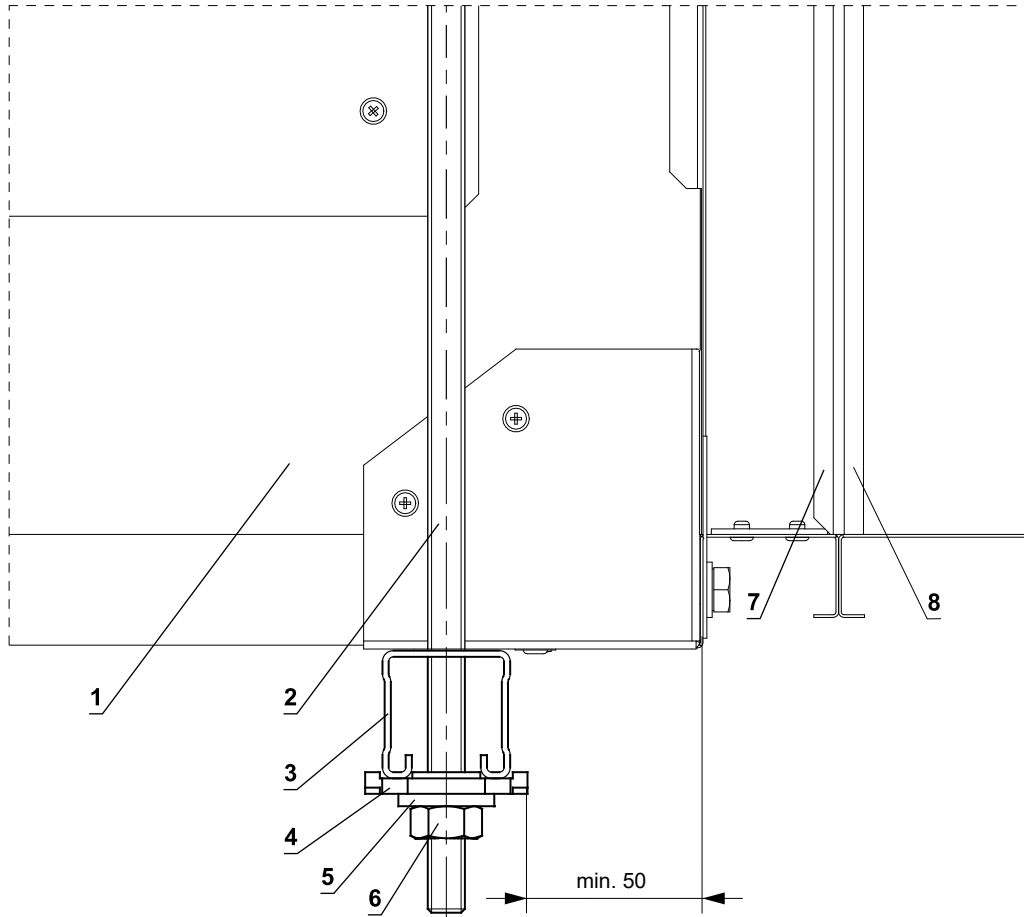


- 1 SEDM
- 2 Threaded rod M8 - M12
- 3 Support HILTI MQ-41 or MQ-41/3
- 4 Bored plate HILTI MQZ-L
- 5 Washer for M8 - M12
- 6 Nut M8 - M12
- 7 Flange of SEDM
- 8 Flange of duct
- 9 Self-tapping screw 5x30 mm and 1 pcs large washer M5 (for additional fixing, prevents the damper from sliding off the support - not necessary use)

Fixing SEDM according to size, with L-holder - fixing on wall / ceiling


FOR:  $A < 500$   
 $B < 500$

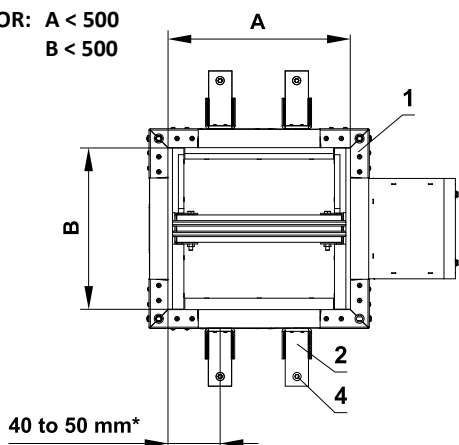

FOR:  $A < 500$   
 $B \geq 500$

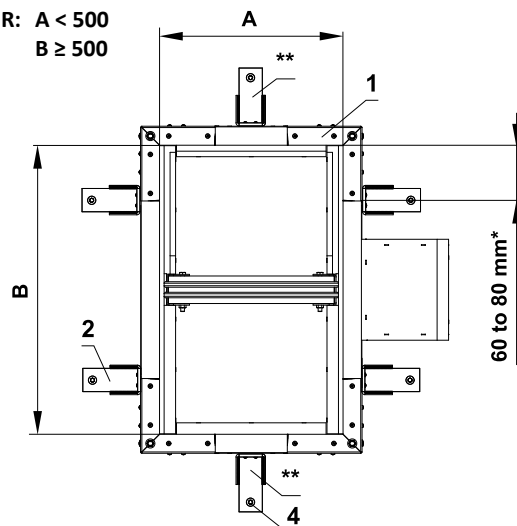


FOR:  $A \geq 500$   
 $B \geq 500$

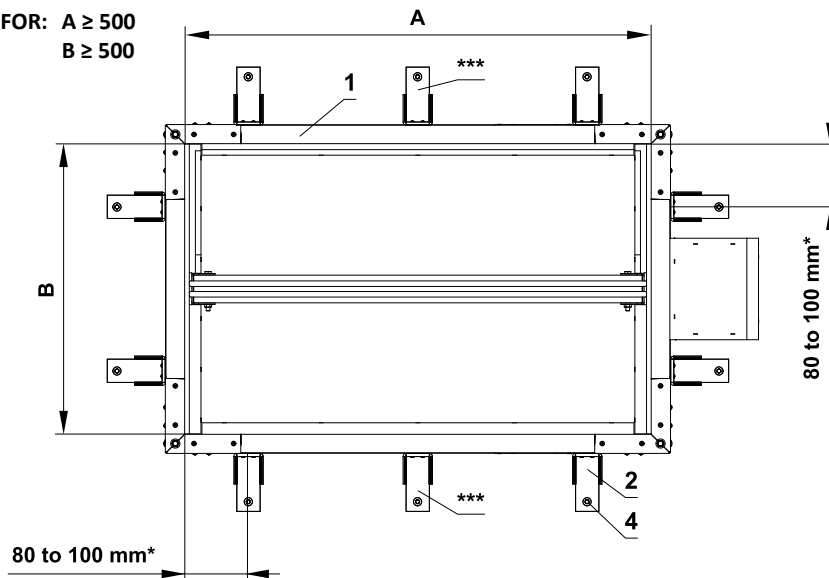




- \* From inner edge of the damper to the center of the holder, on both sides / opposite sides (mirrored)
- \*\* 1 holder to CENTER damper part "A" and on opposite sides (mirrored)
- \*\*\* In case of  $A \geq 1000$ , add holders to the center of the "A" side.

L-holder for connecting damper on the wall / ceiling (optional accessories MANDIK, a.s.)

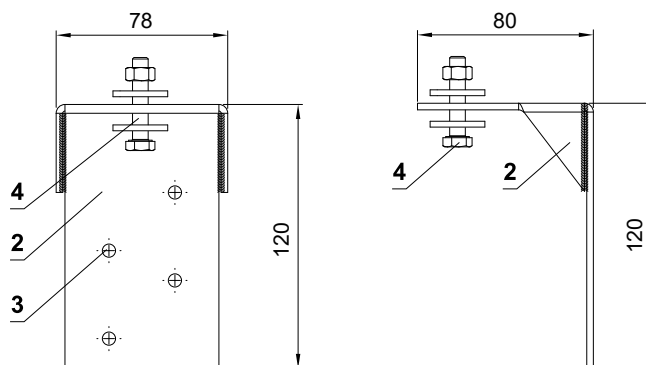


- 1 SEDM
- 2 L-holder - optional accessories from MANDIK, a.s.
- 3 Holes for screw UNI min. 5x30 mm for fastening L-holder to damper body
- 4 M8 bolt assembly (bolt min. M8x60 mm, 2 pcs large washer M8, nut M8) or Anchor to concrete, → see page 51

Fixing SEDM according to size - fixing to solid / gypsum or ceiling construction

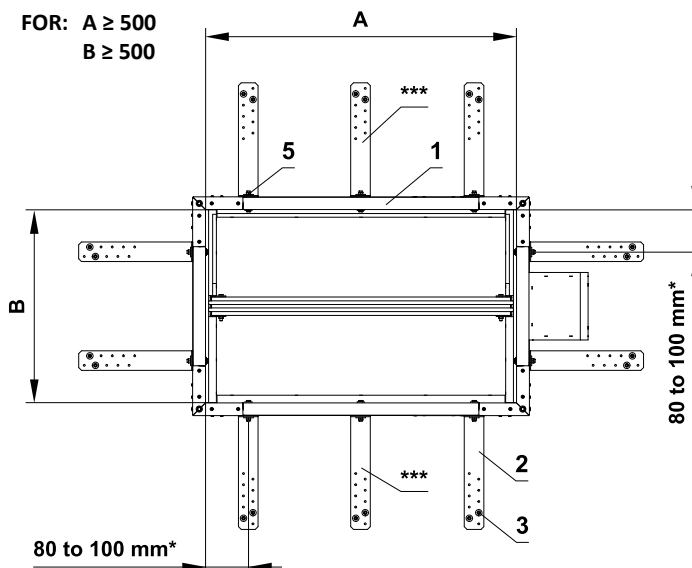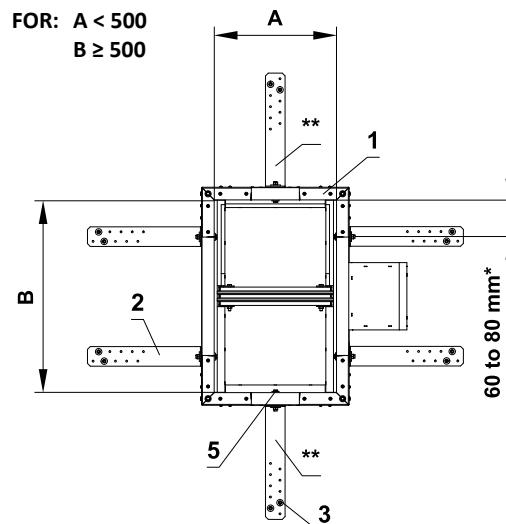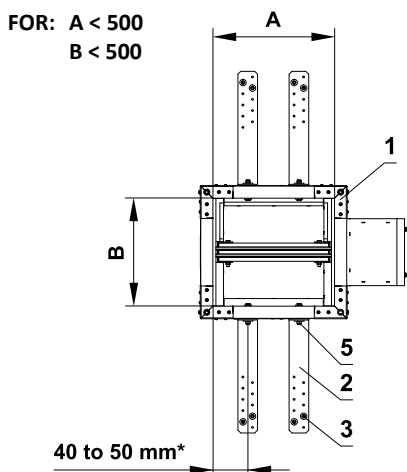

- \* From inner edge of the damper to the center of the holder, on both sides / opposite sides (mirrored)
- \*\* 1 holder to CENTER damper part "A" and on opposite sides (mirrored)
- \*\*\* In case of  $A \geq 1000$ , add holders to the center of the "A" side.



Fixing element/steel holder for connecting damper to the construction (optional accessories MANDIK, a.s.)

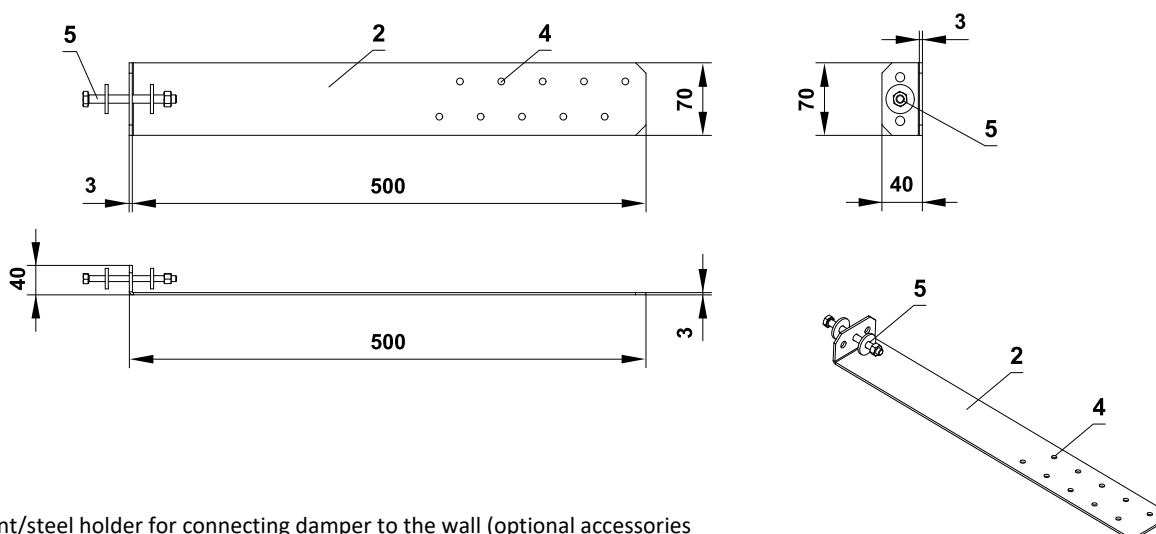

- 1 SEDM
- 2 Fixing element/steel holder for connecting damper to the wall (optional accessories MANDIK, a.s. or sheet metal min. thickness 2 mm and min. width 60 mm)
- 3 Anchor to concrete min. M6 or Screw UNI 6x60 mm to Gypsum grid from "C" profile
- 4 Installation holes
- 5 M8 bolt assembly (bolt M8x55 mm, 2 pcs large washer M8, nut M8)

■ Details of fixing the holder to the construction → see pages 55 to 56

Fixing SEDM to the solid (ceiling) wall construction with Ablative Coated Batt

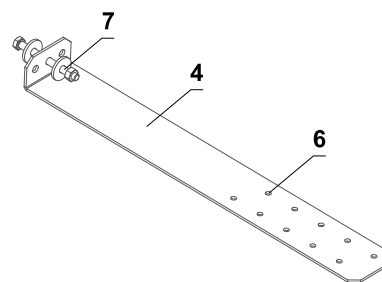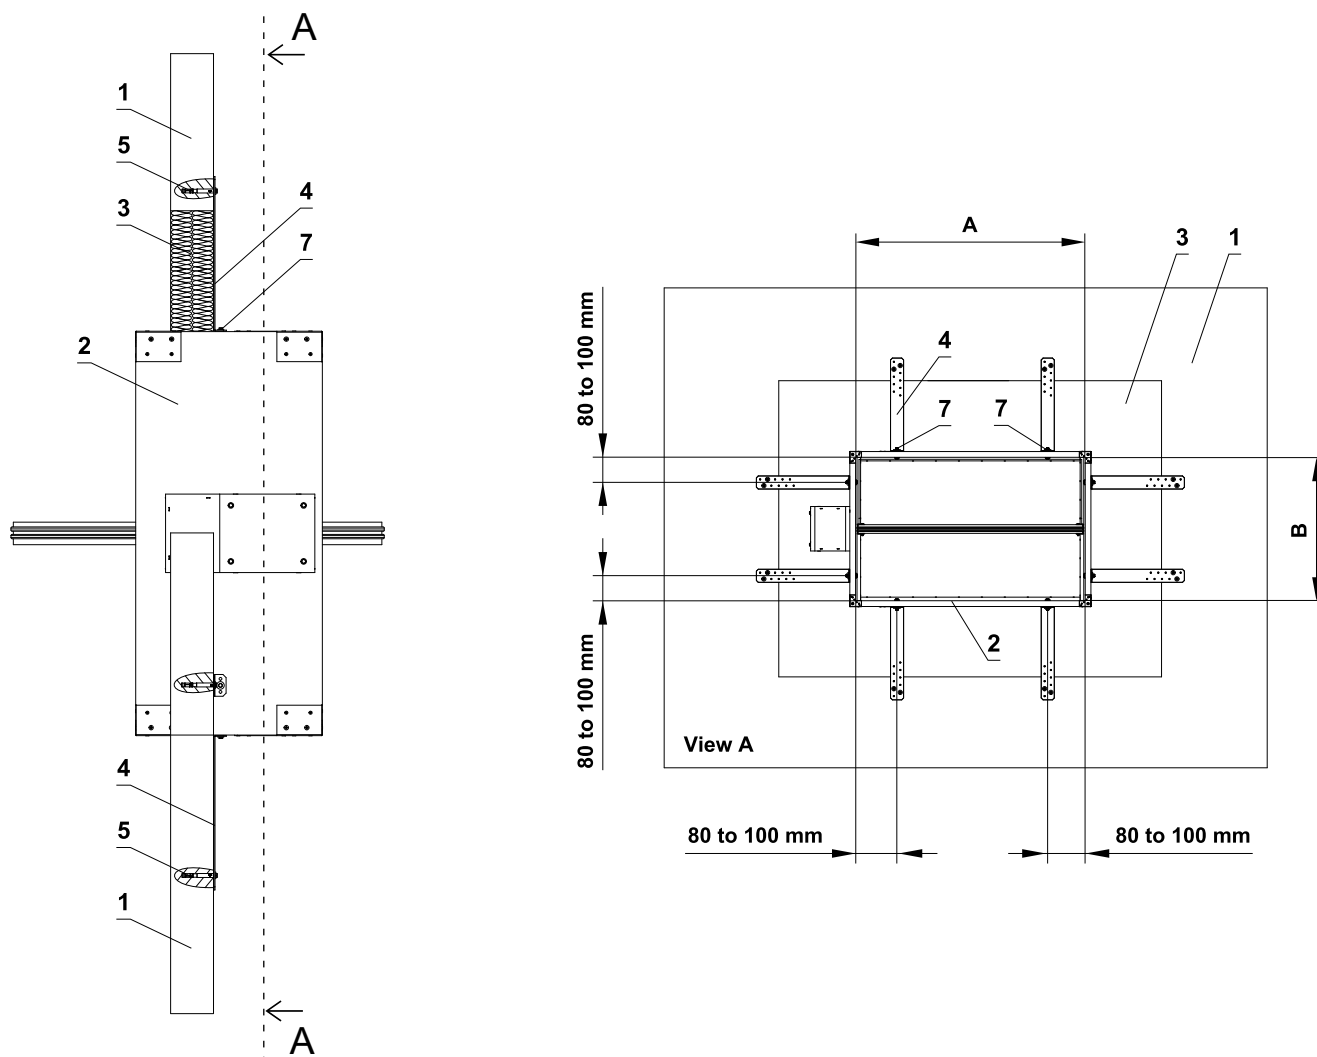


**\* RESPECT JOINT POSITION !**

Bolts and nuts shall not prevent free rotation on the blades.

- 1 Solid wall construction
- 2 SEDM
- 3 Ablative Coated Batt
- 4 Fixing element/steel bracket for connecting damper to the wall (optional accessories MANDIK, a.s. or sheet metal min. thickness 2 mm and min. width 60 mm). Full drawing of bracket, → see page 54
- 5 Anchor to concrete min. M6
- 6 Installation holes
- 7 M8 bolt assembly (bolt M8x55 mm, 2 pcs large washer M8, nut M8) \*

- The method of mounting must meet the minimum requirements for attachment in accordance with national regulations.


Fixing SEDM to the gypsum wall construction with Ablative Coated Batt

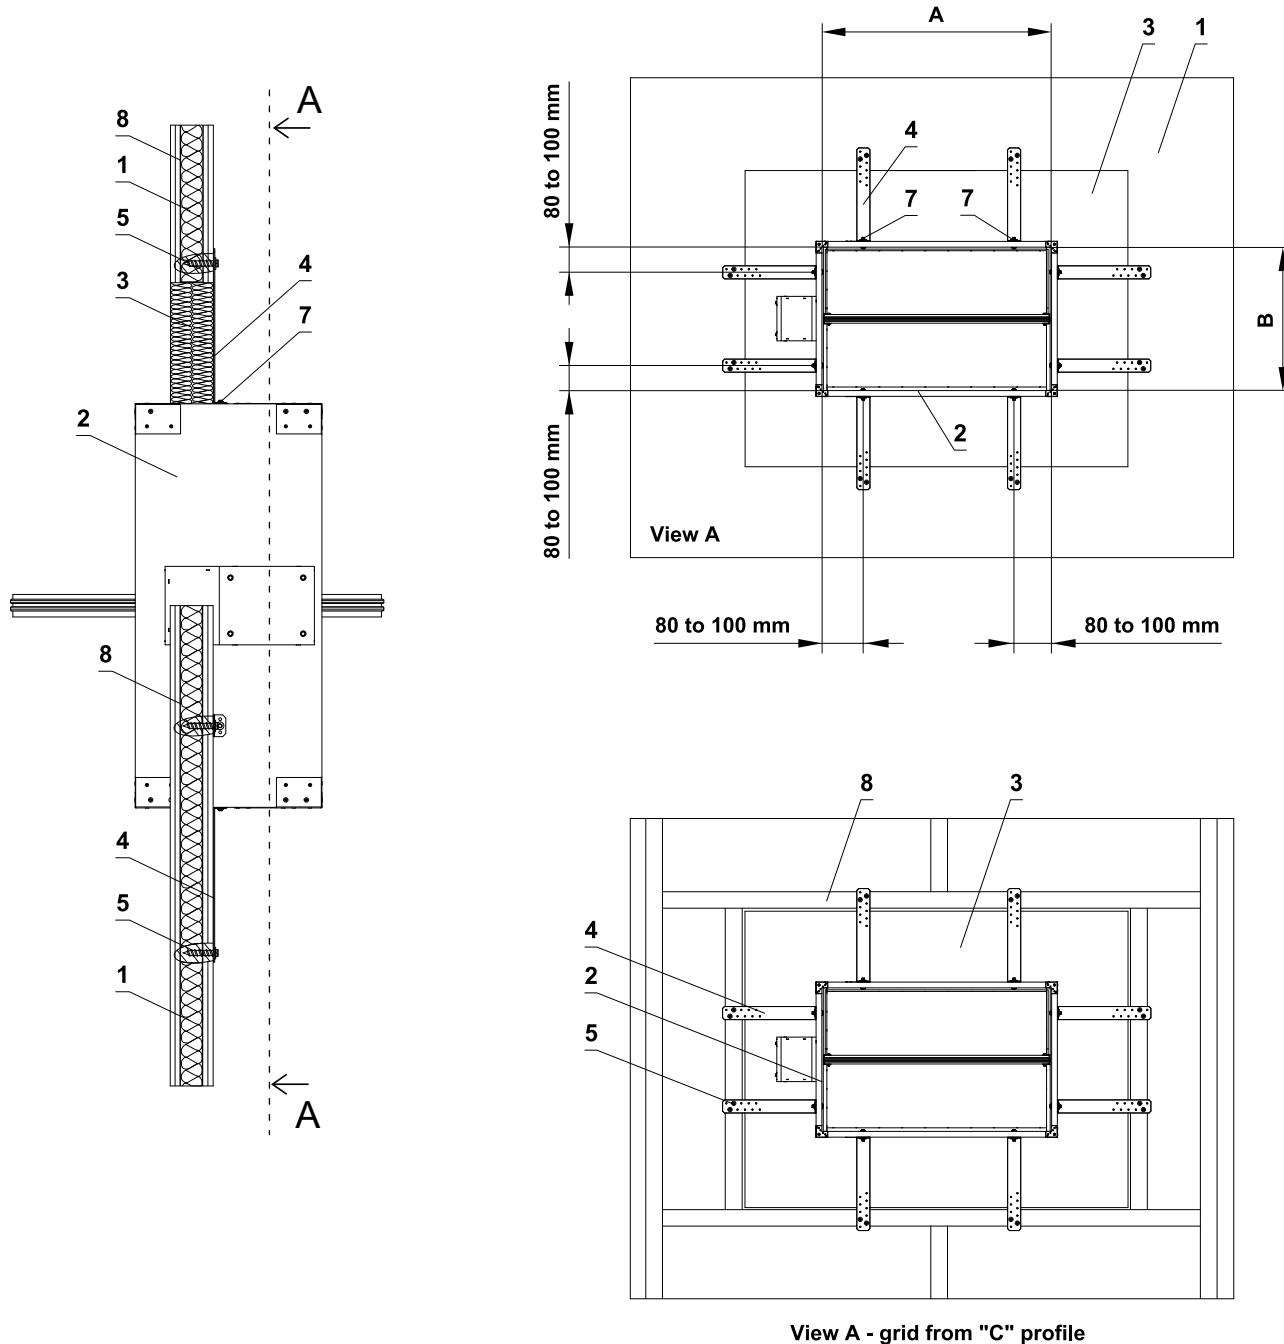

**\* RESPECT JOINT POSITION !**

Bolts and nuts shall not prevent free rotation on the blades.

- 1 Gypsum wall construction
- 2 SEDM
- 3 Ablative Coated Batt
- 4 Fixing element/steel bracket for connecting damper to the wall (optional accessories MANDIK, a.s. or sheet metal min. thickness 2 mm and min. width 60 mm). Full drawing of bracket, → see page 54
- 5 Screw UNI 6x60 mm
- 6 Installation holes
- 7 M8 bolt assembly (bolt M8x55 mm, 2 pcs large washer M8, nut M8) \*
- 8 Gypsum grid from "C" profile

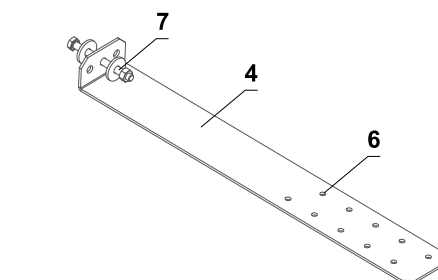


■ The method of mounting must meet the minimum requirements for attachment in accordance with national regulations.




### Example of duct connection


Connection to smoke extract duct acc. to EN 1366-8 (MULTI) / to EN 1366-9 (SINGLE)

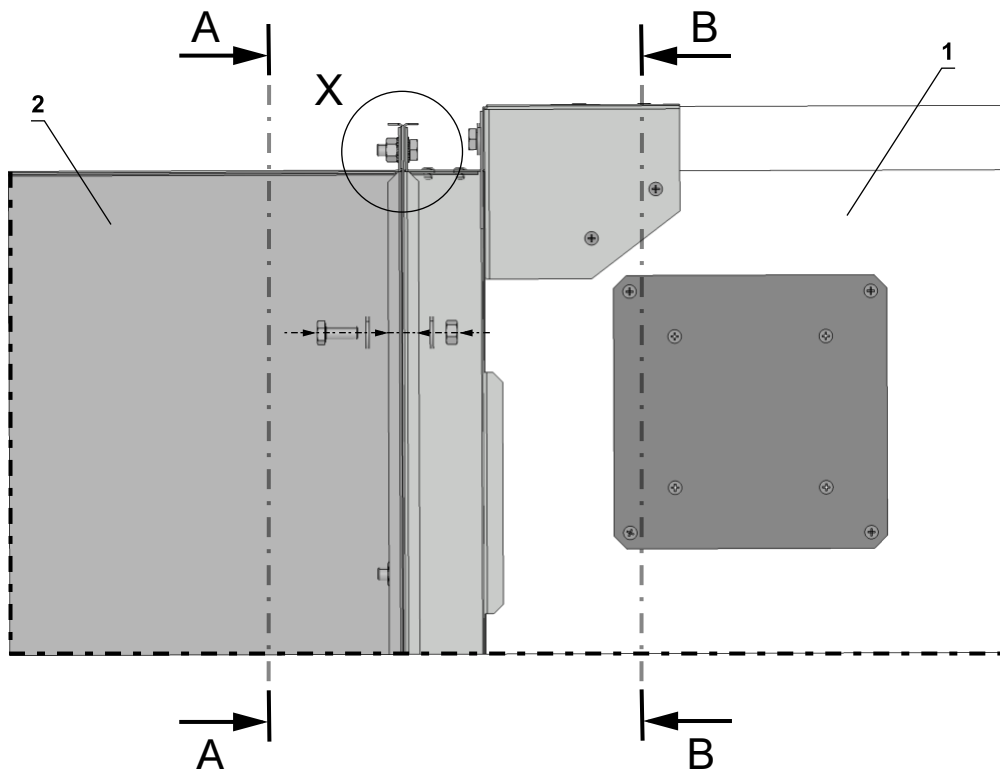


A-A

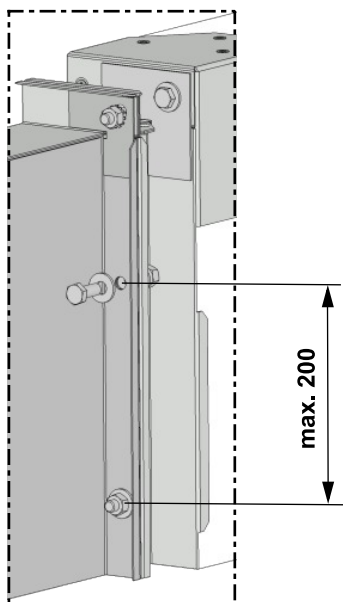

B-B

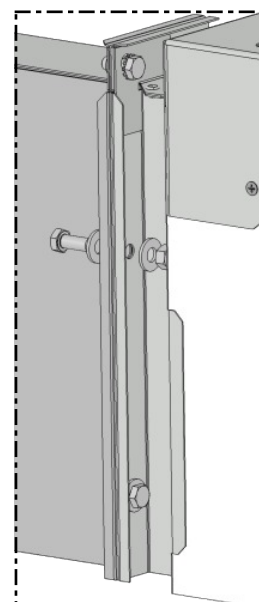

Electrically conductive connection



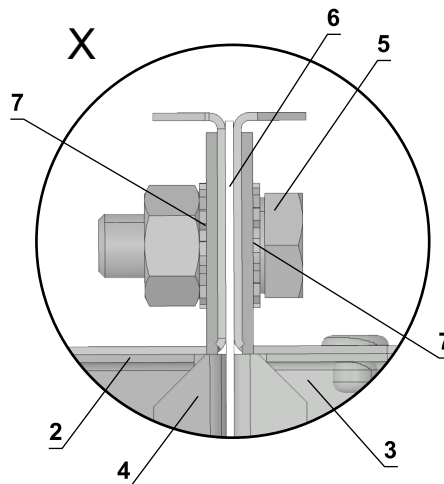


- 1 SEDM
- 2 Smoke extraction duct - tested according to EN 1366-8 or EN 1366-9
- 3 Flange of SEDM
- 4 Flange of duct
- 5 M8 bolt assembly (bolt M8x20 mm, 2 pcs large washer M8, nut M8) \*
- 6 Ceramic self-adhesive tape (FJ 120 Pyrosil B 170-250 kg/m<sup>3</sup> - Tremco-illbruck) or equivalent
- 7 Lock washers M8

\* min. one connection must be electrically conductive

**Example of connection SEDM damper in steel duct with insulation ROCKWOOL FIREPRO DuctRock Slab**

- Connect the joints of stone wool plates with ROCKWOOL FIREPRO Glue, secure with screws and welding pins at max. spacings of 250 mm. Board joints must be covered using ROCKWOOL black aluminium foil tape. Follow duct supplier's instructions and insulation.

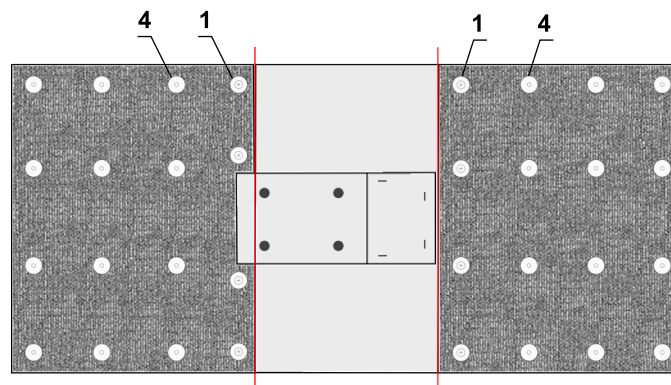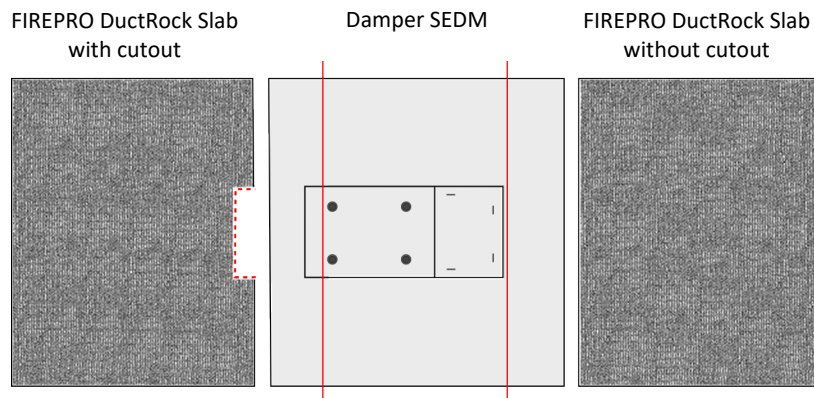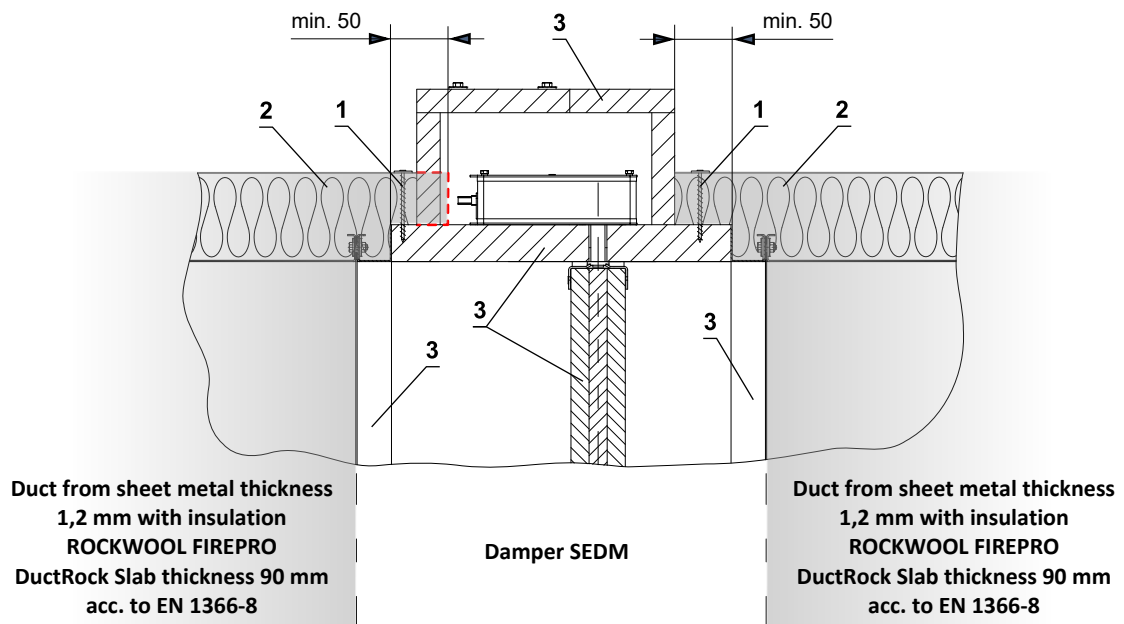


- 1 Universal screw min. 5x70 mm, max. spacing 250 mm
- 2 ROCKWOOL FIREPRO DuctRock Slab th. 90 mm acc. to EN 1366-8
- 3 Part of SEDM
- 4 Welding pins at max. spacings of 250 mm



--- Insulation cut-out area around the actuator cover

**Example installed SEDM damper in fire separating construction and connection to steel duct with insulation ROCKWOOL FIREPRO DuctRock Slab**

- Connect the joints of stone wool plates with ROCKWOOL FIREPRO Glue, secure with screws and welding pins at max. spacings of 250 mm. Board joints must be covered using ROCKWOOL black aluminium foil tape. Follow duct supplier's instructions and insulation.

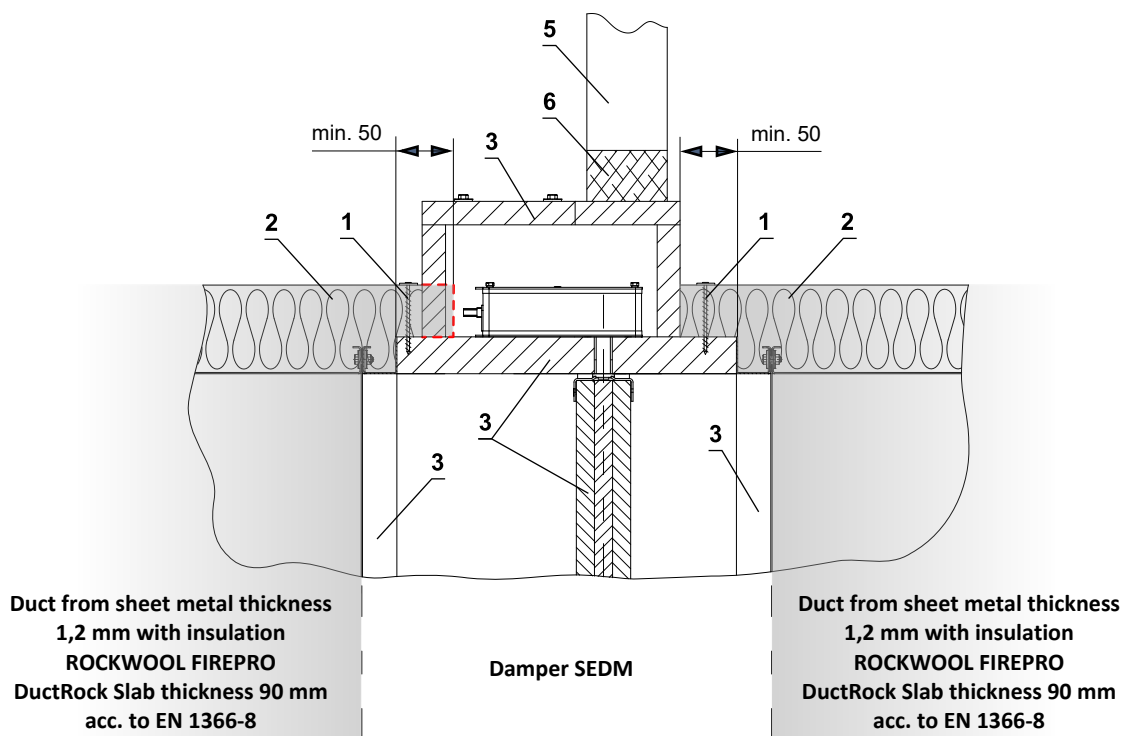


FIREPRO DuctRock Slab with cutout      Damper SEDM      FIREPRO DuctRock Slab without cutout

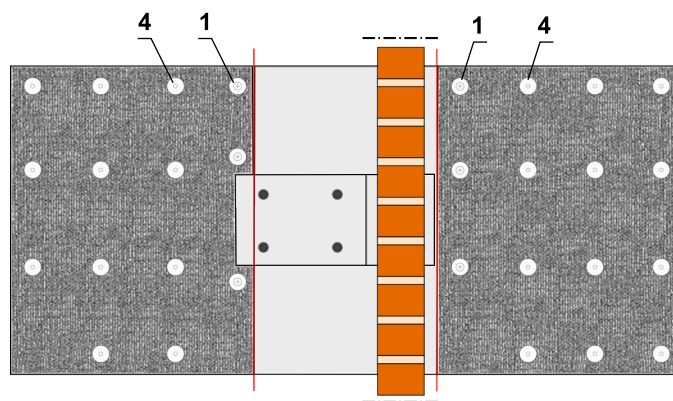
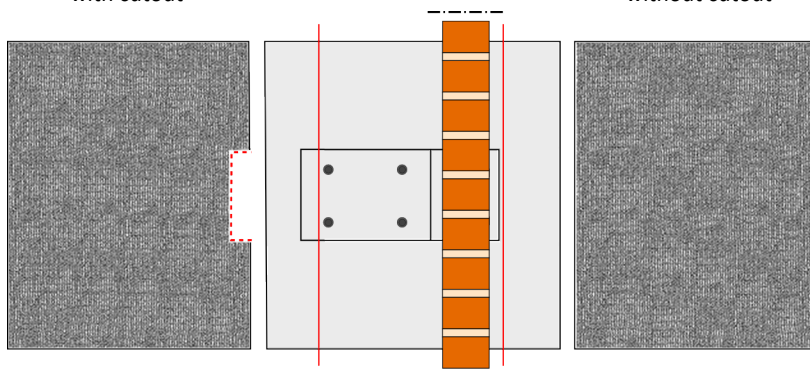



- 1 Universal screw min. 5x70 mm, max. spacing 250 mm
- 2 ROCKWOOL FIREPRO DuctRock Slab th. 90 mm acc. to EN 1366-8
- 3 Part of SEDM
- 4 Welding pins at max. spacings of 250 mm
- 5 Fire separating construction\*
- 6 Penetration

\* Same rules apply to mounting and connection in the ceiling construction

 Insulation cut-out area around the actuator cover



Example of connection SEDM damper in duct made of fire-resistant boards

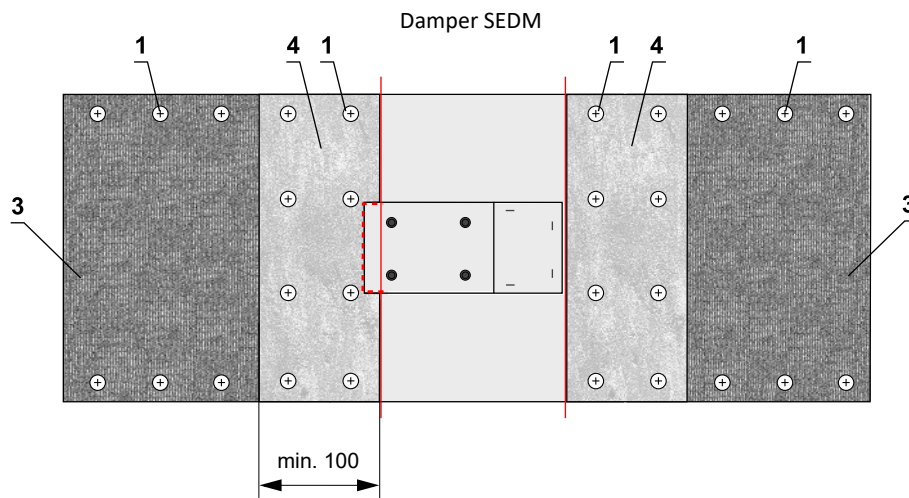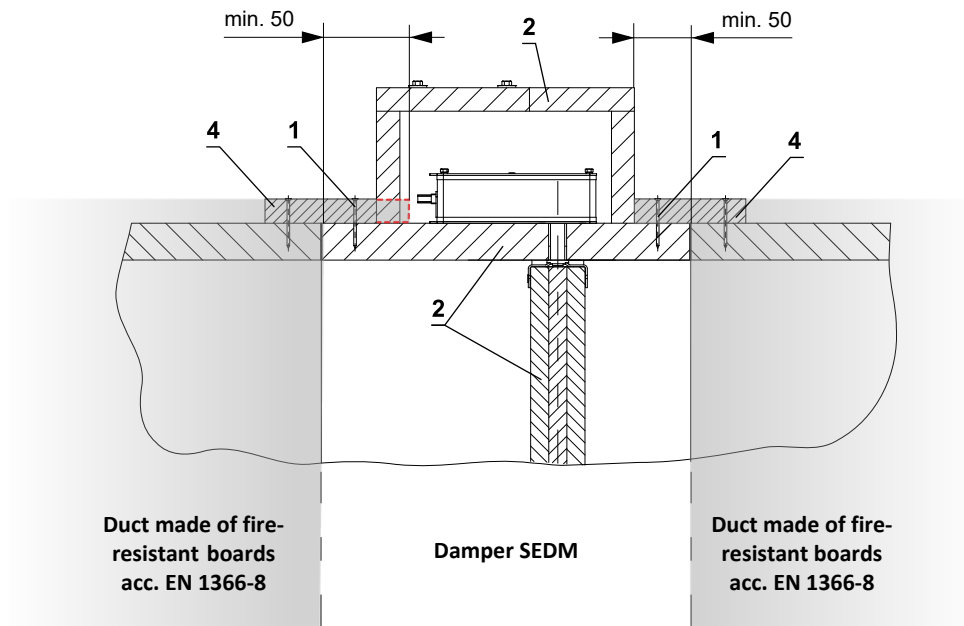


 Cut-out area of the connecting strip around the actuator housing

- 1 Screw (according to duct manufacturer)
- 2 Part of SEDM
- 3 Smoke extraction duct, min. density 500 kg/m<sup>3</sup> (e.g. PROMATECT-L500)
- 4 Spacing strip, min. density 500 kg/m<sup>3</sup> (e.g. PROMATECT-L500)

Example installed SEDM damper in fire separating construction and connection to duct made of fire-resistant boards

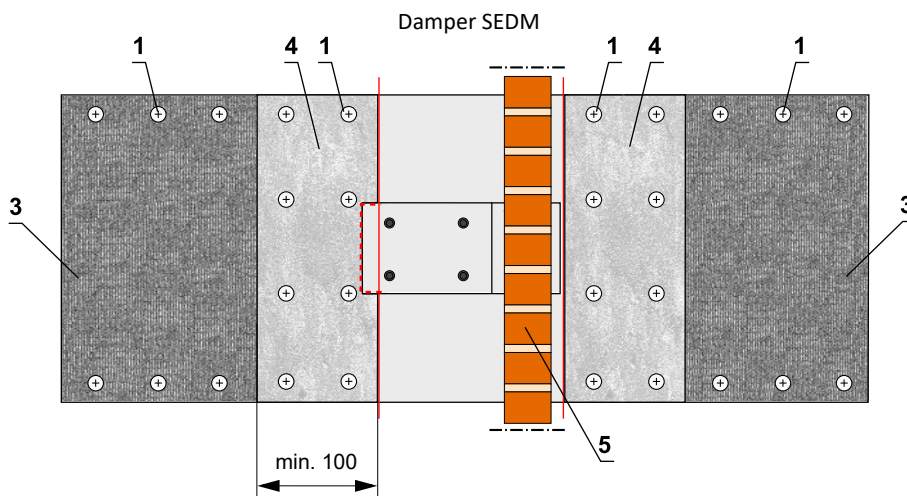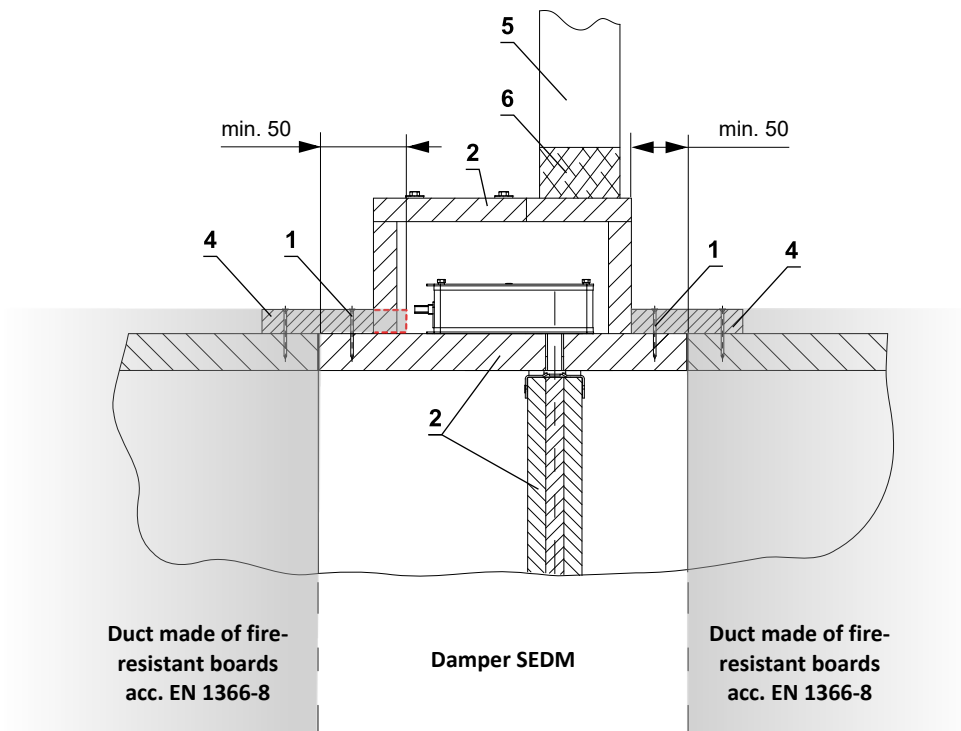

 Cut-out area of the connecting strip around the actuator housing

- 1 Screw (according to duct manufacturer)
- 2 Part of SEDM
- 3 Smoke extraction duct, min. density 500 kg/m<sup>3</sup> (e.g. PROMATECT-L500)
- 4 Spacing strip, min. density 500 kg/m<sup>3</sup> (e.g. PROMATECT-L500)
- 5 Fire separating construction\*
- 6 Penetration


\* Same rules apply to mounting and connection in the ceiling construction

## VI. ACCESSORIES


### Cover grille KMM

- The grilles type KMM (TPM 002/96) can be used to close smoke control dampers.
- For the installation of the grille, the overlap of the damper blade has to be respected → see pages 10 to 22. In case of blade overlap, the damper must be equipped with an extension piece ("duct").
- Free area value for KMM is 78%.
- These grilles are available in all sizes of the SEDM

#### SEDM with cover grille without flange

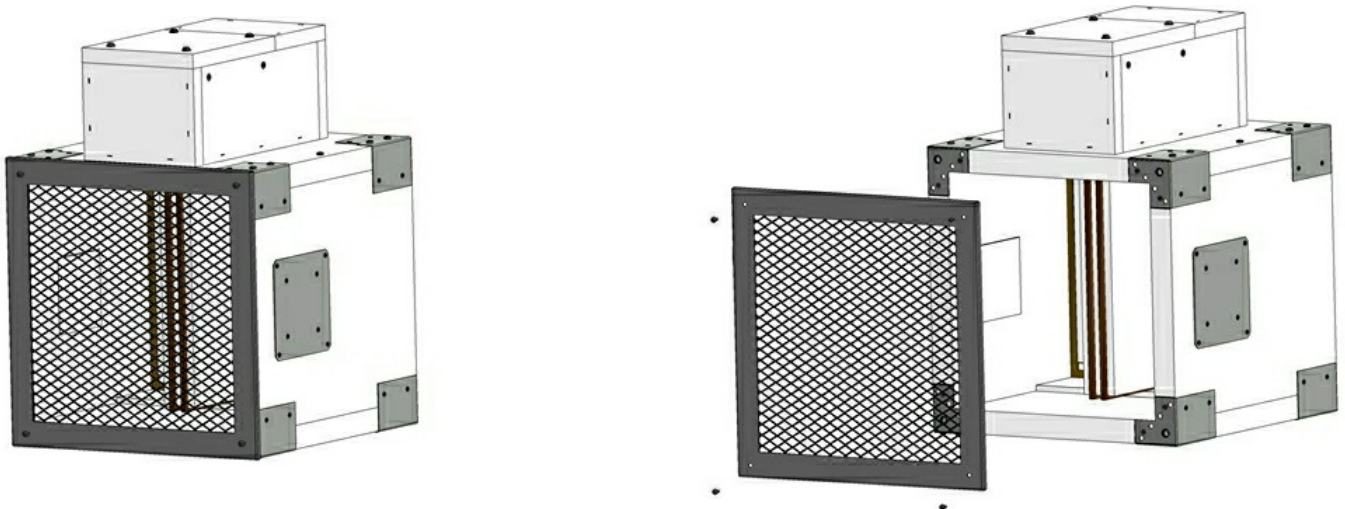

#### SEDM with cover grille and with flange

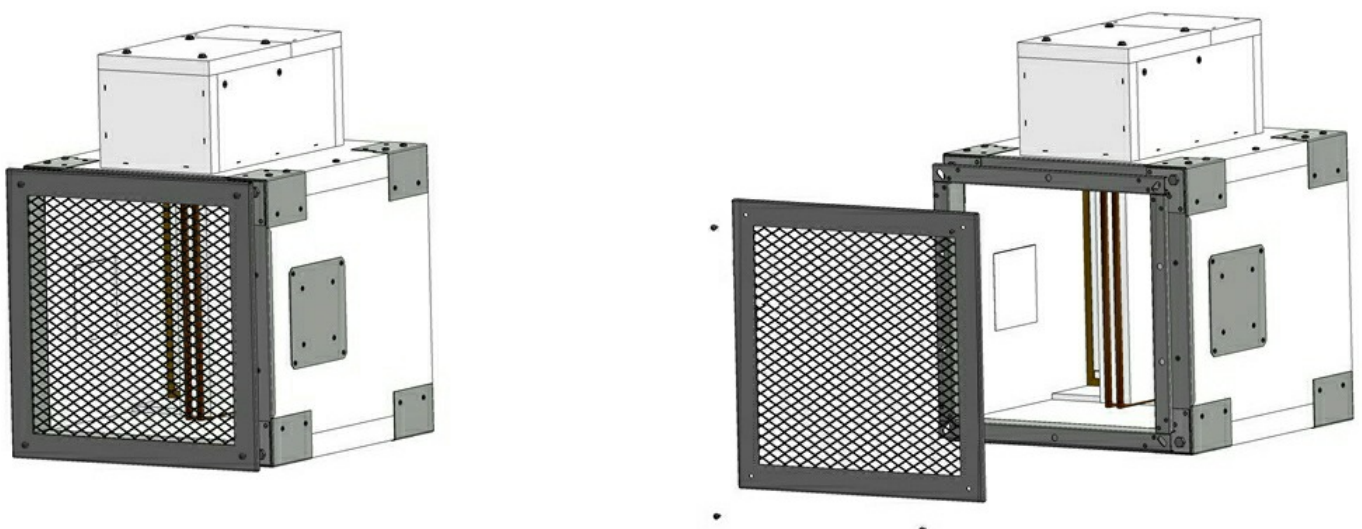

## VII. TECHNICAL DATA


### Pressure loss

#### Pressure loss calculation

$$\Delta p = \xi \cdot \rho \cdot \frac{w^2}{2}$$

$\Delta p$	[Pa]	pressure loss
$w$	[m/s]	air flow speed in nominal damper section
$\rho$	[kg/m <sup>3</sup> ]	air density
$\xi$	[-]	coefficient of local pressure loss for the nominal damper section → see page 64

#### Determination of pressure loss by using diagram $\rho = 1,2 \text{ kg/m}^3$

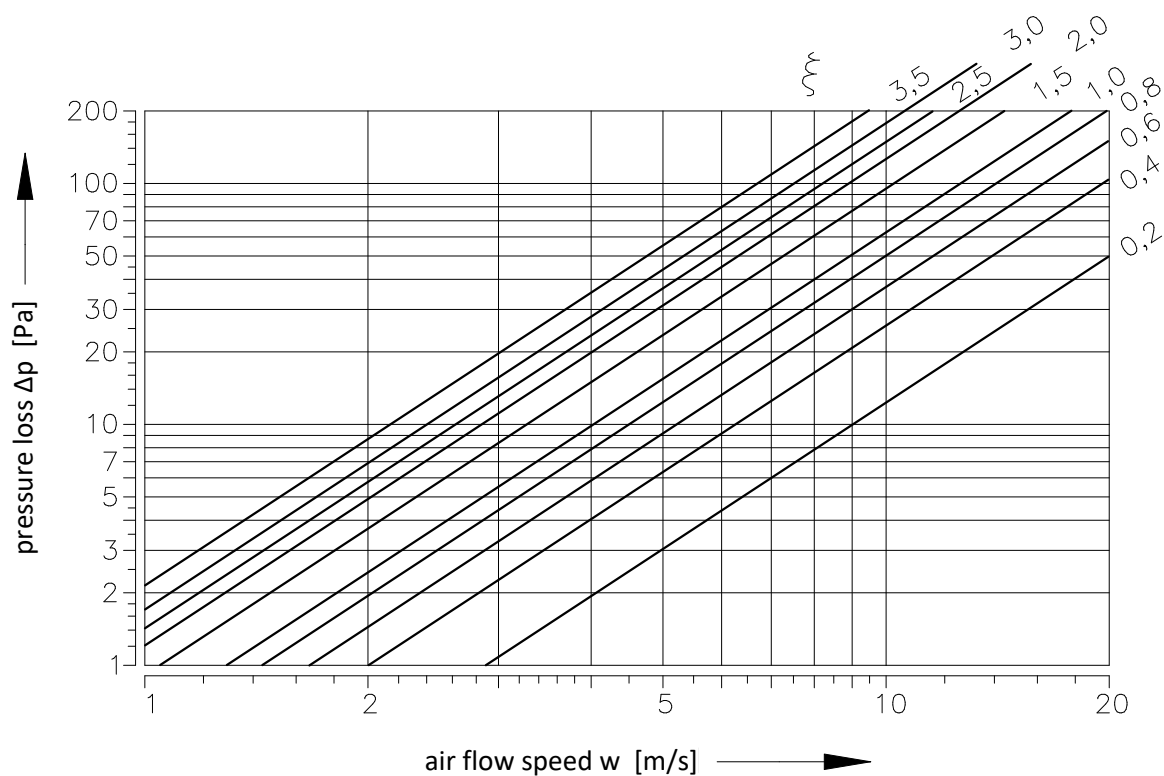

**Coefficient of local pressure loss**

<b>B</b>											
<b>A</b>	<b>180</b>	<b>200</b>	<b>225</b>	<b>250</b>	<b>280</b>	<b>300</b>	<b>315</b>	<b>355</b>	<b>400</b>	<b>450</b>	<b>500</b>
<b>180</b>	3,1433	2,5092	2,0162	1,6711	1,4773	1,3192	1,1951	1,0336	0,9095	0,8126	0,7429
<b>200</b>	2,9529	2,3545	1,9584	1,5657	1,3991	1,2512	1,1186	0,9673	0,8500	0,7582	0,6919
<b>225</b>	2,7795	2,2032	1,8326	1,4909	1,3226	1,1594	1,0438	0,9231	0,8143	0,7157	0,6562
<b>250</b>	2,6401	2,1012	1,7204	1,3923	1,2172	1,0795	0,9911	0,8568	0,7514	0,6698	0,6120
<b>280</b>	2,5721	2,0417	1,6677	1,3413	1,1577	1,0506	0,9333	0,8313	0,7242	0,6375	0,5984
<b>300</b>	2,5075	1,9822	1,5725	1,2784	1,1373	1,0081	0,9078	0,8075	0,7055	0,6239	0,5627
<b>315</b>	2,4055	1,9108	1,5283	1,2376	1,0897	0,9843	0,8806	0,7752	0,6800	0,6052	0,5525
<b>355</b>	2,3103	1,8343	1,4552	1,2121	1,0676	0,9265	0,8602	0,7412	0,6511	0,5797	0,5287
<b>400</b>	2,2304	1,7697	1,3787	1,1679	1,0217	0,9044	0,8279	0,7140	0,6256	0,5576	0,5083
<b>450</b>	2,1607	1,7153	1,3413	1,1305	1,0013	0,8823	0,8007	0,6902	0,6052	0,5389	0,4913
<b>500</b>	2,1080	1,6711	1,3362	1,1016	0,9452	0,8483	0,7633	0,6715	0,5882	0,5236	0,4777
<b>550</b>	2,0723	1,6507	1,2971	1,0829	0,9231	0,8194	0,7514	0,6613	0,5797	0,5185	0,4726
<b>560</b>	2,0587	1,6320	1,2886	1,0744	0,9061	0,8211	0,7429	0,6545	0,5729	0,5100	0,4658
<b>600</b>	2,0247	1,6116	1,2801	1,0659	0,8959	0,8041	0,7327	0,6443	0,5627	0,5066	0,4590
<b>630</b>	2,0128	1,5946	1,2733	1,0489	0,8857	0,7871	0,7259	0,6392	0,5593	0,4981	0,4539
<b>650</b>	2,0043	1,5742	1,2546	1,0421	0,8687	0,7786	0,7225	0,6324	0,5559	0,4947	0,4505
<b>700</b>	1,9873	1,5674	1,2512	1,0319	0,8517	0,7701	0,7157	0,6290	0,5508	0,4913	0,4471
<b>710</b>	1,9720	1,5623	1,2274	1,0268	0,8534	0,7548	0,7089	0,6256	0,5474	0,4879	0,4437
<b>750</b>	1,9567	1,5419	1,2172	1,0183	0,8483	0,7497	0,6987	0,6188	0,5406	0,4845	0,4386
<b>800</b>	1,9380	1,5351	1,2087	1,0081	0,8432	0,7446	0,6953	0,6137	0,5372	0,4777	0,4352
<b>900</b>	1,9074	1,5096	1,2053	0,9911	0,8228	0,7259	0,6834	0,6035	0,5270	0,4692	0,4284
<b>1000</b>	1,8836	1,4909	1,2002	0,9792	0,7939	0,7106	0,6749	0,5950	0,5202	0,4641	0,4216
<b>1100</b>	1,8615	1,4739	1,1917	0,9673	0,7752	0,7004	0,6664	0,5865	0,5134	0,4573	0,4165
<b>1250</b>	1,8428	1,4569	1,1781	0,9554	0,7735	0,6987	0,6579	0,5814	0,5083	0,4522	0,4114
<b>1400</b>	1,8241	1,4433	1,1696	0,9469	0,7718	0,6970	0,6511	0,5746	0,5032	0,4471	0,4080
<b>1500</b>	1,8139	1,4348	1,1611	0,9418	0,7684	0,6936	0,6477	0,5712	0,4998	0,4454	0,4046
<b>1600</b>	1,8054	1,4280	1,1169	0,9367	0,7667	0,6902	0,6443	0,5678	0,4981	0,4420	0,4029

<b>B</b>											
<b>A</b>	<b>550</b>	<b>560</b>	<b>600</b>	<b>630</b>	<b>650</b>	<b>700</b>	<b>710</b>	<b>750</b>	<b>800</b>	<b>900</b>	<b>1000</b>
<b>180</b>	0,6987	0,6800	0,6477	0,6273	0,5984	0,5933	0,5831	0,5627	0,5474	0,5168	0,4947
<b>200</b>	0,6545	0,6341	0,6052	0,5848	0,5627	0,5525	0,5440	0,5304	0,5100	0,4828	0,4607
<b>225</b>	0,6188	0,5916	0,5712	0,5559	0,5355	0,5287	0,5134	0,5032	0,4777	0,4556	0,4318
<b>250</b>	0,5882	0,5610	0,5372	0,5168	0,4998	0,4913	0,4862	0,4726	0,4488	0,4335	0,4063
<b>280</b>	0,5559	0,5304	0,5151	0,4947	0,4828	0,4794	0,4726	0,4471	0,4301	0,4216	0,3927
<b>300</b>	0,5321	0,5202	0,4947	0,4743	0,4675	0,4624	0,4573	0,4267	0,4182	0,4029	0,3808
<b>315</b>	0,5134	0,5049	0,4692	0,4658	0,4471	0,4386	0,4318	0,4097	0,4046	0,3825	0,3655
<b>355</b>	0,4896	0,4828	0,4556	0,4454	0,4318	0,4216	0,4131	0,3961	0,3876	0,3655	0,3485
<b>400</b>	0,4743	0,4641	0,4471	0,4284	0,4182	0,4097	0,3978	0,3842	0,3723	0,3519	0,3349
<b>450</b>	0,4556	0,4488	0,4352	0,4131	0,4046	0,3927	0,3842	0,3757	0,3587	0,3383	0,3230
<b>500</b>	0,4505	0,4369	0,4182	0,4012	0,3876	0,3791	0,3723	0,3587	0,3485	0,3298	0,3145
<b>550</b>	0,4437	0,4267	0,4148	0,3978	0,3808	0,3757	0,3655	0,3519	0,3451	0,3247	0,3111
<b>560</b>	0,4386	0,4250	0,4097	0,3910	0,3757	0,3723	0,3638	0,3451	0,3400	0,3213	0,3060
<b>600</b>	0,4369	0,4199	0,3978	0,3876	0,3672	0,3638	0,3587	0,3434	0,3366	0,3162	0,3026
<b>630</b>	0,4301	0,4148	0,3927	0,3825	0,3621	0,3570	0,3536	0,3417	0,3315	0,3128	0,2992
<b>650</b>	0,4267	0,4097	0,3927	0,3808	0,3604	0,3553	0,3502	0,3400	0,3298	0,3111	0,2975
<b>700</b>	0,4250	0,4080	0,3859	0,3791	0,3587	0,3536	0,3485	0,3383	0,3281	0,3077	0,2941
<b>710</b>	0,4216	0,4063	0,3808	0,3740	0,3570	0,3502	0,3468	0,3349	0,3247	0,3060	0,2924
<b>750</b>	0,4199	0,4029	0,3757	0,3706	0,3553	0,3468	0,3434	0,3315	0,3213	0,3026	0,2873
<b>800</b>	0,4182	0,3978	0,3757	0,3655	0,3536	0,3451	0,3400	0,3281	0,3179	0,2992	0,2856
<b>900</b>	0,4148	0,3910	0,3757	0,3604	0,3519	0,3417	0,3332	0,3179	0,3128	0,2941	0,2805
<b>1000</b>	0,4012	0,3859	0,3706	0,3553	0,3502	0,3349	0,3281	0,3145	0,3077	0,2907	0,2771
<b>1100</b>	0,3927	0,3808	0,3587	0,3502	0,3417	0,3298	0,3247	0,3094	0,3043	0,2856	0,2737
<b>1250</b>	0,3876	0,3757	0,3536	0,3451	0,3383	0,3281	0,3213	0,3077	0,2992	0,2822	0,2703
<b>1400</b>	0,3825	0,3723	0,3502	0,3417	0,3332	0,3264	0,3179	0,3043	0,2975	0,2805	0,2669
<b>1500</b>	0,3791	0,3706	0,3485	0,3400	0,3298	0,3247	0,3162	0,3026	0,2958	0,2788	0,2652
<b>1600</b>	0,3774	0,3672	0,3451	0,3383	0,3264	0,3230	0,3145	0,2992	0,2941	0,2771	0,2635



Noise data - level of acoustic output corrected with filter A

Air velocity 4 m/s Level of acoustic output [dB]																						
B																						
A	180	200	225	250	280	300	315	355	400	450	500	550	560	600	630	650	700	710	750	800	900	1000
180	56	49	48	46	44	42	41	41	40	40	40	40	40	40	40	40	40	38	38	37	38	38
200	52	48	45	44	41	41	41	41	40	40	39	39	39	38	38	38	37	37	37	36	37	37
225	50	47	45	40	40	40	41	40	39	39	39	38	38	36	36	37	37	36	36	36	36	36
250	49	45	44	42	40	40	40	39	38	38	37	37	37	37	37	37	37	37	37	36	36	36
280	47	45	40	40	40	39	38	37	37	37	37	37	37	36	36	36	36	36	36	36	35	35
300	47	44	40	40	39	39	39	37	36	37	37	37	37	35	35	35	35	35	35	36	36	36
315	47	44	40	40	39	39	37	37	37	36	36	36	36	36	36	36	36	35	35	35	34	34
355	46	43	40	39	39	37	37	36	36	36	36	35	35	35	35	35	35	35	33	34	35	35
400	47	42	40	39	37	37	36	36	36	35	35	35	35	35	35	35	34	34	34	34	33	33
450	45	42	40	39	37	37	37	36	35	35	35	35	35	35	35	35	35	35	34	34	34	34
500	45	40	39	38	37	36	36	36	35	35	35	34	34	33	33	34	34	34	33	33	33	33
550	44	40	40	38	37	37	36	36	35	35	34	34	34	34	34	33	33	33	33	33	33	33
560	44	40	40	38	37	37	36	35	35	35	34	34	34	34	34	34	33	33	33	33	33	33
600	44	40	38	36	36	36	36	36	35	35	35	35	35	33	33	33	33	32	32	32	32	32
630	44	40	38	37	36	36	36	35	35	35	34	34	34	34	34	34	33	33	33	33	32	32
650	44	40	38	37	36	36	36	35	35	35	34	34	34	34	34	34	33	33	33	33	33	33
700	43	39	38	38	36	36	36	37	35	36	34	34	34	34	34	33	33	33	33	33	33	33
710	43	39	38	38	36	36	36	37	35	36	34	34	34	34	34	33	33	33	33	33	33	33
750	43	40	38	37	36	35	35	34	34	34	34	34	33	33	33	33	33	33	33	33	33	33
800	43	40	37	37	36	36	35	34	34	34	34	33	33	33	33	33	33	33	33	33	33	33
900	43	40	37	36	36	36	35	34	34	34	34	33	33	33	33	33	33	33	33	33	33	33
1000	43	39	37	37	37	36	35	35	34	34	34	33	33	33	33	33	33	33	33	33	33	33
1100	42	39	37	37	37	35	35	34	34	34	33	33	33	33	33	33	33	33	32	32	32	32
1250	42	39	37	37	37	35	35	34	34	34	34	34	33	33	33	33	33	33	32	32	32	32
1400	42	39	37	37	37	35	35	34	34	34	33	33	33	33	33	33	33	33	32	32	32	31
1500	42	39	37	37	37	35	35	34	34	34	33	33	33	33	33	33	33	33	32	32	32	31
1600	42	39	37	37	37	35	35	34	34	34	33	33	33	33	33	33	33	33	32	32	32	31

**Air velocity 5 m/s  
Level of acoustic output [dB]**

B																						
A	180	200	225	250	280	300	315	355	400	450	500	550	560	600	630	650	700	710	750	800	900	1000
<b>180</b>	>55	55	53	52	49	47	48	47	47	47	46	46	46	46	46	45	45	45	45	45	45	45
<b>200</b>	>55	55	52	49	48	48	47	47	47	45	45	45	44	44	44	44	45	45	45	45	45	45
<b>225</b>	>55	54	50	48	47	47	47	45	44	44	44	44	44	44	44	44	44	44	44	44	44	43
<b>250</b>	>55	52	49	48	47	46	46	44	44	44	44	44	44	44	43	43	43	43	43	43	43	43
<b>280</b>	54	50	49	47	46	45	45	44	44	44	43	43	43	43	42	42	42	42	42	42	42	42
<b>300</b>	54	49	47	46	45	45	44	44	43	43	43	43	43	42	42	42	42	41	42	42	42	41
<b>315</b>	54	51	48	47	45	45	44	44	44	43	43	42	42	41	41	41	41	41	41	41	41	41
<b>355</b>	54	50	48	45	44	43	43	43	42	42	42	41	41	41	41	41	41	41	41	41	40	40
<b>400</b>	54	49	46	45	43	43	43	43	42	42	41	40	40	40	40	40	40	40	40	40	40	40
<b>450</b>	52	47	46	43	42	42	42	41	41	40	40	40	40	40	40	40	40	40	40	39	39	39
<b>500</b>	51	48	46	44	43	43	43	41	41	40	40	40	40	40	40	40	40	40	39	39	39	39
<b>550</b>	49	47	46	44	43	43	42	41	40	40	40	40	40	40	40	39	39	39	39	39	39	38
<b>560</b>	49	47	46	44	43	43	42	41	40	40	40	40	40	40	40	39	39	39	39	39	39	38
<b>600</b>	50	47	45	43	43	42	42	41	40	40	40	40	40	40	39	39	39	39	39	38	38	38
<b>630</b>	50	48	45	43	43	42	42	41	40	40	40	40	40	40	40	40	40	38	38	38	38	38
<b>650</b>	50	48	45	43	42	42	42	41	40	40	40	40	39	39	39	39	39	38	38	38	38	38
<b>700</b>	50	48	45	42	42	42	42	41	40	40	40	40	39	39	39	39	39	38	38	38	38	38
<b>710</b>	50	48	45	42	42	42	42	41	40	40	40	40	39	39	39	39	39	38	38	38	38	38
<b>750</b>	50	47	45	42	42	42	42	41	40	40	40	40	39	39	39	39	39	38	38	38	38	38
<b>800</b>	50	47	45	42	42	42	42	41	40	40	40	40	39	39	39	39	39	38	38	38	38	38
<b>900</b>	49	47	44	42	42	42	41	40	40	40	40	39	39	39	39	39	38	38	38	38	38	38
<b>1000</b>	49	47	43	42	42	42	40	40	40	40	40	39	39	39	39	38	38	38	38	38	38	38
<b>1100</b>	49	47	43	42	42	42	40	40	40	40	40	39	39	39	39	38	38	38	38	38	38	38
<b>1250</b>	49	47	43	42	42	42	40	40	40	40	39	39	39	39	38	38	38	38	38	38	38	38
<b>1400</b>	48	46	43	42	42	41	40	40	40	39	38	38	38	38	38	38	38	38	38	38	38	37
<b>1500</b>	48	46	43	42	41	41	40	40	40	39	38	38	38	38	38	38	38	38	38	38	38	37
<b>1600</b>	48	46	43	42	41	41	40	40	40	39	38	38	38	38	38	38	38	38	38	38	38	37

Air velocity 6 m/s  
Level of acoustic output [dB]

B																						
A	180	200	225	250	280	300	315	355	400	450	500	550	560	600	630	650	700	710	750	800	900	1000
180	>55	>55	>55	>55	55	54	54	54	54	52	52	52	52	52	52	52	52	52	51	51	51	51
200	>55	>55	>55	55	54	54	53	53	52	51	50	50	50	50	50	50	50	50	50	50	50	48
225	>55	>55	>55	54	52	52	52	51	50	50	49	48	48	48	48	48	48	48	48	48	47	47
250	>55	>55	55	53	52	52	51	50	50	49	48	48	48	47	47	47	47	47	47	47	47	47
280	>55	>55	54	52	51	50	50	49	48	48	48	47	46	46	46	46	46	46	46	46	46	46
300	>55	>55	54	52	50	50	50	48	47	47	46	46	46	46	46	46	46	46	46	46	47	45
315	>55	55	53	52	50	49	50	48	47	46	46	46	46	46	46	46	46	46	46	47	47	46
355	>55	55	53	51	50	49	48	47	47	46	46	46	46	46	46	46	46	46	46	46	46	46
400	>55	54	52	50	49	48	48	47	45	45	45	45	45	45	45	45	45	45	45	45	45	45
450	>55	54	51	50	48	48	47	46	45	45	45	45	45	45	45	45	45	45	45	45	45	45
500	55	54	51	49	48	48	47	45	45	45	45	45	45	45	45	45	45	45	45	45	45	43
550	55	53	50	50	48	47	45	45	45	45	45	45	45	45	45	45	45	45	45	45	44	44
560	55	53	50	50	48	47	45	45	45	45	45	45	45	45	45	45	45	45	45	45	44	44
600	55	53	50	50	48	47	45	45	45	45	45	45	45	44	44	44	44	44	44	44	44	44
630	55	53	50	49	48	47	45	45	45	45	45	45	44	44	44	44	44	44	44	44	44	44
650	55	52	50	49	48	47	45	45	45	45	45	45	44	44	44	44	44	44	44	43	43	43
700	55	52	50	48	48	46	46	45	45	45	45	45	44	44	44	44	44	44	44	43	43	43
710	55	52	50	48	48	46	46	45	45	45	45	45	44	44	44	44	44	44	44	43	43	43
750	55	52	50	48	48	46	45	45	45	45	45	45	44	44	44	44	44	44	44	43	43	43
800	55	52	50	48	48	46	45	45	45	45	45	45	44	44	44	44	43	43	43	43	43	43
900	55	52	49	48	47	45	45	45	45	45	45	44	43	43	43	43	43	43	43	43	43	43
1000	55	52	49	48	47	45	45	45	45	45	44	44	44	43	43	43	43	43	43	43	43	43
1100	54	52	49	48	46	45	45	45	45	44	44	44	44	43	43	43	43	43	43	43	43	43
1250	54	52	49	47	45	45	45	45	45	44	44	44	44	43	43	43	43	43	43	43	43	43
1400	54	52	48	48	46	44	44	44	45	44	43	43	43	43	43	43	43	43	43	43	43	42
1500	54	52	48	48	45	44	44	44	45	44	43	43	43	43	43	43	43	43	43	43	42	42
1600	54	52	48	48	45	44	44	45	45	45	43	43	43	43	43	43	43	43	43	42	42	42

Air velocity 7 m/s  
Level of acoustic output [dB]

B																						
A	180	200	225	250	280	300	315	355	400	450	500	550	560	600	630	650	700	710	750	800	900	1000
180	>61	>61	>61	>61	61	60	60	58	58	57	56	56	56	55	55	55	55	55	55	56	55	55
200	>61	>61	>61	>61	59	58	58	57	56	55	55	55	55	55	55	55	55	54	54	54	54	54
225	>61	>61	>61	60	57	56	56	55	55	55	54	54	53	53	53	53	53	53	53	53	53	53
250	>61	>61	>61	58	56	56	56	55	54	53	53	53	53	53	52	52	52	52	52	53	52	52
280	>61	>61	60	57	56	55	55	54	53	52	52	52	51	51	51	51	51	51	51	51	50	50
300	>61	61	58	57	55	54	54	53	53	52	52	52	52	52	52	50	50	50	50	50	50	50
315	>61	61	57	56	55	55	54	53	52	52	51	51	51	51	50	50	50	50	50	49	49	49
355	>61	61	57	55	54	53	53	52	52	52	51	50	50	50	50	50	49	49	49	48	48	48
400	>61	60	57	55	53	53	53	52	51	51	49	49	49	49	49	48	48	48	48	48	48	48
450	>61	59	56	54	52	52	52	51	50	50	50	48	48	48	48	48	48	48	48	48	48	48
500	60	58	55	54	53	52	52	50	50	50	48	48	48	48	48	48	48	48	48	48	48	48
550	60	58	55	54	53	52	52	50	50	48	48	48	48	48	48	48	48	48	48	48	48	48
560	60	58	55	54	53	52	52	50	50	48	48	48	48	48	48	48	48	48	48	48	48	48
600	60	58	55	54	52	52	51	50	49	48	48	48	48	48	48	48	48	48	48	48	48	48
630	60	58	55	53	51	51	51	50	49	48	48	48	48	48	48	48	48	48	48	48	48	48
650	60	58	55	53	52	51	51	50	49	48	48	48	48	48	48	48	48	48	48	48	48	48
700	59	58	55	53	52	51	51	50	49	48	48	48	48	48	48	48	48	48	48	48	48	48
710	59	58	55	53	52	51	51	50	49	48	48	48	48	48	48	48	48	48	48	48	48	48
750	59	58	55	53	52	51	51	50	49	48	48	48	48	48	48	48	48	48	48	48	48	48
800	59	58	55	53	52	51	51	50	49	48	48	48	48	48	48	48	48	48	48	48	48	48
900	58	56	53	53	52	50	50	48	48	47	48	48	48	48	48	48	48	48	48	48	47	47
1000	58	56	53	53	51	50	50	48	48	48	48	48	48	48	48	48	48	48	48	48	47	47
1100	58	56	53	53	51	50	50	48	48	48	48	48	48	48	48	48	48	48	48	47	47	47
1250	58	56	53	53	51	50	50	48	48	48	48	48	48	48	48	48	48	48	48	47	47	47
1400	58	56	53	52	51	50	48	48	47	47	47	47	47	47	47	47	47	47	47	47	47	46
1500	58	56	53	52	51	50	50	48	47	47	47	47	47	47	47	47	47	47	47	47	47	46
1600	58	56	53	52	51	50	50	48	47	47	47	47	47	47	47	47	47	47	47	47	47	46

Air velocity 8 m/s  
Level of acoustic output [dB]

B																						
A	180	200	225	250	280	300	315	355	400	450	500	550	560	600	630	650	700	710	750	800	900	1000
180	>63	>63	>63	>63	>63	>63	>63	63	62	61	61	60	60	60	60	60	60	60	60	60	60	59
200	>63	>63	>63	>63	>63	62	62	61	60	60	60	60	60	60	60	60	60	60	59	59	59	58
225	>63	>63	>63	>63	>63	61	61	60	60	58	58	58	58	58	58	58	58	58	58	57	57	57
250	>63	>63	>63	>63	61	60	60	59	58	58	57	57	57	57	57	57	57	57	56	56	56	56
280	>63	>63	>63	>63	59	59	59	58	58	57	57	56	56	56	56	56	56	56	56	55	55	54
300	>63	>63	62	61	59	59	59	58	57	56	56	55	55	55	55	55	55	55	55	54	54	54
315	>63	>63	62	61	59	59	58	57	57	56	55	55	55	55	55	55	55	55	55	55	54	54
355	>63	>63	63	59	58	58	57	56	55	55	54	54	54	54	54	54	53	53	53	53	53	53
400	>63	63	62	60	58	57	56	56	55	54	54	54	54	54	54	54	53	53	53	53	52	52
450	>63	63	60	58	57	56	56	55	55	55	54	53	53	53	53	53	53	53	53	53	52	52
500	>63	62	60	58	56	55	55	54	54	54	53	53	53	53	53	53	53	53	53	52	51	51
550	>63	62	59	58	56	56	55	55	54	53	53	53	53	53	53	53	53	53	52	52	51	51
560	>63	62	59	58	56	56	55	55	54	53	53	53	53	53	53	53	53	53	52	52	51	51
600	>63	62	59	58	56	55	55	54	54	53	53	53	53	53	52	52	52	51	51	51	50	50
630	>63	62	59	58	56	55	55	54	54	53	53	53	53	53	52	52	52	51	50	50	50	50
650	>63	61	59	58	56	55	55	54	54	53	53	53	52	51	51	51	51	51	50	50	50	50
700	63	62	59	57	56	55	55	54	54	53	53	53	52	51	51	50	50	50	50	50	49	49
710	63	62	59	57	56	55	55	54	54	53	53	53	52	51	51	50	50	50	50	50	49	49
750	63	62	59	57	56	55	55	54	54	53	52	52	52	52	51	50	50	50	50	50	50	49
800	62	60	57	57	56	55	54	54	54	52	52	52	52	51	51	50	50	50	50	50	50	49
900	62	60	57	56	55	55	54	53	53	52	52	51	51	51	50	50	50	50	50	50	50	50
1000	62	60	57	56	56	55	54	53	53	52	52	51	51	51	50	50	50	50	50	50	50	50
1100	62	60	57	56	56	55	54	53	53	52	51	51	51	50	50	50	50	50	50	50	50	50
1250	62	61	58	56	56	54	54	53	53	52	50	50	50	50	50	50	49	49	49	49	49	49
1400	62	61	57	56	56	53	54	53	53	50	50	50	50	50	50	50	49	49	49	49	49	49
1500	62	61	57	56	56	54	54	53	52	50	50	50	50	50	50	50	49	49	49	49	49	49
1600	62	61	57	56	56	54	54	53	52	50	50	50	50	50	50	50	49	49	49	49	49	49

Air velocity 9 m/s  
Level of acoustic output [dB]

B																						
A	180	200	225	250	280	300	315	355	400	450	500	550	560	600	630	650	700	710	750	800	900	1000
180	>65	>65	>65	>65	>65	>65	>65	>65	>65	65	64	64	64	64	64	64	64	64	64	63	63	63
200	>65	>65	>65	>65	>65	>65	>65	65	64	64	63	63	63	62	62	62	62	62	62	62	61	61
225	>65	>65	>65	>65	>65	>65	65	63	63	62	61	61	61	61	61	61	61	61	61	61	60	60
250	>65	>65	>65	>65	>65	65	65	63	62	61	60	60	60	60	60	60	60	60	60	60	60	60
280	>65	>65	>65	>65	64	63	62	61	61	60	60	60	60	59	59	59	59	59	59	59	58	58
300	>65	>65	>65	65	63	62	62	61	60	60	60	60	60	60	60	59	59	59	59	59	59	59
315	>65	>65	>65	64	63	62	61	61	60	60	60	60	60	59	59	59	59	59	59	59	59	58
355	>65	>65	>65	64	62	61	60	60	60	60	60	59	59	59	59	58	58	58	58	58	58	58
400	>65	>65	>65	63	61	60	60	59	58	58	58	58	58	58	58	58	58	58	58	58	57	57
450	>65	>65	65	63	60	60	60	59	58	58	58	57	57	57	57	57	57	57	57	57	56	56
500	>65	>65	64	61	60	60	60	59	58	57	57	57	57	57	56	56	56	56	56	56	56	55
550	>65	>65	62	62	60	60	58	57	58	58	57	57	57	56	56	56	56	56	56	56	56	55
560	>65	>65	62	62	60	60	58	57	58	58	57	57	57	56	56	56	56	56	56	56	55	55
600	>65	>65	62	62	60	59	58	58	58	57	56	56	56	56	56	56	55	55	55	55	55	55
630	>65	>65	62	62	60	59	58	58	58	57	56	56	56	56	56	56	55	55	55	55	55	55
650	>65	>65	62	62	59	59	58	58	58	57	56	56	56	56	56	56	55	55	55	55	55	55
700	>65	>65	62	61	59	59	58	58	57	56	55	55	55	55	55	55	55	55	55	55	55	54
710	>65	>65	62	61	59	59	58	58	57	56	55	55	55	55	55	55	55	55	55	55	55	54
750	>65	>65	62	61	59	59	58	57	57	56	55	55	55	55	55	55	55	55	55	55	55	55
800	>65	64	62	61	59	59	58	57	57	56	55	55	55	55	55	55	55	55	55	55	54	54
900	>65	64	62	60	60	59	58	57	57	55	55	55	55	55	55	55	54	55	55	55	54	54
1000	>65	64	60	60	58	58	58	57	57	55	55	55	55	55	55	55	55	55	55	55	54	54
1100	>65	64	60	59	58	58	57	57	57	55	55	55	55	55	55	55	55	55	55	55	54	54
1250	>65	64	60	59	58	58	57	57	56	55	55	55	55	55	54	54	54	54	54	54	54	53
1400	>65	64	61	60	58	58	57	57	56	56	55	55	55	55	55	54	54	54	54	54	53	53
1500	>65	64	60	60	58	58	56	56	56	56	55	55	55	55	55	54	54	54	53	53	53	53
1600	>65	64	60	60	58	58	56	56	56	56	55	55	55	55	55	54	54	54	53	53	53	53

## VIII. MATERIAL, FINISHING

- Damper casings and blades are made of fire resistant asbestos free boards made of mineral fibres.
- Damper bodies and blades can be coated with Promat 2000 anti-moisture coating or Promat-SR anti-aggressive coating.
- Fasteners are galvanized.
- According to the customer's requirements, damper can be made of stainless material.

### Specifications for stainless-steel models – classification of stainless steel:

- Class A2 – Food-grade stainless steel (AISI 304 – EN 17240)
- Class A4 – Chemistry-grade stainless steel (AISI 316, 316L – EN 17346, 17349)

The respective stainless steel is the material for all components present or accessing the damper interior; components outside the damper body are typically from galvanised sheet metal (fasteners for mounting the actuator).

### The following components, including the fasteners, are made from stainless steel at all times:

- Damper body and all components permanently attached
- Blade's holders, including pins, metal parts of blade
- Inspection hole cover and fasteners (if they are parts of the cover)

Everything that is located or enters the inner space or the cross-section of the damper is from a given stainless-steel material. The parts located outside the body and in the damper mechanism space are made of galvanised material as standard. In the case of the stainless-steel design, the cover grilles are always made of galvanised material with a "powder-coated" coating.

Plastic, rubber and silicon components, sealants, foaming bands, glass-ceramic seals, housings, brass bearings of the blade, actuators, and end switches are identical for all material variants of the dampers.

Some fasteners and components are available in one class of stainless steel; the type will be used in all stainless-steel variants.

The blade in the variants for chemical environments (Class A4) is always treated with a coating of chemically resistant Promat SR.

Any other requirements for the design shall be considered atypical and shall be addressed on an individual basis.

## IX. TRANSPORTATION, STORAGE AND WARRANTY

### Logistic terms

- Dampers are delivered on pallets. As standard, the dampers are wrapped in plastic foil for protection during transport and must not be used for long-term storage of the equipment. Changes in temperature during transport may cause condensation of water vapour inside the packaging and thereby conditions may arise inside the packaging that are suitable for corrosion of materials used in the equipment (e.g. white corrosion on zinc-coated items or mould on calcium silicate). Therefore, it is necessary to remove the transport packaging immediately after unloading to allow air to circulate around the product.
- The equipment must be stored in clean, dry, well ventilated and dust-free environment out of direct sunlight. ensuring protection against moisture and extremes of temperatures (minimum temperature +5°C) the equipment must be protected against mechanical and accidental damage prior to installation.
- Another required packaging system should be approved and agreed by manufacturer. Packaging material is not returnable in case that another packaging system (material) is required and used and it is not included into final price of damper.
- For unloading and further manipulation with the damper is necessary to use appropriate tooling (forklifts) due to damper weight. Dampers are fragile.
- Dampers are transported by box freight vehicles without direct weather impact, there must not occur any shocks and ambient temperature must not exceed +50°C. Dampers must be protected against impact when transported and manipulated. During transportation, the damper blades must be in the "CLOSED" position.
- Dampers are stored indoor in environment without any aggressive vapours, gases or dust. Indoor temperature must be in the range from -30°C to +50°C and maximum relative humidity 95% (avoid condensation on the damper body). Dampers must be protected against impact when transported and manipulated.

### Warranty

- The manufacturer provides a warranty of 24 months from the date of dispatch for the dampers.
- If a Schischek actuator is used, the actuator is warranted by the manufacturer for 12 months.
- The warranty for fire dampers SEDM, provided by the manufacturer, is completely void if actuating, closing and control devices are unprofessionally handled by untrained workers or if electric components, i.e. actuators.
- The warranty is void if dampers are used for other purposes, devices and working conditions than those allowed by these technical conditions or if the dampers are mechanically damaged during handling.
- If the dampers are damaged by transport, a record must be written down with the forwarder at reception for later complaint.

## X. ASSEMBLY, ATTENDANCE AND MAINTENANCE

- Assembly, maintenance and damper function check can be done only by qualified and trained person, i.e. "AUTHORIZED PERSON" according to the manufacturer documentation. All works done on the smoke control dampers must be done according international and local norms and laws.
- All effective safety standards and directives must be observed during damper assembly.
- To ensure reliable smoke exhaust damper function it is necessary to avoid blocking the closing mechanism and contact surfaces with collected dust, fibre and sticky materials and solvents.
- Manual operation
  - Without power supply, the damper can be operated manually and fixed in any required position.



## Electrical connection of the actuator in protection box

### Protection box without slot or predrilled holes


- Drill two holes into the protection box (from outside to inside) and pull through field wiring cables (CAT 3 fire resistant cables as BS 8519) to connect to the actuator trailing lead inside the housing, using a standard screwed cable connector block, the protection box is made of calcium silicate plates.
- Procedure
  - Use drill (drill size acc. To suit connecting cable  $\varnothing + 2$  mm for seal up by mastic) and make two holes. It is possible to drill holes in any side of the housing.
  - Pull the heat resistant cable through the calcium silicate plate (wall) and connect with cables from actuator acc. to above mentioned electrical diagram.
  - Seal up the space around cable with fire resistant mastic (HILTI CFS-S ACR, PROMASTOP) or equivalent.
  - Let the mastic harden.



*Example of position of holes in the wall of the box, without pre-manufactured slot*

### Protection box with slot including intumescent tapes – not available for UK


- To connect the actuator, use the prepared hole in the box, which is equipped with intumescent tape.
- If necessary, the hole can be additionally filled with fire-resistant sealant.

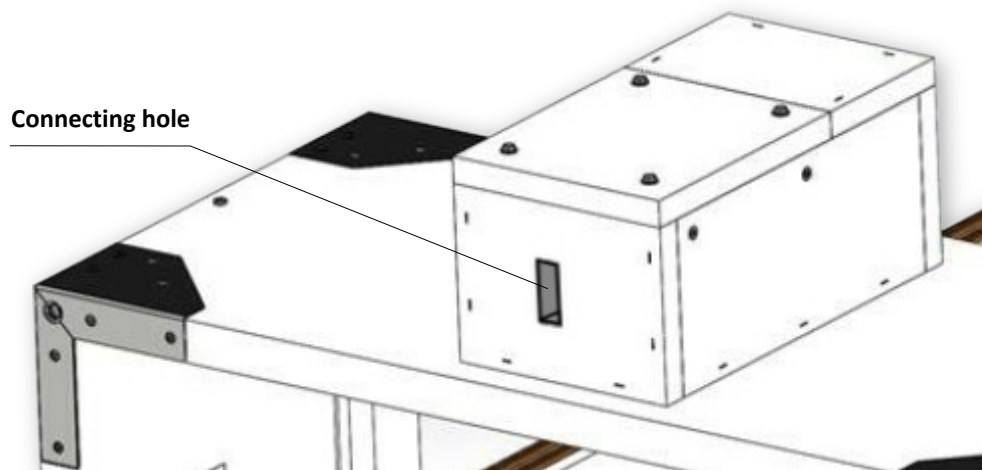

*Example of pre-manufactured slot in the insulating box, with intumescent tape inside slot*

## Entry into service and revisions

- Before entering the dampers into operation after assembly and after sequential revisions, checks and functionality tests of all designs including operation of the electrical components must be successfully provided and finished. After entering into operation, these revisions must be done according to requirement set by national regulations.
- In case that dampers are found unable to serve for their function for any cause, it must be clearly marked. The operator is obliged to ensure that the damper is put into condition in which it is ready for function and meanwhile he is obliged to provide the fire protection by another appropriate way.
- Removing the inspection hole cover
  - Unscrew four of the edge screws to release the cover and then remove it from its original position.
- Results of regular checks, imperfections found and all-important facts connected with the damper function must be recorded in the "FIRE BOOK" and immediately reported to the operator.
- Before entering the dampers into operation after their assembly and by sequential checks, the following checks must be carried out for all designs.
- Visual inspection of proper damper integration, inside damper area, damper blade, contact surfaces and silicon sealing.

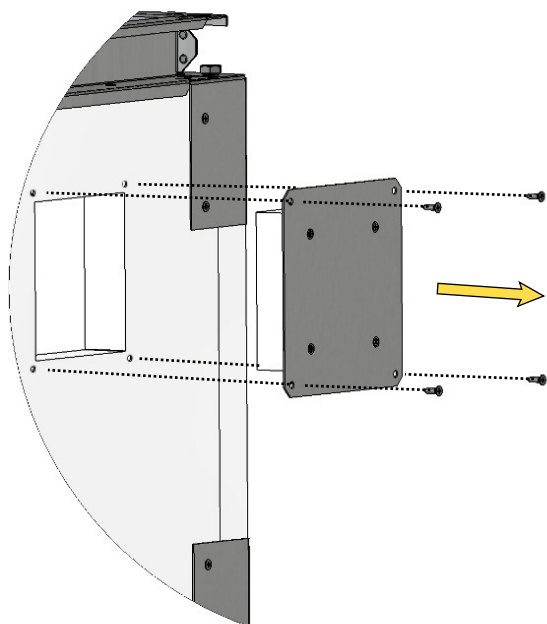


*Inspection hole detail*

- Ensure each damper is fully checked for operational capability, control should be initiated from the control system. Dampers blades should open and close correctly and operation should be visually inspected and documented prior to handover.

# XI. ORDERING INFORMATION

## Ordering key

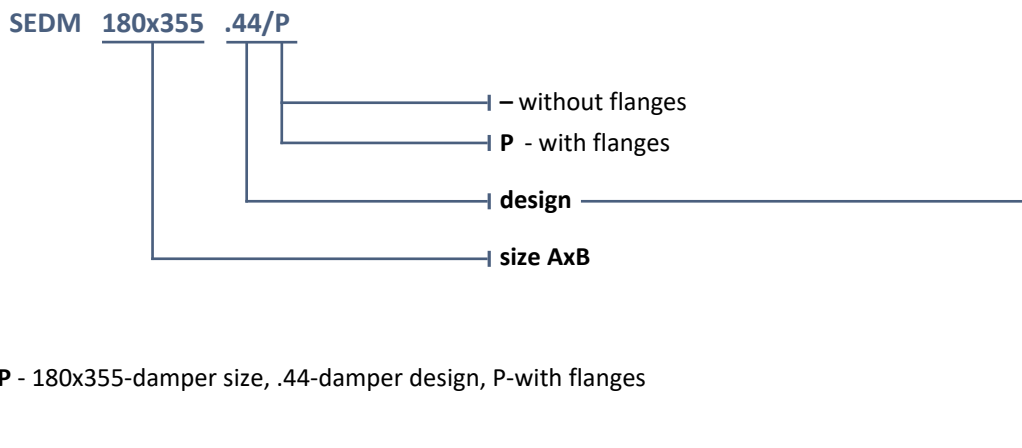

**EXAMPLE:**

**SEDM 180x355 .44/P** - 180x355-damper size, .44-damper design, P-with flanges


Dampers design	Additional digit
with actuating mechanism BEN, BEE, BE, InMax 50.75-S for 230V	.44
with actuating mechanism BEN, BEE, BE, InMax 50.75-S for 24V	.54
with actuating mechanism BEN (BEE)-SR for 24V	.65*

\* Design .65 is not available by using actuating mechanism BE, InMax 50.75-S

## Data label

- Data label is placed on the damper casing (example)


**MANDÍK**<sup>®</sup> MANDÍK, a.s.  
Dobříšská 550, 267 24 Hostomice, Czech Republic

**MULTI COMPARTMENT SMOKE CONTROL DAMPER - XXXX** 

DIMENSION:  DESIGN:

SERIAL.NO.:  WEIGHT (kg):  **MANUAL**

CLASSIFICATION:

TPM XXX/XX Cert. No.: 1391-CPR-XXXX/XXXX, DoP: PM/XXXX/XX/XX/X  EN 12101-8:2011

The producer reserves the right for innovations of the product.  
For actual product information see [www.mandik.com](http://www.mandik.com)

**MANDÍK**<sup>®</sup>  
[www.mandik.com](http://www.mandik.com)